


# **OIL ANALYSIS REPORT**

Sample Rating Trend



NORMAL



Machine Id

# FES TYSNAS HS 10 (S/N 2555348)

Refrigeration Compressor

USPI ALT-68 SC (--- GAL)

#### DIAGNOSIS

## Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

## Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


## **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


		12014 Jan20	16 Jan 2017 Apr 2018		hpr2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USP0013384	USP0007265	USP0001242
Sample Date		Client Info		11 Jun 2024	05 Feb 2024	15 Oct 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	0	0	0
Chromium	ppm	ASTM D5185m	>2	0	0	0
Nickel	ppm	ASTM D5185m		0	0	<1
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>3	0	0	0
Lead	ppm	ASTM D5185m	>2	0	0	<1
Copper	ppm	ASTM D5185m	>8	0	<1	0
Tin	ppm	ASTM D5185m	>4	0	0	0
Vanadium	ppm	ASTM D5185m		<1	<1	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	<1	0
Magnesium	ppm	ASTM D5185m		<1	0	<1
Calcium	ppm	ASTM D5185m		0	0	0
Phosphorus	ppm	ASTM D5185m		<1	0	0
Zinc	ppm	ASTM D5185m		0	0	<1
Sulfur	ppm	ASTM D5185m	50	0	10	0
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	2	2	2
Sodium	ppm	ASTM D5185m		<1	<1	0
Potassium	ppm	ASTM D5185m	>20	<1	2	<1
Water	%	ASTM D6304	>0.01	0.006	0.003	0.004
ppm Water	ppm	ASTM D6304	>100	63	31	45.9
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	4789	3459	4867
Particles >6µm		ASTM D7647	>2500	1274	1173	1477
Particles >14µm		ASTM D7647	>320	25	48	46
Particles >21µm		ASTM D7647	>80	3	8	4
Particles >38µm		ASTM D7647	>20	0	0	0
Particles >71µm		ASTM D7647	>4	0	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	19/17/12	19/17/13	19/18/13
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.005	0.014	0.014	0.014





# **OIL ANALYSIS REPORT**




1k - 4µ	m				
ik - Abnomal	um				
lk -	- A			11111	
ik -					
Abnormal		1111111		$\Lambda$	
ik	IAIA	m		11	۸.
k A	-AW			- Comment	~~
Oct19/14 Jan17/16	Jan15/17 Apr17/18	Jul17/19	Oct7/20	22	Apr5/23







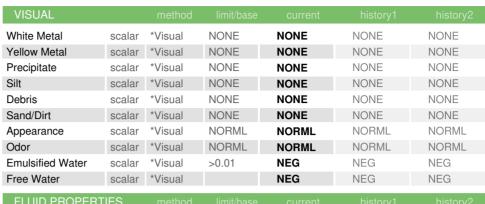

I LOID I HOI LITT	ILO					
Visc @ 40°C	cSt	ASTM D445	65.6	66.1	65.7	65.9

Color	
00101	



SAMPLE IMAGES



	rous	Alloys	;						icle Count			
	irc							491,520				ľ
*****	reserves Ul				بالجابا			122,880 <b>Severe</b>				-2
		11111						30,720				+
4		>		6	0.	2	23	7,680 Abnorm	idi			+2
0ct19/14	Jan17/16	Jan15/17	Apr17/18	Jul17/19	0ct7/20	Jan11/22	Apr5/23	1,920	1			-1
			1etals			7		1,920 - 480 - 120	1.			+2 +1 +1 +1 +1
		pper						120-	/			-1
	mananan lea							图 30-				-1
~	1	AX/	200		A			8-		1		-1
0ct19/14	Jan17/16	Jan 15/17	4pr17/18	eL/LInf	0ct7/20	Jan11/22	Apr5/23	2-				-8
0ct1	Jan1	Jan	Apr1	Jul	00	Jan1	Api	0,	C. 1	4μ 21μ	38μ	71.0
	cosity	@ 40	0°C					Acid	6μ 1 I Number	τμ 21μ	ι ουμ	/1μ
Abno	ormal							(B/H0.04				11111
Base	^		^	_		_		E 0.03			٨	
Abno	ormal						-	Acid Mumber (mg KOH/g)		~~	—/ L	
14	91	17	81	- 61	20	22	- 53	Acid 45	- L	80 6	20-	23
Oct19/14	Jan17/16	Jan 15/17	Apr17/18	Jul17/19	0ct7/20	Jan11/22	Apr5/23	0ct19/14	Jan17/16	Apr17/18 Jul17/19	Oct7/20 Jan11/22	Apr5/23





Certificate 12367

Laboratory Sample No.

: USP0013384 Lab Number : 06207882 Unique Number : 11075343

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 12 Jun 2024 **Tested** : 14 Jun 2024

Diagnosed : 15 Jun 2024 - Doug Bogart **TYSON -NASHVILLE-USP** 

NASHVILLE, AR US Contact: SERVICE MANAGER

Test Package : IND 2 To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: