




OIL ANALYSIS REPORT

Sample Rating Trend

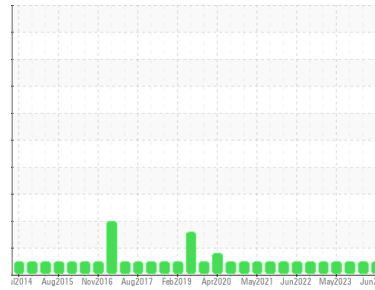

NORMAL



Machine Id
C-7 (S/N S0385JFMFTHAA3)
 Component
Refrigeration Compressor
 Fluid
USPI ALT-68 SC (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a trace of moisture present in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

| SAMPLE INFORMATION | | method | limit/base | current | history1 | history2 |
|--------------------|-------------|-------------|------------|--------------------|-------------|-------------|
| Sample Number | Client Info | | | USP0013406 | USP0003525 | USP0000646 |
| Sample Date | Client Info | | | 11 Jun 2024 | 23 Nov 2023 | 16 Aug 2023 |
| Machine Age | hrs | Client Info | | 0 | 0 | 0 |
| Oil Age | hrs | Client Info | | 0 | 0 | 0 |
| Oil Changed | Client Info | | | N/A | N/A | N/A |
| Sample Status | | | | NORMAL | NORMAL | NORMAL |

| WEAR METALS | | method | limit/base | current | history1 | history2 |
|-------------|-----|-------------|------------|--------------|----------|----------|
| Iron | ppm | ASTM D5185m | >8 | 2 | 2 | <1 |
| Chromium | ppm | ASTM D5185m | >2 | 0 | <1 | 0 |
| Nickel | ppm | ASTM D5185m | | 0 | <1 | 0 |
| Titanium | ppm | ASTM D5185m | | 0 | <1 | <1 |
| Silver | ppm | ASTM D5185m | >2 | 0 | 0 | 0 |
| Aluminum | ppm | ASTM D5185m | >3 | 0 | 1 | <1 |
| Lead | ppm | ASTM D5185m | >2 | 0 | 0 | 0 |
| Copper | ppm | ASTM D5185m | >8 | 0 | <1 | <1 |
| Tin | ppm | ASTM D5185m | >4 | 0 | 0 | 0 |
| Vanadium | ppm | ASTM D5185m | | <1 | 0 | <1 |
| Cadmium | ppm | ASTM D5185m | | 0 | <1 | 0 |

| ADDITIVES | | method | limit/base | current | history1 | history2 |
|------------|-----|-------------|------------|----------|----------|----------|
| Boron | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Barium | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Molybdenum | ppm | ASTM D5185m | | 0 | <1 | 0 |
| Manganese | ppm | ASTM D5185m | | 0 | 0 | <1 |
| Magnesium | ppm | ASTM D5185m | | 0 | <1 | 0 |
| Calcium | ppm | ASTM D5185m | | 0 | <1 | 0 |
| Phosphorus | ppm | ASTM D5185m | | 0 | 0 | 1 |
| Zinc | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Sulfur | ppm | ASTM D5185m | 50 | 0 | 0 | 0 |






| CONTAMINANTS | | method | limit/base | current | history1 | history2 |
|--------------|-----|-------------|------------|--------------|----------|----------|
| Silicon | ppm | ASTM D5185m | >15 | <1 | <1 | <1 |
| Sodium | ppm | ASTM D5185m | | 0 | 0 | 1 |
| Potassium | ppm | ASTM D5185m | >20 | 1 | <1 | 1 |
| Water | % | ASTM D6304 | >0.01 | 0.011 | 0.009 | 0.013 |
| ppm Water | ppm | ASTM D6304 | >100 | 112 | 93 | 135.8 |

| FLUID CLEANLINESS | | method | limit/base | current | history1 | history2 |
|-------------------|--|--------------|------------|-----------------|----------|----------|
| Particles >4µm | | ASTM D7647 | >10000 | 1031 | 495 | 2424 |
| Particles >6µm | | ASTM D7647 | >2500 | 204 | 114 | 811 |
| Particles >14µm | | ASTM D7647 | >320 | 6 | 17 | 51 |
| Particles >21µm | | ASTM D7647 | >80 | 2 | 8 | 10 |
| Particles >38µm | | ASTM D7647 | >20 | 0 | 5 | 0 |
| Particles >71µm | | ASTM D7647 | >4 | 0 | 2 | 0 |
| Oil Cleanliness | | ISO 4406 (c) | >20/18/15 | 17/15/10 | 16/14/11 | 18/17/13 |

| FLUID DEGRADATION | | method | limit/base | current | history1 | history2 |
|-------------------|----------|-----------|------------|--------------|----------|----------|
| Acid Number (AN) | mg KOH/g | ASTM D974 | 0.005 | 0.014 | 0.014 | 0.014 |




OIL ANALYSIS REPORT

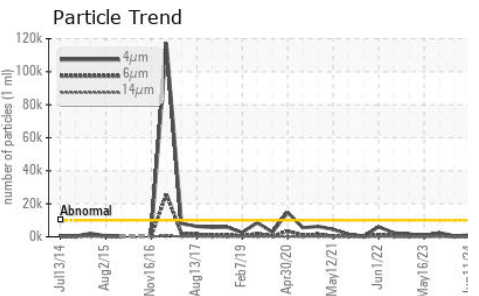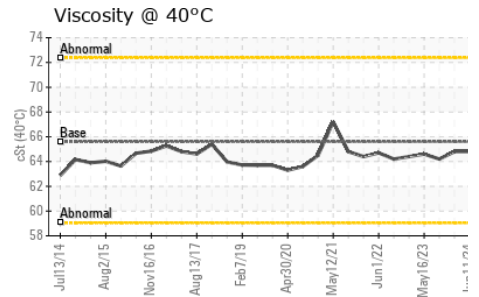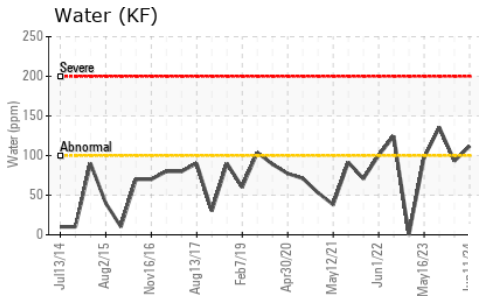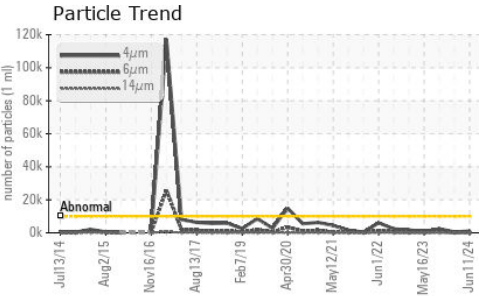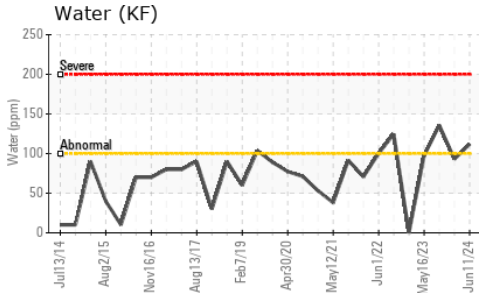






| VISUAL | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal | scalar | *Visual | NONE | NONE | NONE |
| Yellow Metal | scalar | *Visual | NONE | NONE | NONE |
| Precipitate | scalar | *Visual | NONE | NONE | NONE |
| Silt | scalar | *Visual | NONE | NONE | NONE |
| Debris | scalar | *Visual | NONE | NONE | NONE |
| Sand/Dirt | scalar | *Visual | NONE | NONE | NONE |
| Appearance | scalar | *Visual | NORML | NORML | NORML |
| Odor | scalar | *Visual | NORML | NORML | NORML |
| Emulsified Water | scalar | *Visual | >0.01 | NEG | NEG |
| Free Water | scalar | *Visual | | NEG | NEG |

| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| Visc @ 40°C | cSt | ASTM D445 | 65.6 | 64.8 | 64.2 |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
|---------------|--------|------------|---------|----------|----------|

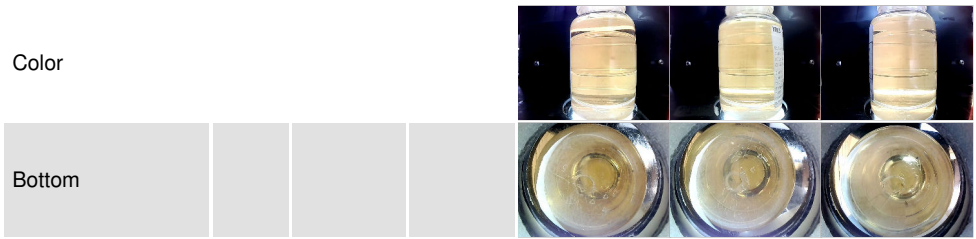

GRAPHS

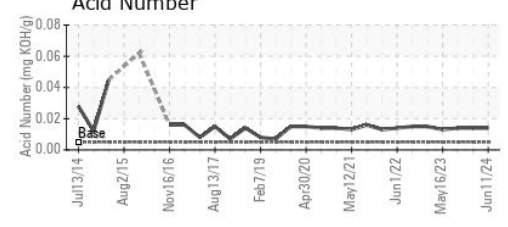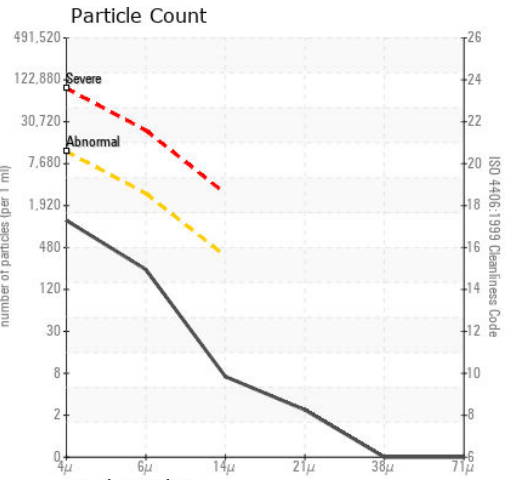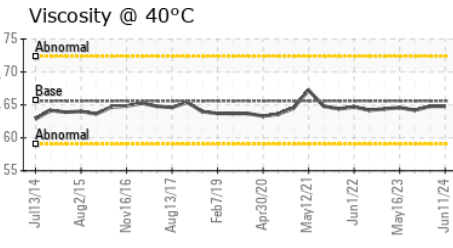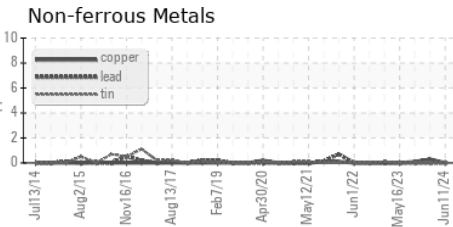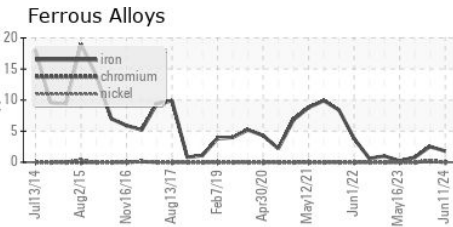

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : USP0013406
 Lab Number : 06207898
 Unique Number : 11075359
 Test Package : IND 2
 Received : 12 Jun 2024
 Tested : 14 Jun 2024
 Diagnosed : 15 Jun 2024 - Doug Bogart

CONAGRA - LOUISVILLE
 12730H WESTPORT RD
 LOUISVILLE, KY
 US 40245
 Contact: SCOTT CASTILLO

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: