




OIL ANALYSIS REPORT

Sample Rating Trend

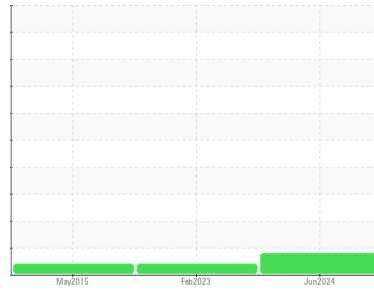

SEDIMENT



Machine Id
KAESER 4951367 - AURORA TECHNOLOGIES (S/N 1020)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (10 GAL)

DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a moderate amount of visible silt present in the sample.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0915298	WC0758270	WCI2235344
Sample Date	Client Info			02 Jun 2024	14 Feb 2023	13 May 2015
Machine Age	hrs	Client Info		41597	33563	5497
Oil Age	hrs	Client Info		0	2708	3732
Oil Changed		Client Info		N/A	N/A	Changed
Sample Status				ABNORMAL	MARGINAL	ABNORMAL

CONTAMINATION	method	limit/base	current	history1	history2
Water	WC Method	>0.05	NEG	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	<1
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	<1	<1	0
Lead	ppm	ASTM D5185m	>10	0	0	<1
Copper	ppm	ASTM D5185m	>50	7	4	3
Tin	ppm	ASTM D5185m	>10	0	0	<1
Antimony	ppm	ASTM D5185m		---	---	0
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		0	0	0


ADDITIVES	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	0	0	
Barium	ppm	ASTM D5185m	90	95	66	122
Molybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m	0	0	<1	
Magnesium	ppm	ASTM D5185m	90	86	53	123
Calcium	ppm	ASTM D5185m	2	3	2	0
Phosphorus	ppm	ASTM D5185m	4	<1	0	
Zinc	ppm	ASTM D5185m	0	4	0	
Sulfur	ppm	ASTM D5185m	20588	17694	24683	

CONTAMINANTS	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>25	0	0	<1
Sodium	ppm	ASTM D5185m	15	10	17	
Potassium	ppm	ASTM D5185m	>20	7	3	4

FLUID DEGRADATION	method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.34	0.33	0.386




OIL ANALYSIS REPORT

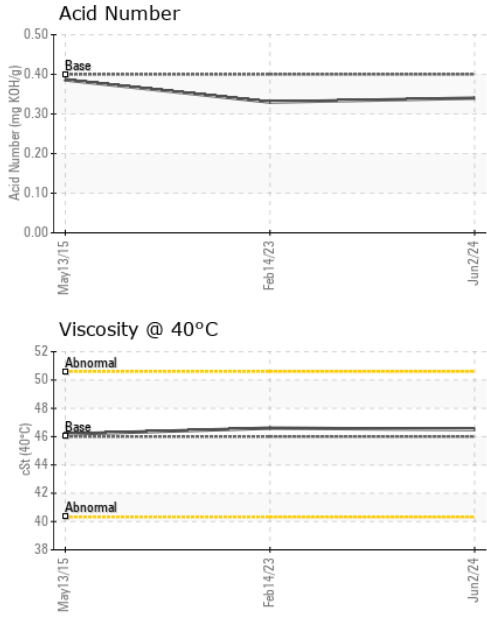





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	▲ MODER	NONE
Debris	scalar	*Visual	NONE	▲ MODER	▲ HEAVY
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	46	46.5	46.6	46.18

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

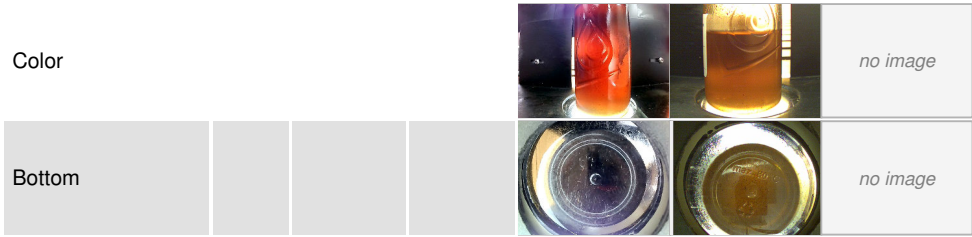

GRAPHS

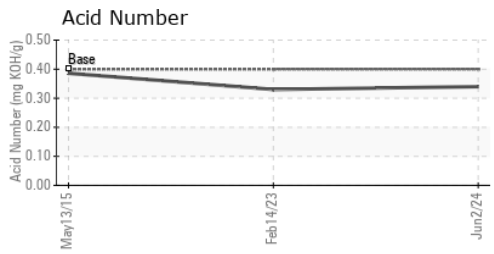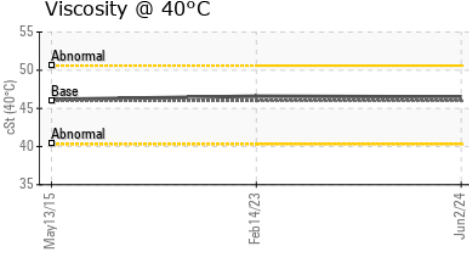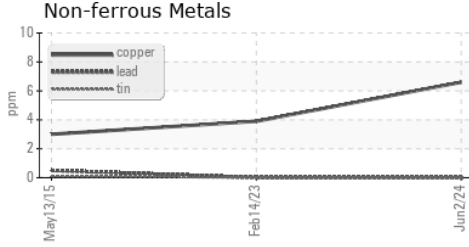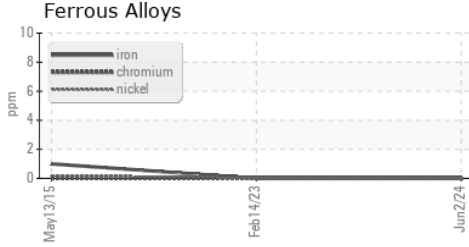

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0915298 **Received** : 12 Jun 2024
Lab Number : 06207920 **Tested** : 14 Jun 2024
Unique Number : 11075381 **Diagnosed** : 14 Jun 2024 - Don Baldrige
Test Package : IND 2

ELEVATED INDUSTRIAL SOLUTIONS - EIS
 302 HUGHES ST
 FOUNTAIN INN, SC
 US 29644
 Contact: DARRIN WARD
 dward@elevatedindustrial.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: (864)862-7653