




# OIL ANALYSIS REPORT

Sample Rating Trend

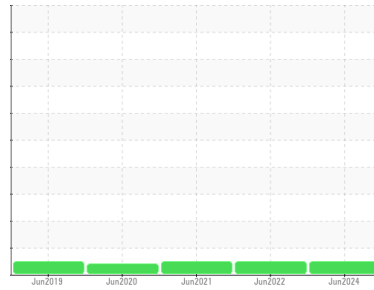

**NORMAL**



Machine Id  
**KAESER 4001677 - BOYSEN (S/N 1484)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) S-460 (5 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC0915315</b>	WC0679494	WC0575830
Sample Date	Client Info			<b>06 Jun 2024</b>	22 Jun 2022	09 Jun 2021
Machine Age	hrs	Client Info		<b>42685</b>	39149	39148
Oil Age	hrs	Client Info		<b>400</b>	1	2
Oil Changed	Client Info			<b>Changed</b>	Changed	Changed
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.05	<b>NEG</b>	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	<1	<1
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	<1
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>&lt;1</b>	1	<1
Lead	ppm	ASTM D5185m	>10	<b>0</b>	<1	0
Copper	ppm	ASTM D5185m	>50	<b>2</b>	<1	2
Tin	ppm	ASTM D5185m	>10	<b>0</b>	<1	<1
Antimony	ppm	ASTM D5185m		<b>---</b>	---	<1
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0


ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	13
Barium	ppm	ASTM D5185m	90	<b>16</b>	23	8
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m	90	<b>68</b>	80	65
Calcium	ppm	ASTM D5185m	2	<b>2</b>	<1	<1
Phosphorus	ppm	ASTM D5185m		<b>1</b>	9	7
Zinc	ppm	ASTM D5185m		<b>14</b>	6	13
Sulfur	ppm	ASTM D5185m		<b>22397</b>	18416	16431

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>0</b>	<1	<1
Sodium	ppm	ASTM D5185m		<b>25</b>	10	20
Potassium	ppm	ASTM D5185m	>20	<b>4</b>	2	2

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	<b>0.36</b>	0.39	0.310




# OIL ANALYSIS REPORT

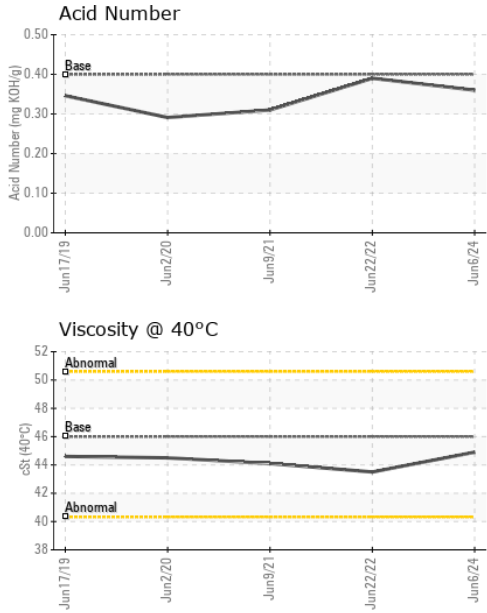





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	46	<b>44.9</b>	43.5	44.1

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

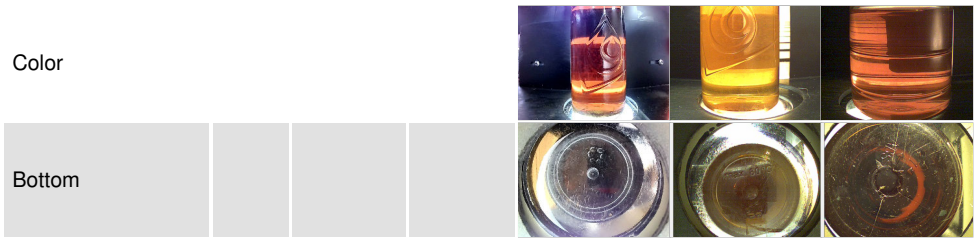

## GRAPHS

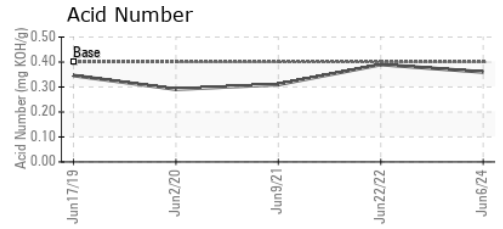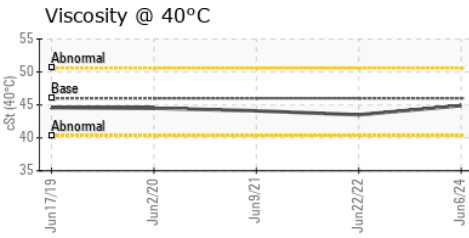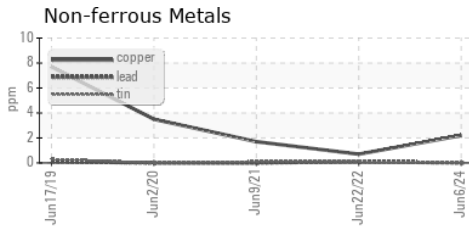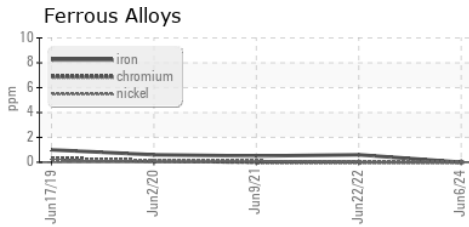

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0915315      **Received** : 12 Jun 2024  
**Lab Number** : **06207937**      **Tested** : 14 Jun 2024  
**Unique Number** : 11075398      **Diagnosed** : 14 Jun 2024 - Don Baldrige  
**Test Package** : IND 2

**ELEVATED INDUSTRIAL SOLUTIONS - EIS**  
 302 HUGHES ST  
 FOUNTAIN INN, SC  
 US 29644  
 Contact: DARRIN WARD  
 dward@elevatedindustrial.com  
 T:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: (864)862-7653