




PROBLEM SUMMARY

Area
NOT GIVEN [CSA1148]
 Machine Id
INGERSOLL RAND CBV880149 - OTC
 Component
Compressor



Sample Rating Trend

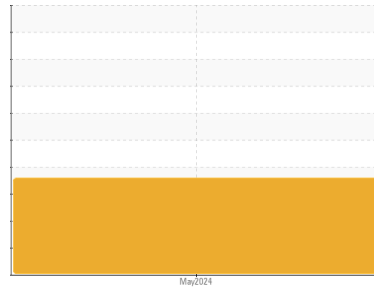

DEGRADATION



COMPONENT CONDITION SUMMARY

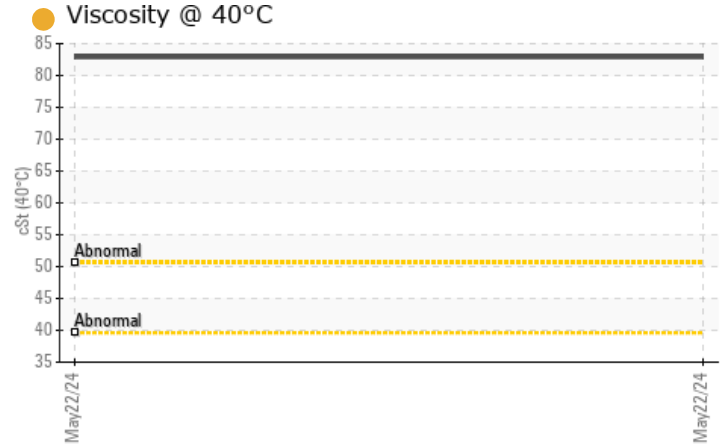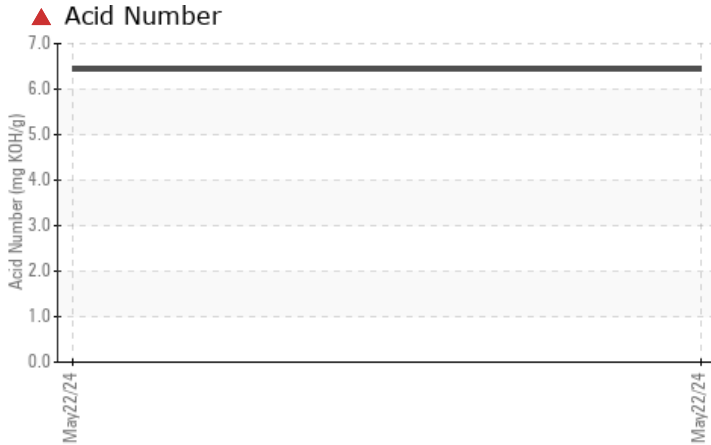

RECOMMENDATION

We advise that you check for a possible overheat condition. We recommend that you drain the oil from the component if this has not already been done. We recommend an early resample to monitor this condition.

PROBLEMATIC TEST RESULTS

Sample Status	mg KOH/g	ASTM D8045	SEVERE	---	---
Acid Number (AN)	6.434		▲	---	---

Customer Id: UCAIRLOU
 Sample No.: UCH06207951
 Lab Number: 06207951
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS


Action	Status	Date	Done By	Description
Change Fluid	---	---	?	We recommend that you drain the oil from the component if this has not already been done.
Resample	---	---	?	We recommend an early resample to monitor this condition.
Check For Overheating	---	---	?	We advise that you check for a possible overheat condition.

HISTORICAL DIAGNOSIS



OIL ANALYSIS REPORT

Sample Rating Trend

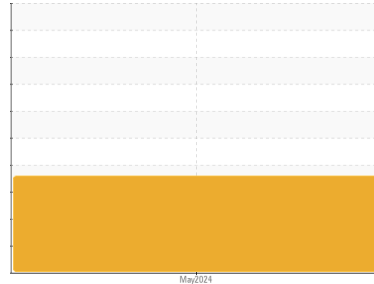

DEGRADATION



Area

NOT GIVEN [CSA1148]

Machine Id

INGERSOLL RAND CBV880149 - OTC

Component

Compressor

DIAGNOSIS

▲ Recommendation

We advise that you check for a possible overheat condition. We recommend that you drain the oil from the component if this has not already been done. We recommend an early resample to monitor this condition.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

▲ Fluid Condition

The AN level is above the recommended limit. The oil viscosity is higher than normal. TAN level indicates possible presence of varnish. The oil is no longer serviceable.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		UCH06207951	---	---
Sample Date	Client Info		22 May 2024	---	---
Machine Age	hrs	Client Info	9482	---	---
Oil Age	hrs	Client Info	9482	---	---
Oil Changed	Client Info		Not Chngd	---	---
Sample Status			SEVERE	---	---

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	NEG	---	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<1	---	---
Chromium	ppm	ASTM D5185m >10	0	---	---
Nickel	ppm	ASTM D5185m	0	---	---
Titanium	ppm	ASTM D5185m	0	---	---
Silver	ppm	ASTM D5185m	0	---	---
Aluminum	ppm	ASTM D5185m >25	<1	---	---
Lead	ppm	ASTM D5185m >25	<1	---	---
Copper	ppm	ASTM D5185m >50	4	---	---
Tin	ppm	ASTM D5185m >15	3	---	---
Vanadium	ppm	ASTM D5185m	<1	---	---
Cadmium	ppm	ASTM D5185m	<1	---	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	6	---	---
Barium	ppm	ASTM D5185m	156	---	---
Molybdenum	ppm	ASTM D5185m	0	---	---
Manganese	ppm	ASTM D5185m	<1	---	---
Magnesium	ppm	ASTM D5185m	2	---	---
Calcium	ppm	ASTM D5185m	2	---	---
Phosphorus	ppm	ASTM D5185m	12	---	---
Zinc	ppm	ASTM D5185m	8	---	---
Sulfur	ppm	ASTM D5185m	595	---	---

CONTAMINANTS



	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	5	---	---
Sodium	ppm	ASTM D5185m	54	---	---
Potassium	ppm	ASTM D5185m >20	9	---	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	▲ 6.434	---	---



OIL ANALYSIS REPORT

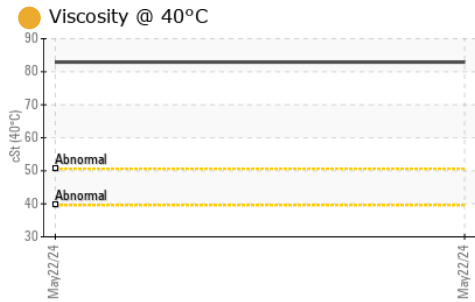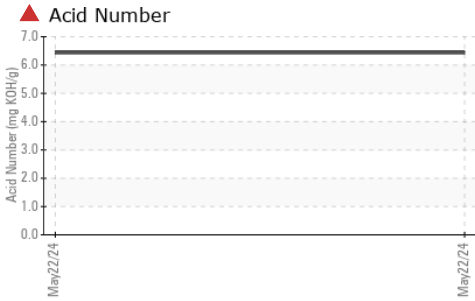





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Precipitate	scalar	*Visual	NONE	NONE	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---	---
Free Water	scalar	*Visual		NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	● 82.9	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

GRAPHS

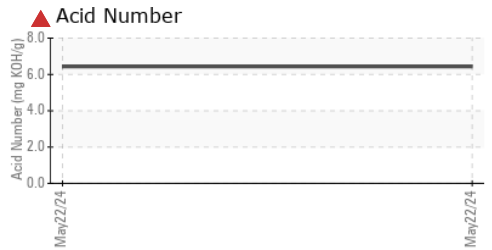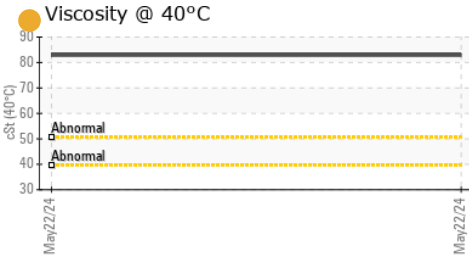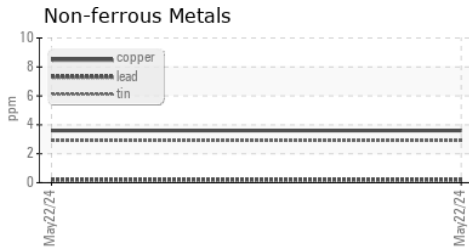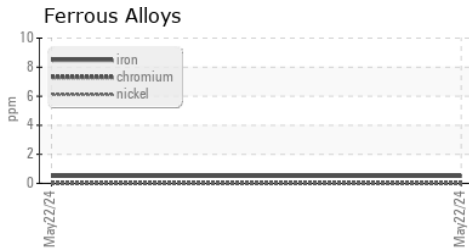

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : UCH06207951 **Received** : 12 Jun 2024
Lab Number : 06207951 **Tested** : 14 Jun 2024
Unique Number : 11075412 **Diagnosed** : 14 Jun 2024 - Don Baldrige
Test Package : IND 2

AIR TECHNOLOGIES INC (LOU)
 1302 N ENGLISH STATION RD
 LOUISVILLE, KY
 US 40223-2280
 Contact: BRYAN BENJAMIN
 bryan.benjamin@aircompressors.com
 T: (502)253-6361
 F: (502)254-2523

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)