




OIL ANALYSIS REPORT

Sample Rating Trend

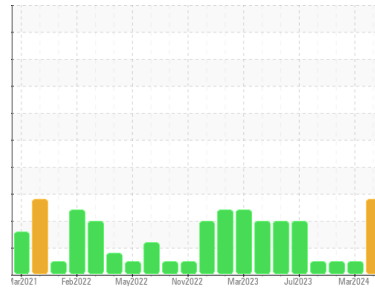

ISO



Machine Id

R8-G-003

Component

Diesel Engine

Fluid

DISEL ENGINE OIL SAE 40 (--- GAL)

DIAGNOSIS

Recommendation

The offline filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KL0014426	KL0013929	KL0013874
Sample Date	Client Info		17 May 2024	29 Mar 2024	28 Feb 2024
Machine Age	days	Client Info	45419	45371	0
Oil Age	days	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ABNORMAL	NORMAL	NORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>5	<1.0	<1.0	<1.0
Water	WC Method	>0.2	NEG	NEG	NEG
Glycol	WC Method		NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >100	37	40	51
Chromium	ppm	ASTM D5185m >20	<1	<1	<1
Nickel	ppm	ASTM D5185m >4	0	0	0
Titanium	ppm	ASTM D5185m	0	<1	0
Silver	ppm	ASTM D5185m >3	0	0	0
Aluminum	ppm	ASTM D5185m >20	3	2	3
Lead	ppm	ASTM D5185m >40	9	8	11
Copper	ppm	ASTM D5185m >330	12	18	22
Tin	ppm	ASTM D5185m >15	<1	<1	1
Vanadium	ppm	ASTM D5185m	<1	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 250	254	262	147
Barium	ppm	ASTM D5185m 10	0	0	0
Molybdenum	ppm	ASTM D5185m 100	126	119	108
Manganese	ppm	ASTM D5185m	<1	<1	<1
Magnesium	ppm	ASTM D5185m 450	776	667	698
Calcium	ppm	ASTM D5185m 3000	1804	1575	1418
Phosphorus	ppm	ASTM D5185m 1150	838	876	805
Zinc	ppm	ASTM D5185m 1350	1032	961	978
Sulfur	ppm	ASTM D5185m 4250	3319	3031	2742

CONTAMINANTS






	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	7	5	5
Sodium	ppm	ASTM D5185m >216	4	4	5
Potassium	ppm	ASTM D5185m >20	1	2	<1

INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844 >3	0.5	0.5	0.5
Nitration	Abs/cm	*ASTM D7624 >20	11.0	11.1	11.7
Sulfation	Abs/.1mm	*ASTM D7415 >30	26.9	27.2	26.3



OIL ANALYSIS REPORT

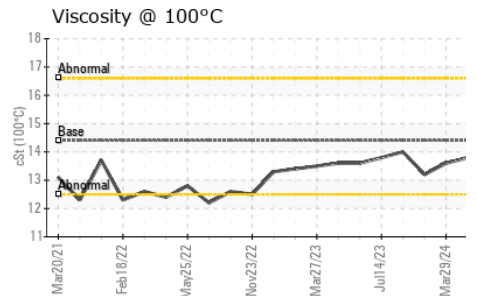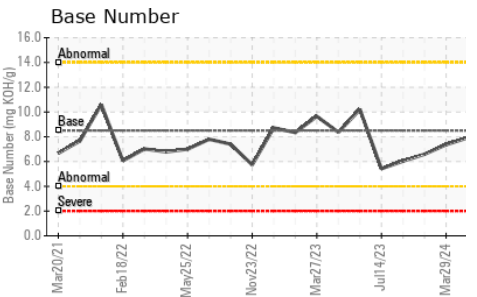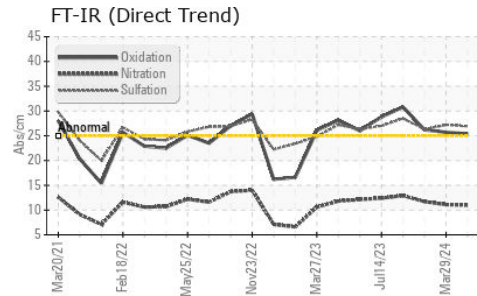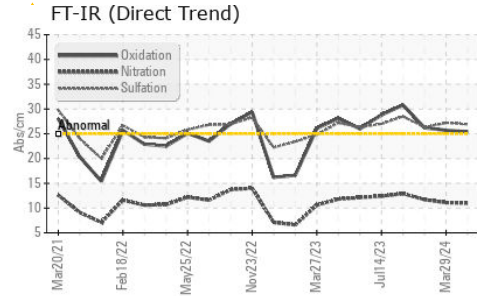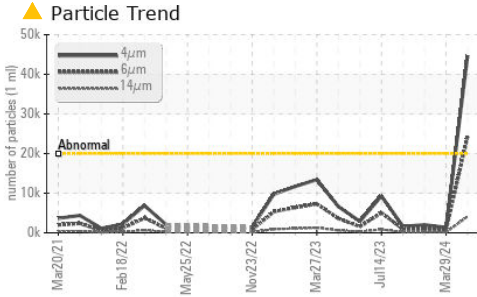






FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>20000	▲ 44707	1348	2036
Particles >6µm	ASTM D7647	>5000	▲ 24355	735	1109
Particles >14µm	ASTM D7647	>640	▲ 4145	125	189
Particles >21µm	ASTM D7647	>160	▲ 1396	42	64
Particles >38µm	ASTM D7647	>40	▲ 216	7	10
Particles >71µm	ASTM D7647	>10	▲ 22	1	1
Oil Cleanliness	ISO 4406 (c)	>21/19/16	▲ 23/22/19	18/17/14	18/17/15

FLUID DEGRADATION	method	limit/base	current	history1	history2
Oxidation	Abs./1mm *ASTM D7414	>25	25.4	25.7	26.2
Base Number (BN)	mg KOH/g ASTM D2896	8.5	7.92	7.36	6.59

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar *Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar *Visual	NONE	NONE	NONE	NONE
Precipitate	scalar *Visual	NONE	NONE	NONE	NONE
Silt	scalar *Visual	NONE	NONE	NONE	NONE
Debris	scalar *Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar *Visual	NONE	NONE	NONE	NONE
Appearance	scalar *Visual	NORML	NORML	NORML	NORML
Odor	scalar *Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar *Visual	>0.2	NEG	NEG	NEG
Free Water	scalar *Visual		NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt ASTM D445	14.4	13.8	13.6	13.2

GRAPHS

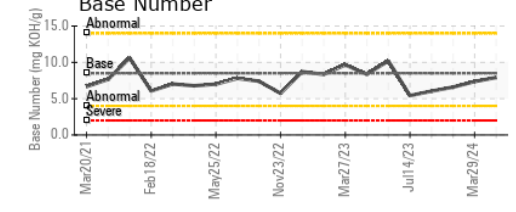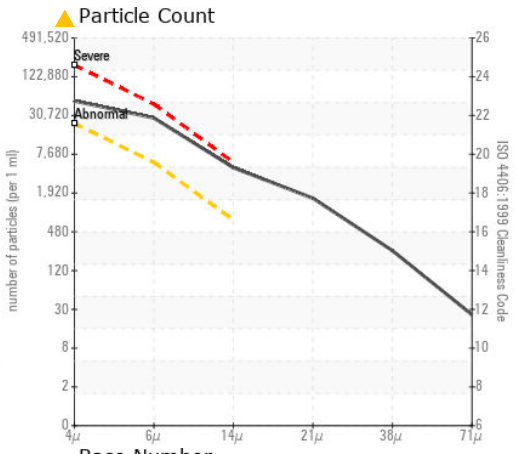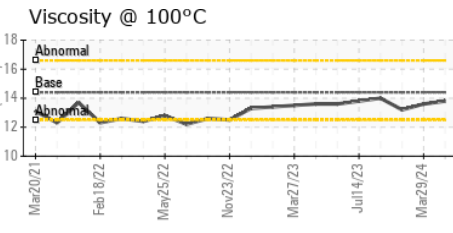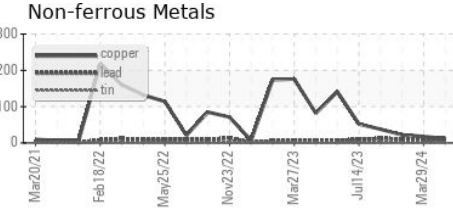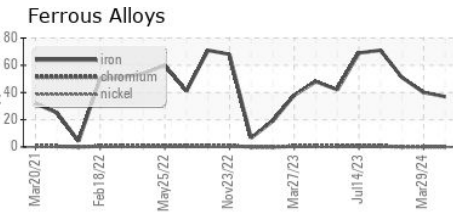

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KL0014426 **Received** : 12 Jun 2024
Lab Number : 06208009 **Tested** : 15 Jun 2024
Unique Number : 11075470 **Diagnosed** : 15 Jun 2024 - Don Baldrige
Test Package : MOB 2 (Additional Tests : PrtCount)

MCVAY DRILLING
 401 E BENDER BLVD
 HOBBS, NM
 US 88241

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)