




FUEL REPORT

Sample Rating Trend

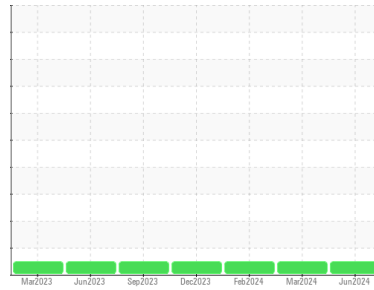

NORMAL



Machine Id

SPACE X JRTI - GEN 2

Component

Tank Diesel Fuel

Fluid

No.2 DIESEL FUEL (ULTRALOW SULPHUR) (2500 GAL)

DIAGNOSIS

Recommendation

All laboratory tests indicate that this sample meets specifications for No.2 low-sulfur diesel fuel.

Corrosion

All metal levels are normal indicating no corrosion in the system.

Contaminants

The water content is negligible. There is no bacteria or fungus (yeast and/or mold) indicated in the sample. There is no indication of any contamination in the fuel.

Fuel Condition

Sulfur value derived by ASTM D5453 method for ULSD validation.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WCDF4620	WCDF4515	WCDF4499
Sample Date	Client Info			08 Jun 2024	05 Mar 2024	15 Feb 2024
Machine Age	mls	Client Info		0	0	0
Sample Status				NORMAL	NORMAL	NORMAL


PHYSICAL PROPERTIES		method	limit/base	current	history1	history2
ASTM Color	scalar	*ASTM D1500		L5.0	L4.5	L4.5
Visc @ 40°C	cSt	ASTM D445	3.0	2.85	2.85	2.93

SULFUR CONTENT		method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m	10	217	47	219
Sulfur (UVF)	ppm	ASTM D5453		161	144	180

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	<1	<1	1
Sodium	ppm	ASTM D5185m	<0.1	<1	0	<1
Potassium	ppm	ASTM D5185m	<0.1	<1	0	<1
Water	%	ASTM D6304	<0.05	0.002	0.004	0.006
ppm Water	ppm	ASTM D6304	<500	21	43	61
% Gasoline	%	*In-House	<0.50	0.0	0.0	0.0
% Biodiesel	%	*In-House	<20.0	0.0	0.0	0.0


HEAVY METALS		method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185m	<0.1	0	0	0
Nickel	ppm	ASTM D5185m	<0.1	0	0	<1
Lead	ppm	ASTM D5185m	<0.1	0	0	0
Vanadium	ppm	ASTM D5185m	<0.1	<1	0	0
Iron	ppm	ASTM D5185m	<0.1	0	0	0
Calcium	ppm	ASTM D5185m	<0.1	0	0	0
Magnesium	ppm	ASTM D5185m	<0.1	<1	0	0
Phosphorus	ppm	ASTM D5185m	<0.1	0	0	0
Zinc	ppm	ASTM D5185m	<0.1	0	0	0

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

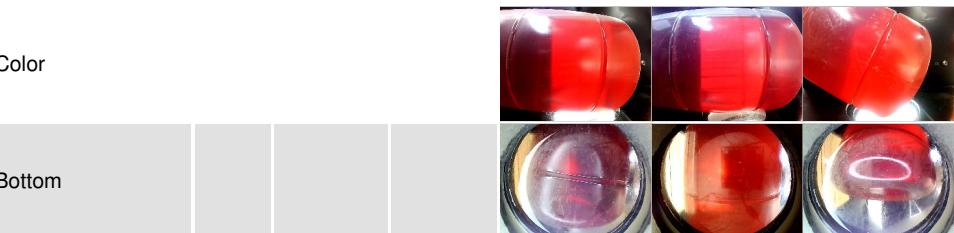




FUEL REPORT

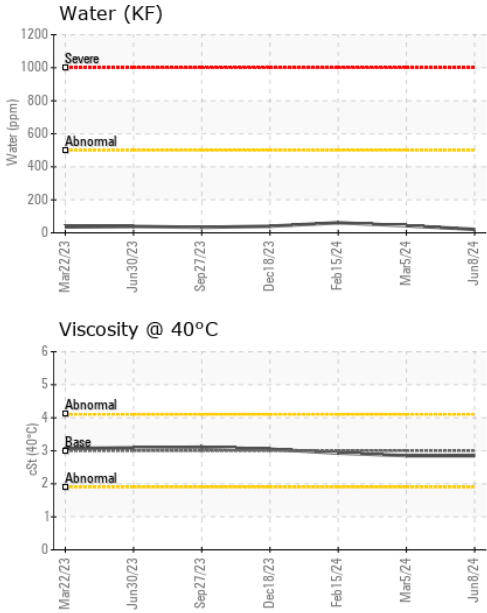

GRAPHS

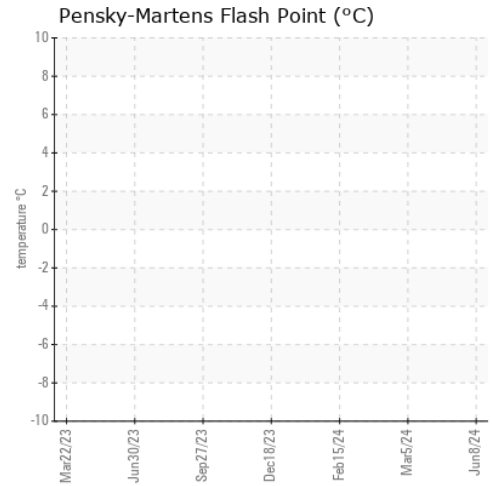

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WCDF4620 **Received** : 12 Jun 2024
Lab Number : 06208240 **Tested** : 20 Jun 2024
Unique Number : 11075701 **Diagnosed** : 20 Jun 2024 - Elizabeth Valachovic
Test Package : DF-5 (Additional Tests: PritCount, Screen)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

TANK WIZARDS
 1511 MASTERS RD NW
 PALM BAY, FL
 US 32907

Contact: WENDALL STRODERD
 wendall@tankwizards.com

T: (321)427-5149

F: (321)574-4131