




OIL ANALYSIS REPORT

Sample Rating Trend

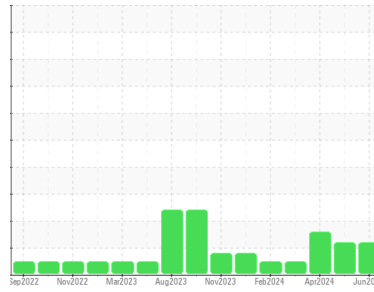

ISO



Machine Id
7363298 (S/N 1103)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- QTS)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION	method	limit/base	current	history1	history2
Sample Number	Client Info		KCPA019140	KCPA014680	KCPA016514
Sample Date	Client Info		12 Jun 2024	14 May 2024	19 Apr 2024
Machine Age	hrs	Client Info	14552	14211	13932
Oil Age	hrs	Client Info	2501	2160	1881
Oil Changed	Client Info		Not Chngd	Not Chngd	Not Chngd
Sample Status			ATTENTION	ATTENTION	ABNORMAL

WEAR METALS	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	0	0	0
Chromium	ppm	ASTM D5185m >10	0	0	<1
Nickel	ppm	ASTM D5185m >3	0	0	0
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	0	<1	0
Aluminum	ppm	ASTM D5185m >10	6	4	1
Lead	ppm	ASTM D5185m >10	0	0	0
Copper	ppm	ASTM D5185m >50	<1	2	1
Tin	ppm	ASTM D5185m >10	0	0	<1
Vanadium	ppm	ASTM D5185m	0	<1	0
Cadmium	ppm	ASTM D5185m	0	0	0






ADDITIVES	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m 90	0	<1	16
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	0	0	<1
Magnesium	ppm	ASTM D5185m 90	0	<1	19
Calcium	ppm	ASTM D5185m 2	0	0	0
Phosphorus	ppm	ASTM D5185m	223	223	243
Zinc	ppm	ASTM D5185m	2	12	10
Sulfur	ppm	ASTM D5185m	2155	2405	3717

CONTAMINANTS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	0	1	<1
Sodium	ppm	ASTM D5185m	2	2	7
Potassium	ppm	ASTM D5185m >20	0	0	<1
Water	%	ASTM D6304 >0.05	0.008	0.006	0.010
ppm Water	ppm	ASTM D6304 >500	82	66	101

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		2692	5086	71811
Particles >6µm	ASTM D7647 >1300		978	● 1701	▲ 22658
Particles >14µm	ASTM D7647 >80		● 122	● 126	▲ 449
Particles >21µm	ASTM D7647 >20		● 40	24	▲ 53
Particles >38µm	ASTM D7647 >4		3	0	2
Particles >71µm	ASTM D7647 >3		1	0	0
Oil Cleanliness	ISO 4406 (c)	>--/17/13	● 19/17/14	● 20/18/14	▲ 23/22/16

FLUID DEGRADATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.53	0.52	1.065


OIL ANALYSIS REPORT

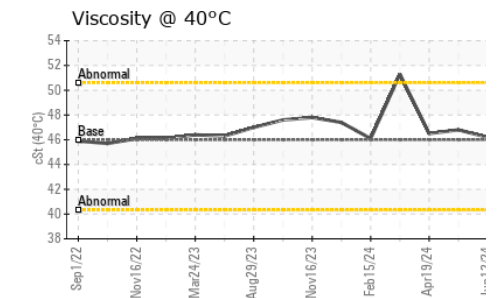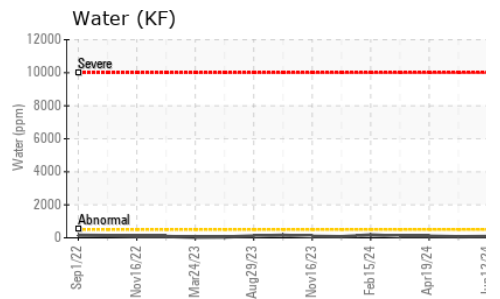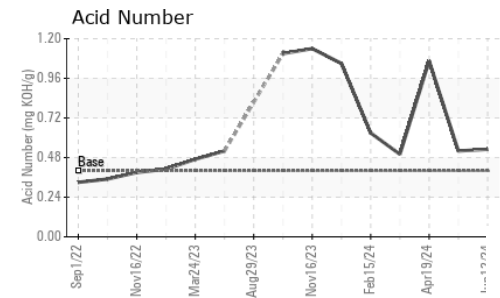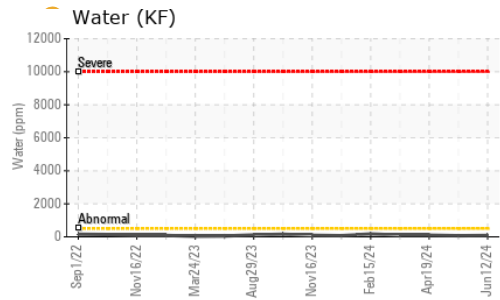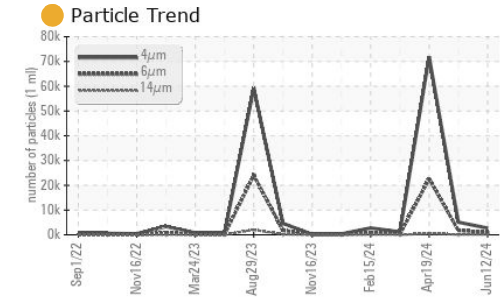





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	46.2	46.8

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

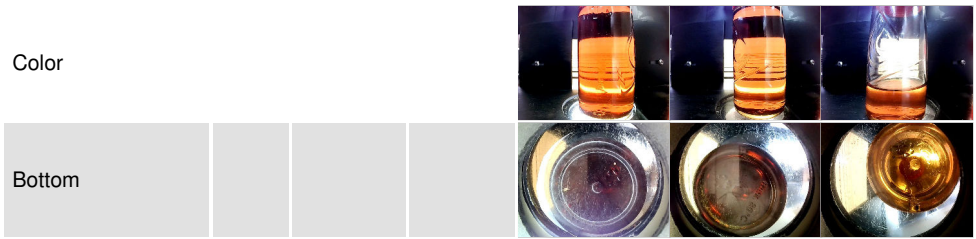

GRAPHS

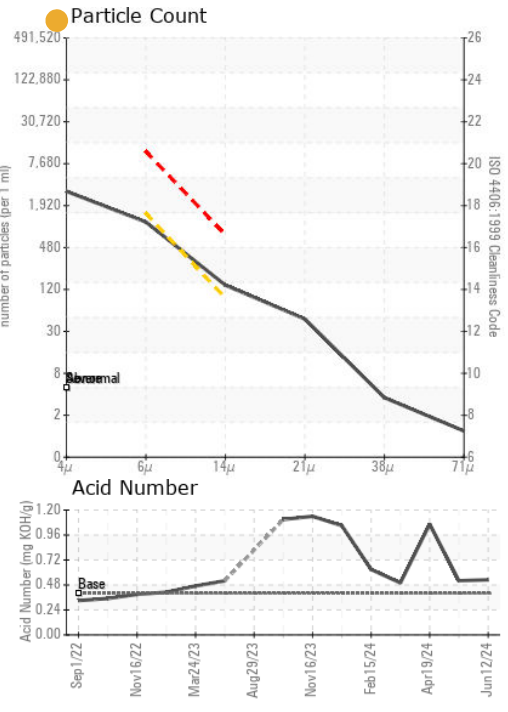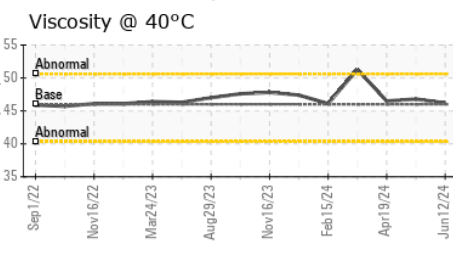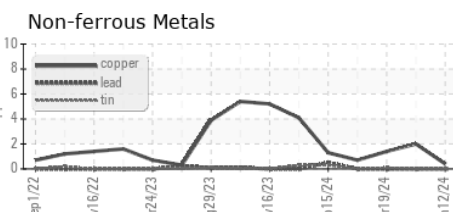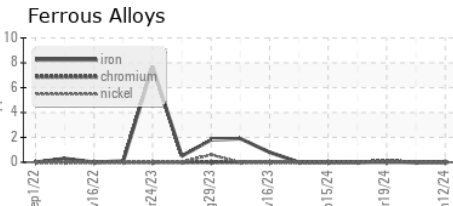

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA019140
Lab Number : 06208709
Unique Number : 11076170
Test Package : IND 2 (Additional Tests: KF, PrtCount)
Received : 13 Jun 2024
Tested : 14 Jun 2024
Diagnosed : 15 Jun 2024 - Don Baldrige

DOMINION PACKAGING
 5700 AUDUBON DR
 SANDSTON, VA
 US 23150
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)