


OIL ANALYSIS REPORT

ROTO XTEND [1560] ATLAS COPCO ITJ607969 - MD ANDERSON

Component Compressor

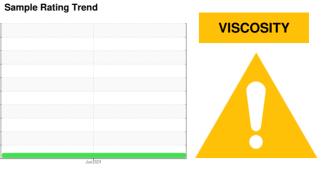

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.


Fluid Condition


The oil viscosity is higher than normal. The AN level is acceptable for this fluid.


CAMPLE INCORN	AATIONI		11 11 11		1111	1111
SAMPLE INFORM	TATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UCH06208785		
Sample Date		Client Info		12 Jun 2024		
Machine Age	hrs	Client Info		12840		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		Changed		
Sample Status				ABNORMAL		
CONTAMINATION		method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>5	0		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>15	0		
Lead	ppm	ASTM D5185m	>65	0		
Copper	ppm	ASTM D5185m	>65	<1		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		5		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m		0		
Calcium	ppm	ASTM D5185m		0		
Phosphorus	ppm	ASTM D5185m		31		
Zinc	ppm	ASTM D5185m		113		
Sulfur	ppm	ASTM D5185m		65		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>35	0		
Sodium	ppm	ASTM D5185m		3		
Potassium	ppm	ASTM D5185m	>20	0		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.14	0.20		





OIL ANALYSIS REPORT

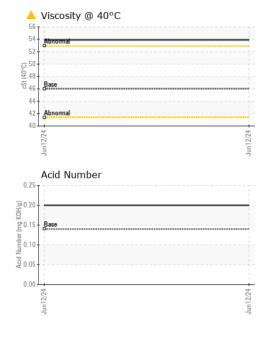

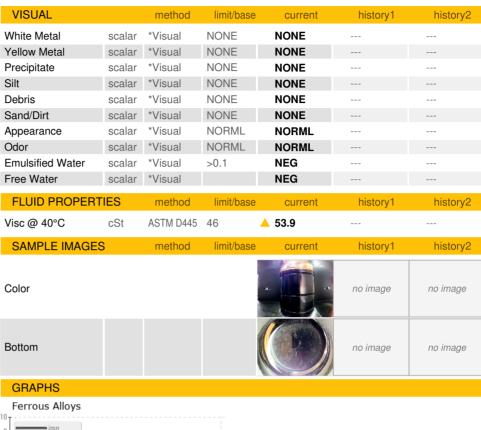











Certificate 12367

Laboratory Sample No.

Lab Number : 06208785

: UCH06208785 Unique Number : 11076246 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 13 Jun 2024

Tested : 14 Jun 2024 Diagnosed : 14 Jun 2024 - Angela Borella

2814 EAST P ST DEER PARK, TX

US 77536 Contact: Brandon Schmill Bschmill@airspecialty.com

AIR SPECIALTY & EQUIPMENT COMPANY

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: UCAIRDEE [WUSCAR] 06208785 (Generated: 06/14/2024 15:32:05) Rev: 1

Contact/Location: Brandon Schmill - UCAIRDEE

T:

F: