




# OIL ANALYSIS REPORT

Sample Rating Trend

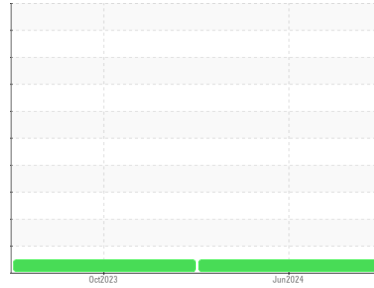

**NORMAL**



Area

**ROTO XTEND [1695]**

Machine Id

**ATLAS COPCO API325653 - REACTIVE DOWNHOLE**

Component

**Compressor**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>UCH06208795</b>	UCH05986657	---
Sample Date	Client Info		<b>12 Jun 2024</b>	04 Oct 2023	---
Machine Age	hrs	Client Info	<b>30823</b>	0	---
Oil Age	hrs	Client Info	<b>0</b>	5000	---
Oil Changed	Client Info		<b>Not Changed</b>	Changed	---
Sample Status			<b>NORMAL</b>	NORMAL	---

## CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	<b>NEG</b>	NEG	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	0	---
Chromium	ppm	ASTM D5185m >5	<b>0</b>	0	---
Nickel	ppm	ASTM D5185m	<b>0</b>	0	---
Titanium	ppm	ASTM D5185m	<b>0</b>	0	---
Silver	ppm	ASTM D5185m	<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m >15	<b>0</b>	0	---
Lead	ppm	ASTM D5185m >65	<b>0</b>	0	---
Copper	ppm	ASTM D5185m >65	<b>0</b>	0	---
Tin	ppm	ASTM D5185m >10	<b>0</b>	0	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 1.5	<b>0</b>	0	---
Barium	ppm	ASTM D5185m 0	<b>0</b>	0	---
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	0	---
Manganese	ppm	ASTM D5185m 0.3	<b>0</b>	0	---
Magnesium	ppm	ASTM D5185m 0	<b>0</b>	0	---
Calcium	ppm	ASTM D5185m 0	<b>0</b>	0	---
Phosphorus	ppm	ASTM D5185m 406	<b>156</b>	135	---
Zinc	ppm	ASTM D5185m 0	<b>25</b>	12	---
Sulfur	ppm	ASTM D5185m 1283	<b>1037</b>	847	---

## CONTAMINANTS



	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >35	<b>0</b>	<1	---
Sodium	ppm	ASTM D5185m	<b>&lt;1</b>	0	---
Potassium	ppm	ASTM D5185m >20	<b>0</b>	<1	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.463	<b>0.14</b>	0.159	---




# OIL ANALYSIS REPORT

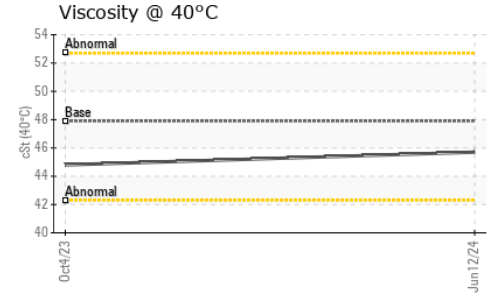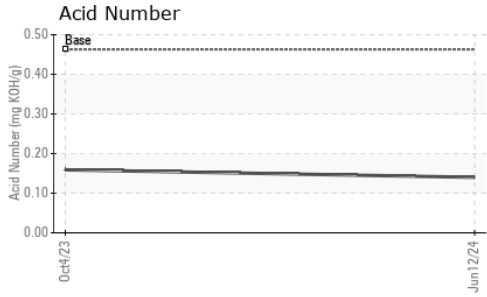





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	47.9	45.7	44.8

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

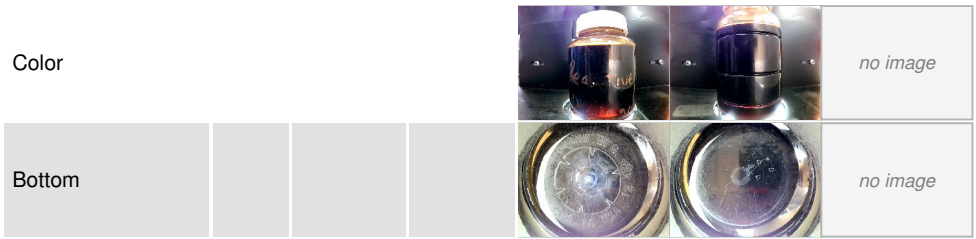

## GRAPHS

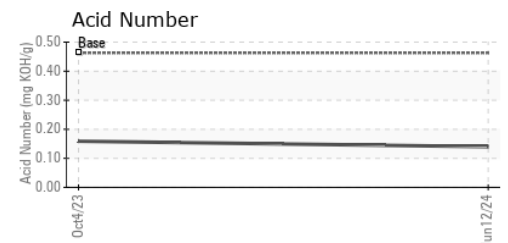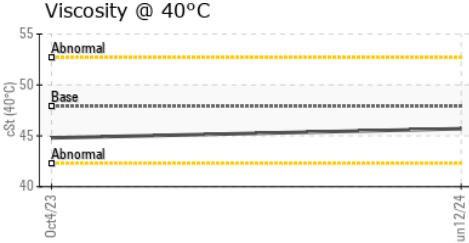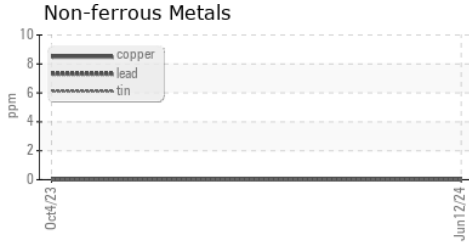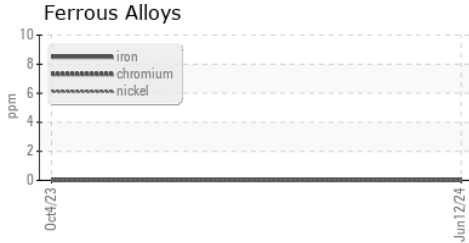

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCH06208795      **Received** : 13 Jun 2024  
**Lab Number** : **06208795**      **Tested** : 14 Jun 2024  
**Unique Number** : 11076256      **Diagnosed** : 14 Jun 2024 - Wes Davis  
**Test Package** : IND 2

**AIR SPECIALTY & EQUIPMENT COMPANY**  
 2814 EAST P ST  
 DEER PARK, TX  
 US 77536  
 Contact: Brandon Schmill  
 Bschmill@airspecialty.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)