




# OIL ANALYSIS REPORT

## Sample Rating Trend

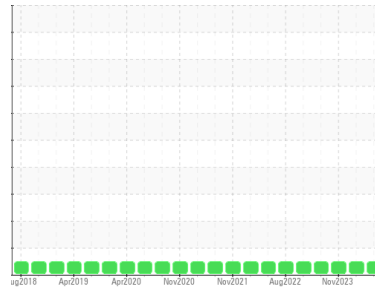

**NORMAL**



Area  
**SULLAIR PRISTINE FG**  
 Machine Id  
**003-106452 - BERRY PLASTICS**  
 Component  
**Compressor**

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

### SAMPLE INFORMATION

|               | method      | limit/base  | current            | history1    | history2    |
|---------------|-------------|-------------|--------------------|-------------|-------------|
| Sample Number | Client Info |             | <b>UCH06208818</b> | UCH06097822 | UCH06011551 |
| Sample Date   | Client Info |             | <b>06 Jun 2024</b> | 15 Feb 2024 | 15 Nov 2023 |
| Machine Age   | hrs         | Client Info | <b>93225</b>       | 90559       | 88568       |
| Oil Age       | hrs         | Client Info | <b>8200</b>        | 5547        | 3000        |
| Oil Changed   | Client Info |             | <b>Not Changed</b> | Not Changd  | Not Changed |
| Sample Status |             |             | <b>NORMAL</b>      | NORMAL      | NORMAL      |

### CONTAMINATION

|       | method    | limit/base | current    | history1 | history2 |
|-------|-----------|------------|------------|----------|----------|
| Water | WC Method | >0.1       | <b>NEG</b> | NEG      | NEG      |

### WEAR METALS

|          | method | limit/base      | current      | history1 | history2 |
|----------|--------|-----------------|--------------|----------|----------|
| Iron     | ppm    | ASTM D5185m >50 | <b>0</b>     | 0        | <1       |
| Chromium | ppm    | ASTM D5185m >10 | <b>0</b>     | <1       | <1       |
| Nickel   | ppm    | ASTM D5185m     | <b>0</b>     | <1       | <1       |
| Titanium | ppm    | ASTM D5185m     | <b>0</b>     | <1       | <1       |
| Silver   | ppm    | ASTM D5185m     | <b>0</b>     | <1       | 0        |
| Aluminum | ppm    | ASTM D5185m >25 | <b>0</b>     | <1       | <1       |
| Lead     | ppm    | ASTM D5185m >25 | <b>0</b>     | <1       | 0        |
| Copper   | ppm    | ASTM D5185m >50 | <b>&lt;1</b> | 1        | 3        |
| Tin      | ppm    | ASTM D5185m >15 | <b>&lt;1</b> | <1       | 0        |
| Vanadium | ppm    | ASTM D5185m     | <b>0</b>     | <1       | <1       |
| Cadmium  | ppm    | ASTM D5185m     | <b>0</b>     | <1       | 0        |

### ADDITIVES

|            | method | limit/base    | current      | history1 | history2 |
|------------|--------|---------------|--------------|----------|----------|
| Boron      | ppm    | ASTM D5185m 0 | <b>0</b>     | 0        | 0        |
| Barium     | ppm    | ASTM D5185m 0 | <b>0</b>     | 8        | 0        |
| Molybdenum | ppm    | ASTM D5185m 0 | <b>0</b>     | <1       | 0        |
| Manganese  | ppm    | ASTM D5185m   | <b>&lt;1</b> | <1       | <1       |
| Magnesium  | ppm    | ASTM D5185m 0 | <b>0</b>     | 0        | 0        |
| Calcium    | ppm    | ASTM D5185m 0 | <b>0</b>     | 0        | 0        |
| Phosphorus | ppm    | ASTM D5185m 0 | <b>0</b>     | 0        | 0        |
| Zinc       | ppm    | ASTM D5185m 2 | <b>0</b>     | 2        | 0        |
| Sulfur     | ppm    | ASTM D5185m   | <b>69</b>    | 10       | 0        |

### CONTAMINANTS



|           | method | limit/base      | current      | history1 | history2 |
|-----------|--------|-----------------|--------------|----------|----------|
| Silicon   | ppm    | ASTM D5185m >25 | <b>&lt;1</b> | 1        | 2        |
| Sodium    | ppm    | ASTM D5185m     | <b>&lt;1</b> | 0        | <1       |
| Potassium | ppm    | ASTM D5185m >20 | <b>0</b>     | <1       | <1       |

### FLUID DEGRADATION

|                  | method   | limit/base      | current     | history1 | history2 |
|------------------|----------|-----------------|-------------|----------|----------|
| Acid Number (AN) | mg KOH/g | ASTM D8045 0.06 | <b>0.37</b> | 0.27     | 0.25     |




# OIL ANALYSIS REPORT

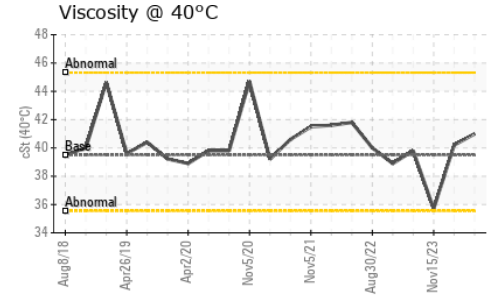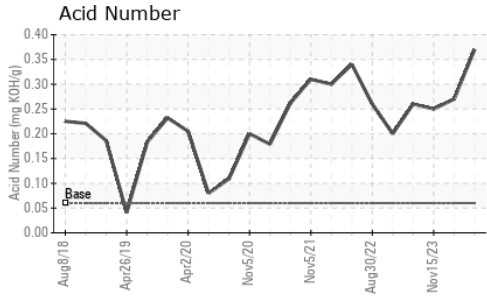





| VISUAL           | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal      | scalar | *Visual    | NONE    | NONE     | NONE     |
| Yellow Metal     | scalar | *Visual    | NONE    | NONE     | NONE     |
| Precipitate      | scalar | *Visual    | NONE    | NONE     | NONE     |
| Silt             | scalar | *Visual    | NONE    | LIGHT    | NONE     |
| Debris           | scalar | *Visual    | NONE    | NONE     | NONE     |
| Sand/Dirt        | scalar | *Visual    | NONE    | NONE     | NONE     |
| Appearance       | scalar | *Visual    | NORML   | NORML    | NORML    |
| Odor             | scalar | *Visual    | NORML   | NORML    | NORML    |
| Emulsified Water | scalar | *Visual    | >0.1    | NEG      | NEG      |
| Free Water       | scalar | *Visual    |         | NEG      | NEG      |

| FLUID PROPERTIES | method | limit/base | current | history1    | history2 |      |
|------------------|--------|------------|---------|-------------|----------|------|
| Visc @ 40°C      | cSt    | ASTM D445  | 39.5    | <b>41.0</b> | 40.2     | 35.7 |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
|---------------|--------|------------|---------|----------|----------|

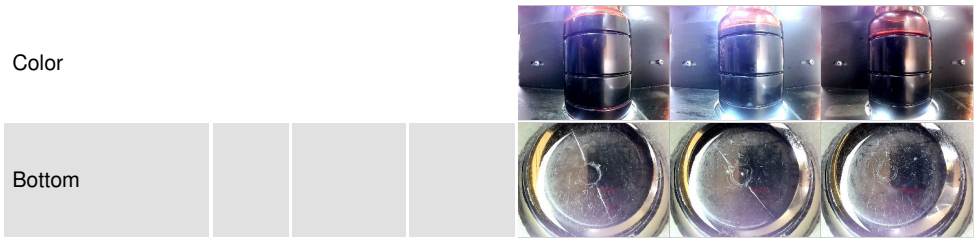

## GRAPHS

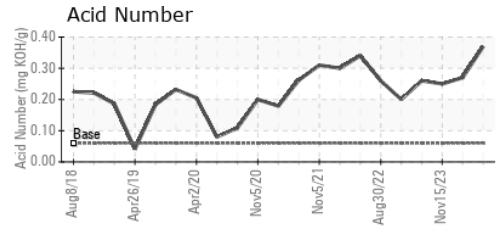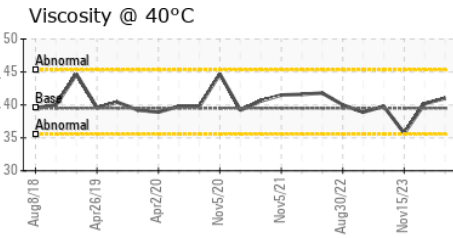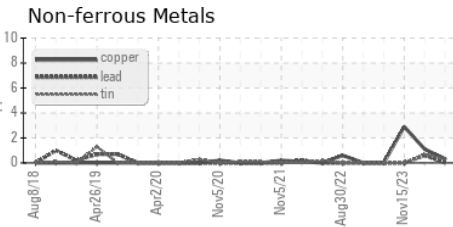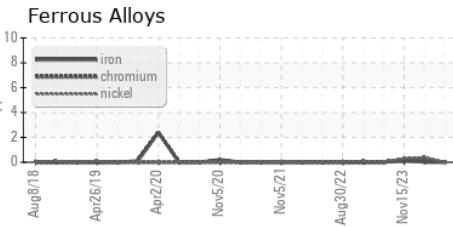

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCH06208818      **Received** : 13 Jun 2024  
**Lab Number** : **06208818**      **Tested** : 14 Jun 2024  
**Unique Number** : 11076279      **Diagnosed** : 14 Jun 2024 - Wes Davis  
**Test Package** : IND 2

**TATE ENGINEERING**  
 3921 Vero Road  
 BALTIMORE, MD  
 US 21227  
 Contact: JOSH PLITT  
 josh.plitt@tate.com  
 T: (443)992-4413  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)