


# **OIL ANALYSIS REPORT**

Area
SULLUBE **SULLAIR 200603270001 - ALL GRANITE** 

Component Compressor

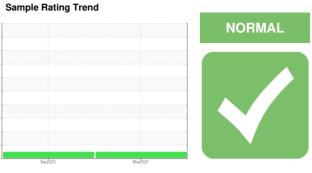

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the


## **Fluid Condition**


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UCH06208860	UCH05962959	
Sample Date		Client Info		14 Mar 2024	18 Sep 2023	
Machine Age	hrs	Client Info		51442	49817	
Oil Age	hrs	Client Info		3690	1232	
Oil Changed		Client Info		N/A	N/A	
Sample Status				NORMAL	NORMAL	
CONTAMINATIO	V	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG	NEG	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m		0	0	
Titanium	ppm	ASTM D5185m		0	0	
Silver	ppm	ASTM D5185m		0	0	
Aluminum	ppm	ASTM D5185m	>25	<1	<1	
Lead	ppm	ASTM D5185m	>25	0	0	
Copper	ppm	ASTM D5185m	>50	<1	<1	
Tin	ppm	ASTM D5185m	>15	<1	<1	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m	500	583	588	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		0	0	
Magnesium	ppm	ASTM D5185m		0	0	
Calcium	ppm	ASTM D5185m		0	2	
Phosphorus	ppm	ASTM D5185m		0	6	
Zinc	ppm	ASTM D5185m		0	0	
Sulfur	ppm	ASTM D5185m	150	261	324	
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	2	1	
Sodium	ppm	ASTM D5185m		28	29	
Potassium	ppm	ASTM D5185m	>20	<1	3	
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.5	0.155	0.089	



# **OIL ANALYSIS REPORT**

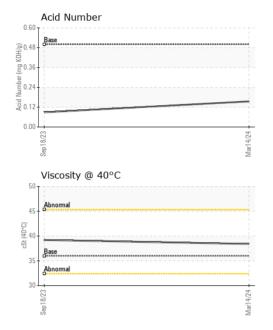

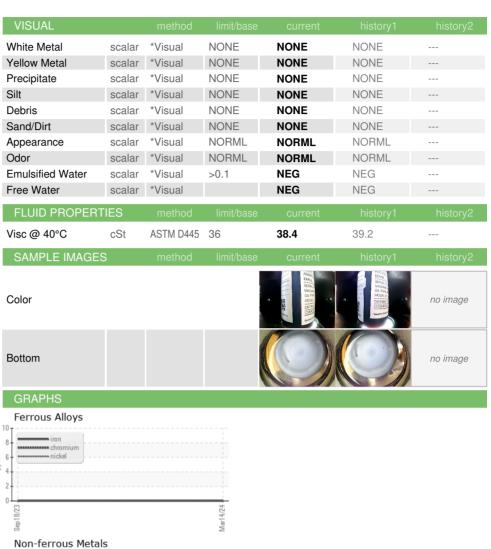





Certificate 12367

Laboratory Sample No.

Lab Number : 06208860 Unique Number : 11076321

Test Package : IND 2

(40°C)

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : UCH06208860

Viscosity @ 40°C

Received : 13 Jun 2024 **Tested** : 14 Jun 2024 Diagnosed : 14 Jun 2024 - Wes Davis

Acid Number

0.60 W 0.48

E 0.36 은 0.24 0.12

0.00

Sep1

Mar14/24 -

**LEWIS SYSTEMS & SERVICE CO INC** 9300 STOCKPORT PL CHARLOTTE, NC US 28273

Contact: JOE KERLEY jkerley@lewissystemsinc.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

Abnorma

Sep18/23

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: UCLEWCHA [WUSCAR] 06208860 (Generated: 06/14/2024 15:37:29) Rev: 1

Contact/Location: JOE KERLEY - UCLEWCHA

T: (704)588-2299