


OIL ANALYSIS REPORT

Area LSS-9300 **SULLAIR 003-5198 - CHARLOTTE OBSERVER** Component Compressor





DIAGNOSIS

Recommendation

Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UCH06208861		
Sample Date		Client Info		12 Mar 2024		
Machine Age	hrs	Client Info		78141		
Oil Age	hrs	Client Info		4000		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
CONTAMINATION	V	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		2		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>25	0		
Lead	ppm	ASTM D5185m	>25	0		
Copper	ppm	ASTM D5185m	>50	0		
Tin	ppm	ASTM D5185m	>15	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m		0		
Calcium	ppm	ASTM D5185m		0		
Phosphorus	ppm	ASTM D5185m		198		
Zinc	ppm	ASTM D5185m		2		
Sulfur	ppm	ASTM D5185m		1212		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	4		
Sodium	ppm	ASTM D5185m		2		
Potassium	ppm	ASTM D5185m	>20	0		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.30		




OIL ANALYSIS REPORT

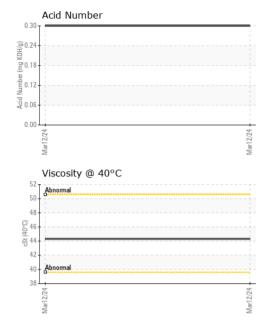



VISUAL		method				history2
White Metal	scalar	*Visual	NONE	NONE		
Yellow Metal	scalar	*Visual	NONE	NONE		
Precipitate	scalar	*Visual	NONE	NONE		
Silt	scalar	*Visual	NONE	NONE		
Debris	scalar	*Visual	NONE	NONE		
Sand/Dirt	scalar	*Visual	NONE	NONE		
Appearance	scalar	*Visual	NORML	NORML		
Odor	scalar	*Visual	NORML	NORML		
Emulsified Water	scalar	*Visual	>0.1	NEG		
Free Water	scalar	*Visual		NEG		
FLUID PROPERT	TES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445		44.3		
SAMPLE IMAGES		method	limit/base	current	history1	history2

SAMPLE IMAGES	method		HISTORY	riistoryz
Color		ADDRESS EMAL SEPPAL NO C MACHINE UP OL TYPE L MODEL NO L DISTRESS GRANDO	no image	no image
Bottom			no image	no image
GRAPHS				













Certificate 12367

Laboratory Sample No.

Lab Number : 06208861

: UCH06208861 Unique Number : 11076322 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513

Received : 13 Jun 2024 Tested Diagnosed

: 14 Jun 2024 : 14 Jun 2024 - Wes Davis

9300 STOCKPORT PL

CHARLOTTE, NC US 28273 Contact: JOE KERLEY jkerley@lewissystemsinc.com

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

T: (704)588-2299

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) Report Id: UCLEWCHA [WUSCAR] 06208861 (Generated: 06/14/2024 15:35:35) Rev: 1

Contact/Location: JOE KERLEY - UCLEWCHA

LEWIS SYSTEMS & SERVICE CO INC