




OIL ANALYSIS REPORT



Machine Id
IRGM01BE (S/N CTL0580)
 Component
Biogas Engine
 Fluid
CHEVRON HDAX 9500 GAS ENGINE OIL 40 (108 GAL)

Sample Rating Trend

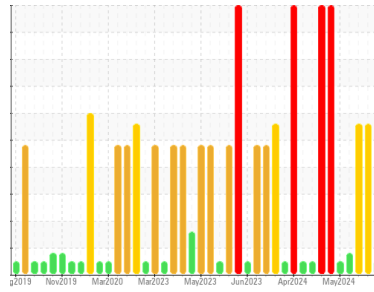

NORMAL



DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0789117	WC0789121	WC0789116
Sample Date	Client Info			11 Jun 2024	04 Jun 2024	28 May 2024
Machine Age	hrs	Client Info		17043	16854	16713
Oil Age	hrs	Client Info		189	512	125
Oil Changed	Client Info			N/A	Changed	N/A
Sample Status				NORMAL	SEVERE	SEVERE

CONTAMINATION		method	limit/base	current	history1	history2
Fuel	WC Method	>4.0		<1.0	<1.0	<1.0
Water	WC Method	>.11		NEG	NEG	NEG
Glycol	WC Method			NEG	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>15	3	8	10
Chromium	ppm	ASTM D5185m	>4	0	<1	<1
Nickel	ppm	ASTM D5185m		0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>6	2	3	3
Lead	ppm	ASTM D5185m	>9	<1	7	6
Copper	ppm	ASTM D5185m	>6	<1	3	3
Tin	ppm	ASTM D5185m	>4	2	▲ 4	▲ 5
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		10	17	22
Barium	ppm	ASTM D5185m		0	2	0
Molybdenum	ppm	ASTM D5185m		6	11	11
Manganese	ppm	ASTM D5185m		<1	<1	<1
Magnesium	ppm	ASTM D5185m		20	46	48
Calcium	ppm	ASTM D5185m		1677	1956	1883
Phosphorus	ppm	ASTM D5185m		291	336	373
Zinc	ppm	ASTM D5185m		354	455	452
Sulfur	ppm	ASTM D5185m		2971	3431	3458

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>181	121	▲ 218	▲ 216
Sodium	ppm	ASTM D5185m	>21	<1	<1	<1
Potassium	ppm	ASTM D5185m	>20	0	0	0


INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844		0.1	0.1	0.1
Nitration	Abs/cm	*ASTM D7624		5.3	6.2	6.0
Sulfation	Abs/.1mm	*ASTM D7415		18.3	22.1	21.3

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414		10.6	14.3	13.2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	1.03	1.90	2.28
Base Number (BN)	mg KOH/g	ASTM D2896	5.4	3.48	3.49	3.72




OIL ANALYSIS REPORT


FT-IR (Direct Trend)

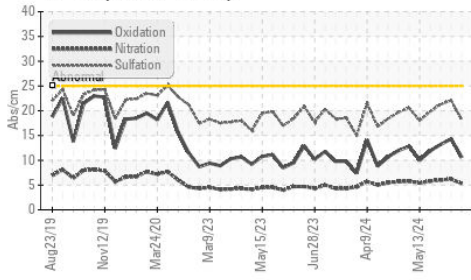


Acid Number

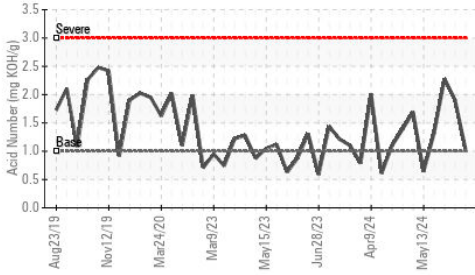

Base Number

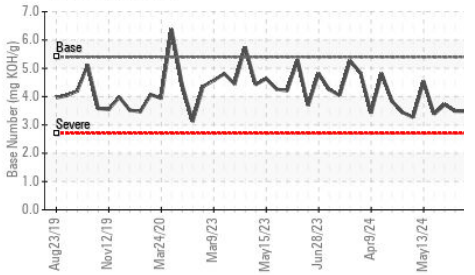









Viscosity @ 100°C

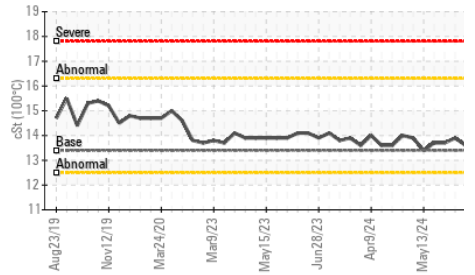

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>.11	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.4	13.6	13.9

GRAPHS

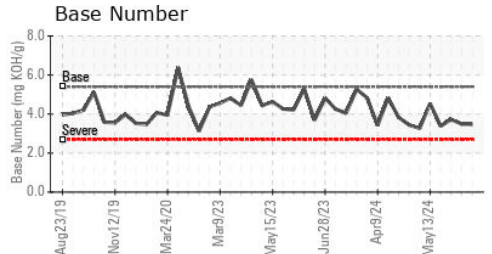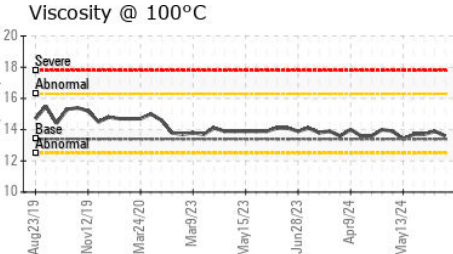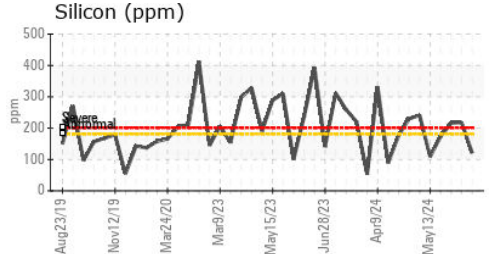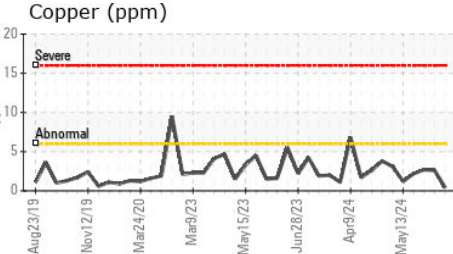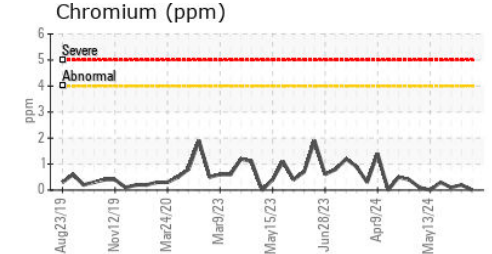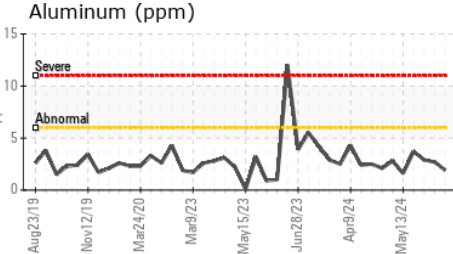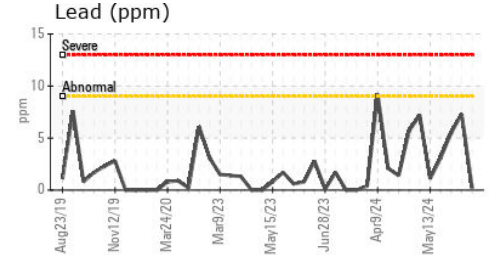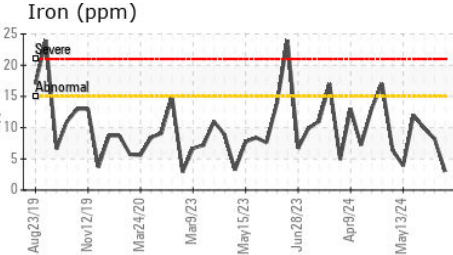

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : WC0789117
 Lab Number : 06208887
 Unique Number : 11076348
 Test Package : MOB 2

Received : 13 Jun 2024
 Tested : 14 Jun 2024
 Diagnosed : 14 Jun 2024 - Angela Borella

EDL NA Recips-Iris Glen
 IRIS GLEN POWER STATION, 1705 E MAIN ST
 JOHNSON CITY, TN
 US 37601
 Contact: CHRIS SMITH
 csmith@stowerscat.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)