




FUEL REPORT

Sample Rating Trend

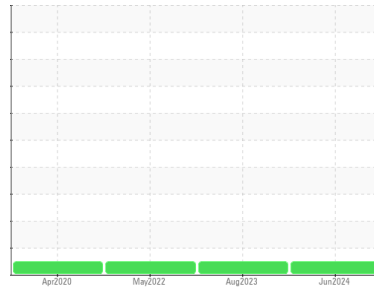

NORMAL



Area

[PMOAS3263459]

Machine Id

13994550100 - 1 (S/N 2114726)

Component

Diesel Fuel

Fluid

No.2 DIESEL FUEL (ULTRALOW SULPHUR) (--- QTS)

DIAGNOSIS

Recommendation

All laboratory tests indicate that this sample meets specifications for No.2 ultra-low-sulfur diesel fuel.

Corrosion

All metal levels are normal indicating no corrosion in the system.

Contaminants

The water content is negligible. There is no Bacteria, Yeast and/or Fungus indicated in the sample. There is no indication of any contamination in the fuel. The amount and size of particulates present in the system are acceptable.

Fuel Condition

Sulfur value derived by ASTM D4294 method for ULSD validation. Sulfur level is acceptable for ULSD specification.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			DC0036952	DC0030193	DC0014855
Sample Date	Client Info			06 Jun 2024	23 Aug 2023	03 May 2022
Machine Age	hrs	Client Info		790	754	645
Sample Status				NORMAL	NORMAL	NORMAL

PHYSICAL PROPERTIES		method	limit/base	current	history1	history2
ASTM Color	scalar	*ASTM D1500		L4.0	L4.5	L5.5
Visc @ 40°C	cSt	ASTM D445	3.0	2.46	2.46	2.46

SULFUR CONTENT		method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m	10	0	87	3
Sulfur (UVF)	ppm	ASTM D5453		8	8	10

IGNITION QUALITY		method	limit/base	current	history1	history2
API Gravity		ASTM D7777	37.7	37.3	37.3	37.1





CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	<1	0	<1
Sodium	ppm	ASTM D5185m	<0.1	2	<1	0
Potassium	ppm	ASTM D5185m	<0.1	2	0	0
Water	%	ASTM D6304	<0.05	0.003	0.003	0.002
ppm Water	ppm	ASTM D6304	<500	31	27.6	16.8
% Gasoline	%	*In-House	<0.50	0.0	0.0	0.0
% Biodiesel	%	*In-House	<20.0	0.0	0.0	0.0

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>2500	468	---	5711
Particles >6µm		ASTM D7647	>640	169	---	2012
Particles >14µm		ASTM D7647	>80	17	---	303
Particles >21µm		ASTM D7647	>20	4	---	115
Particles >38µm		ASTM D7647	>4	0	---	8
Particles >71µm		ASTM D7647	>3	0	---	0
Oil Cleanliness		ISO 4406 (c)	>18/16/13	16/15/11	---	20/18/15

HEAVY METALS		method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185m	<0.1	0	0	0
Nickel	ppm	ASTM D5185m	<0.1	<1	0	<1
Lead	ppm	ASTM D5185m	<0.1	0	0	0
Vanadium	ppm	ASTM D5185m	<0.1	0	0	0
Iron	ppm	ASTM D5185m	<0.1	0	0	0
Calcium	ppm	ASTM D5185m	<0.1	0	0	<1
Magnesium	ppm	ASTM D5185m	<0.1	0	0	0
Phosphorus	ppm	ASTM D5185m	<0.1	0	4	<1
Zinc	ppm	ASTM D5185m	<0.1	<1	0	0




FUEL REPORT

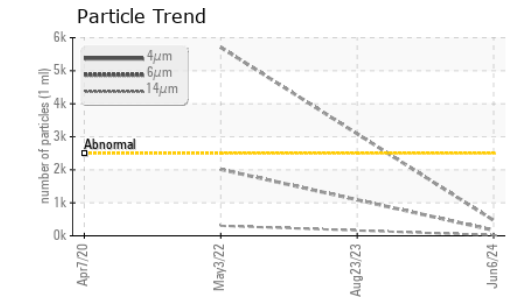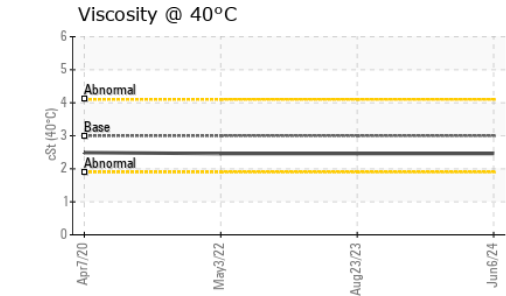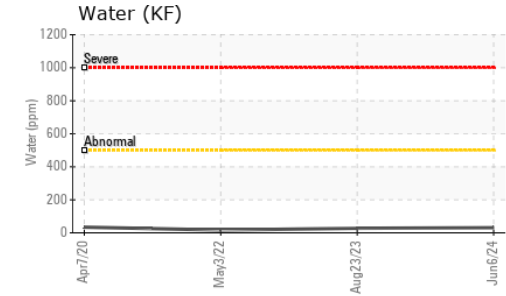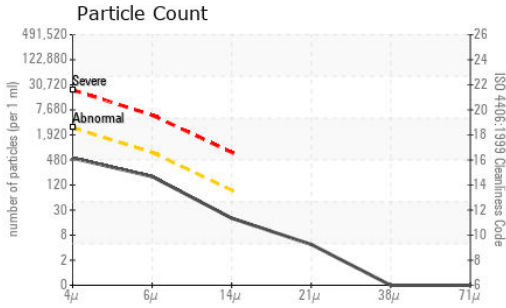

SAMPLE IMAGES		method	limit/base	current	history1	history2
Color						
Bottom						

GRAPHS

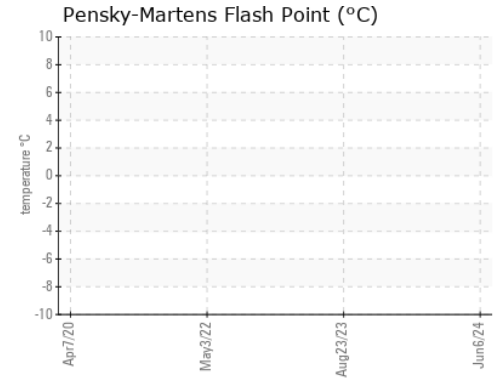

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : DC0036952
Lab Number : 06209102
Unique Number : 11076563
Test Package : DF-5 (Additional Tests: API, Cetane, Fuel, PrtCount, Screen)

KELLY GENERATOR & EQUIPMENT INC
 1955 DALE LN
 OWINGS, MD
 US 20736

Contact: LESLIE SNURR
 LSNURR@KGE.COM

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (410)257-5225

F: (410)257-5227