

OIL ANALYSIS REPORT

Sample Rating Trend

ISO

KAESER 6149166 (S/N NOT GIVEN)

Component Compressor

Fluid KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

A Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA017256	KCPA007225	
Sample Date		Client Info		07 Jun 2024	13 Oct 2023	
Machine Age	hrs	Client Info		23499	22252	
Oil Age	hrs	Client Info		1500	0	
Oil Changed		Client Info		Changed	N/A	
Sample Status				ABNORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	0	
Chromium	ppm	ASTM D5185m	>10	<1	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	<1	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	2	0	
Lead	ppm	ASTM D5185m	>10	<1	0	
Copper	ppm	ASTM D5185m	>50	7	18	
Tin	ppm	ASTM D5185m	>10	<1	0	
Vanadium	ppm	ASTM D5185m	-	0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	
Barium	ppm	ASTM D5185m	90	<1	0	
Molybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m		0	0	
Magnesium	ppm	ASTM D5185m	100	27	0	
Calcium	ppm	ASTM D5185m	0	0	0	
Phosphorus	ppm	ASTM D5185m	0	0	0	
Zinc	ppm	ASTM D5185m	0	8	0	
Sulfur	ppm	ASTM D5185m	23500	18617	19229	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	
Sodium	ppm	ASTM D5185m		3	<1	
Potassium	ppm	ASTM D5185m	>20	1	0	
Water	%	ASTM D6304	>0.05	0.012	0.007	
ppm Water	ppm	ASTM D6304	>500	129	75.1	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		10583	137763	
Particles >6µm		ASTM D7647	>1300	<u> </u>	▲ 39326	
Particles >14µm		ASTM D7647	>80	91	▲ 883	
Particles >21µm		ASTM D7647	>20	8	1 92	
Particles >38µm		ASTM D7647	>4	1	5	
Particles >71µm		ASTM D7647	>3	0	0	
		ISO 4406 (c)	>/17/13	A 21/19/14	▲ 24/22/17	
Oil Cleanliness						
Oil Cleanliness FLUID DEGRADA	TION	method	limit/base	current	history1	history2


Contact/Location: Service Manager - CARUTINY Page 1 of 2




OIL ANALYSIS REPORT





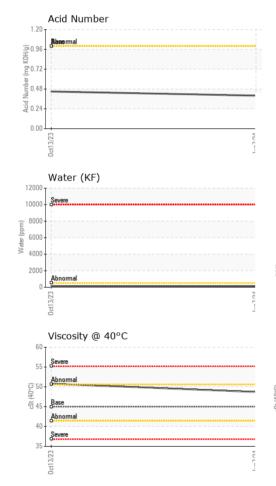

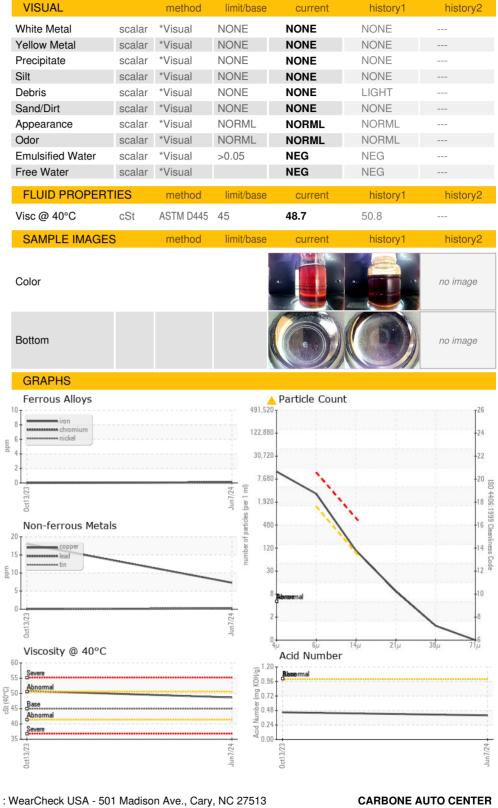



Laboratory Sample No. : KCPA017256 Received : 13 Jun 2024 5718 HORATIO ST Lab Number Tested : 16 Jun 2024 : 06209250 Unique Number : 11076711 Diagnosed : 16 Jun 2024 - Doug Bogart Contact: Service Manager Test Package : IND 2 (Additional Tests: KF, PrtCount) Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: CARUTINY [WUSCAR] 06209250 (Generated: 06/16/2024 15:03:22) Rev: 1

Contact/Location: Service Manager - CARUTINY

UTICA, NY

US 13502

T:

F: