


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



Machine Id

KAESER SM 10 5922318 (S/N 2005)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Aug 2019	Mar2020 Jun2021	MarŽ022 JanŽ023	Jun2024	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA012955	KCP52001	KCP44830
Sample Date		Client Info		03 Jun 2024	17 Jan 2023	31 Mar 2022
Machine Age	hrs	Client Info		46448	34408	55655
Oil Age	hrs	Client Info		6956	0	0
Oil Changed		Client Info		Changed	Changed	Changed
Sample Status				NORMAL	NORMAL	ATTENTION
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	<1
Chromium	ppm	ASTM D5185m	>10	<1	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	<1	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	2	0	<1
Lead	ppm	ASTM D5185m	>10	<1	0	0
Copper	ppm	ASTM D5185m	>50	6	2	2
Tin	ppm	ASTM D5185m	>10	<1	0	0
Antimony	ppm	ASTM D5185m				
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	<1
Barium	ppm	ASTM D5185m	90	0	0	51
Molybdenum	ppm	ASTM D5185m		<1	0	0
Manganese	ppm	ASTM D5185m		0	0	<1
Magnesium	ppm	ASTM D5185m	90	<1	51	61
Calcium	ppm	ASTM D5185m	2	0	0	2
Phosphorus	ppm	ASTM D5185m		2	4	10
Zinc	ppm	ASTM D5185m		0	3	0
Sulfur	ppm	ASTM D5185m		12794	15396	15847
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	0	<1
Sodium	ppm	ASTM D5185m		0	9	2
Potassium	ppm	ASTM D5185m	>20	<1	2	0
Water	%	ASTM D6304	>0.05	0.003	0.019	0.018
ppm Water	ppm	ASTM D6304	>500	35	196.2	186.8
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		500	3299	5049
Particles >6µm		ASTM D7647	>1300	117	946	1216
Particles >14μm		ASTM D7647	>80	13	73	149
Particles >21µm		ASTM D7647	>20	5	12	48
Particles >38μm		ASTM D7647	>4	0	1	4
Particles >71μm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	16/14/11	19/17/13	17/14
FLUID DEGRADA	TION	method	limit/base	current	history1	history2



OIL ANALYSIS REPORT

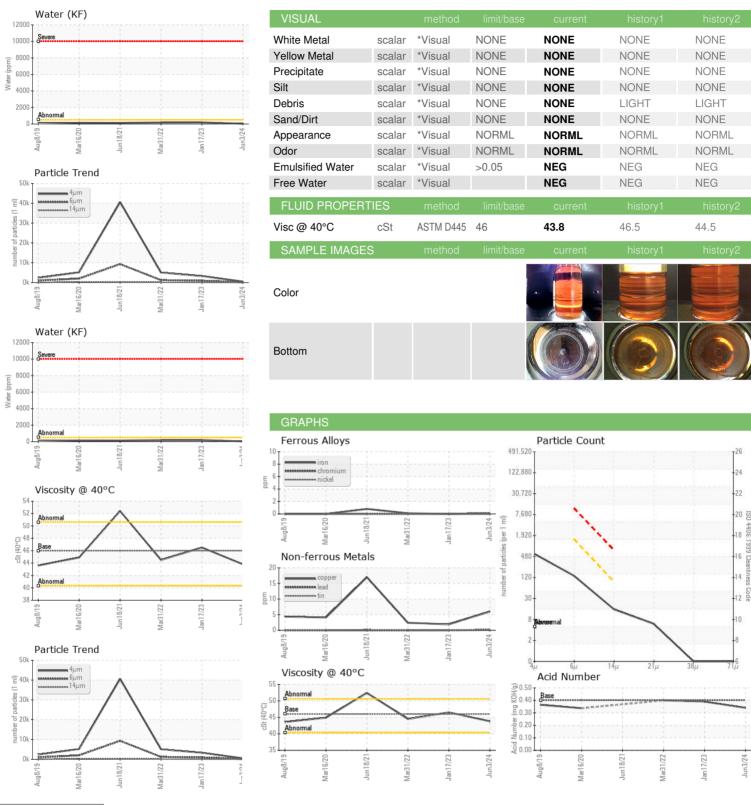





Certificate 12367

Sample No. Lab Number

Laboratory

Unique Number : 11076716

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : KCPA012955 : 06209255

Received : 13 Jun 2024 **Tested** : 16 Jun 2024 Diagnosed : 16 Jun 2024 - Doug Bogart

Test Package : IND 2 (Additional Tests: KF, PrtCount) To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

HOLY REDEEMER HOSPITAL

1648 HUNTINGDON PIKE MEADOWBROOK, PA US 19046

Contact: A. LISTMAN alistman@holyredeemer.com T:

Report Id: HOLMEA [WUSCAR] 06209255 (Generated: 06/16/2024 15:06:19) Rev: 1

F: