




OIL ANALYSIS REPORT

Sample Rating Trend

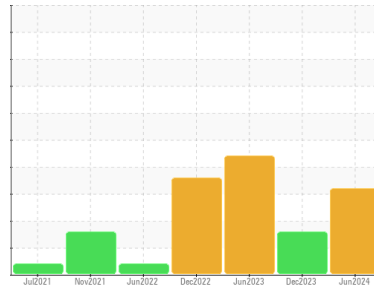

WATER



Machine Id
KAESER 1432476 (S/N 3610978)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

Wear

All component wear rates are normal.

Contamination

Excessive free water present. There is a light concentration of water present in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KCPA018104	KCPA010988	KCPA002009
Sample Date	Client Info			04 Jun 2024	22 Dec 2023	21 Jun 2023
Machine Age	hrs	Client Info		55093	54936	34735
Oil Age	hrs	Client Info		1500	0	0
Oil Changed	Client Info			Changed	N/A	N/A
Sample Status				ABNORMAL	ATTENTION	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	0	<1
Chromium	ppm	ASTM D5185m	>10	<1	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	<1
Titanium	ppm	ASTM D5185m	>3	<1	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	2	0	1
Lead	ppm	ASTM D5185m	>10	<1	0	0
Copper	ppm	ASTM D5185m	>50	1	<1	1
Tin	ppm	ASTM D5185m	>10	<1	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	0
Barium	ppm	ASTM D5185m	90	14	5	30
Molybdenum	ppm	ASTM D5185m	0	<1	0	0
Manganese	ppm	ASTM D5185m		0	0	<1
Magnesium	ppm	ASTM D5185m	100	49	52	55
Calcium	ppm	ASTM D5185m	0	0	2	5
Phosphorus	ppm	ASTM D5185m	0	3	5	7
Zinc	ppm	ASTM D5185m	0	21	48	23
Sulfur	ppm	ASTM D5185m	23500	19522	16953	23036

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	0	<1
Sodium	ppm	ASTM D5185m		0	9	2
Potassium	ppm	ASTM D5185m	>20	2	16	3
Water	%	ASTM D6304	>0.05	▲ 0.168	0.009	▲ 0.343
ppm Water	ppm	ASTM D6304	>500	▲ 1680	96	▲ 3430

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		9959	9497	---
Particles >6µm		ASTM D7647	>1300	1249	● 1651	---
Particles >14µm		ASTM D7647	>80	11	● 82	---
Particles >21µm		ASTM D7647	>20	2	● 22	---
Particles >38µm		ASTM D7647	>4	0	1	---
Particles >71µm		ASTM D7647	>3	0	0	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	20/17/11	● 20/18/14	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.37	0.36	0.43


OIL ANALYSIS REPORT

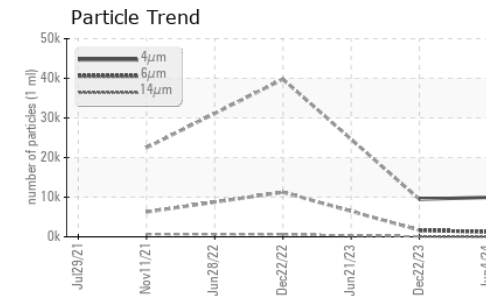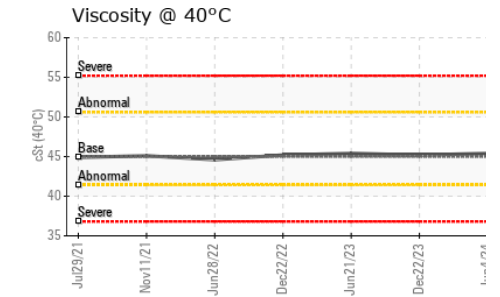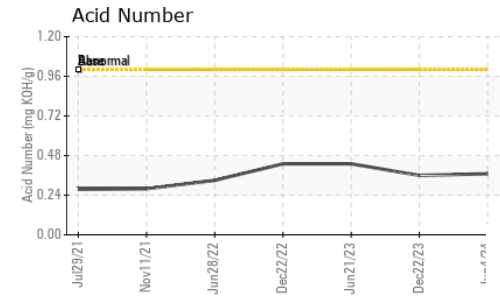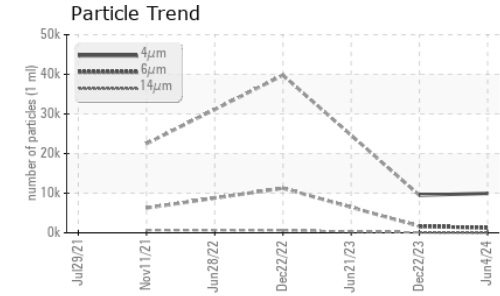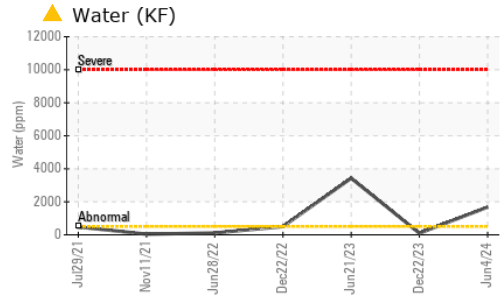






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	● HAZY
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	0.2%	▲ 0.2%
Free Water	scalar	*Visual		>10%	● 10.0

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 45	45.4	45.2	45.4

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

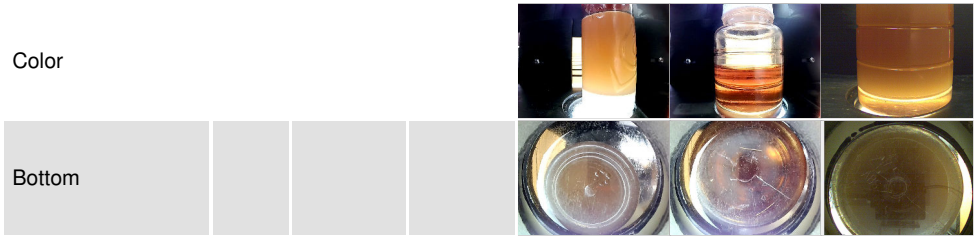

GRAPHS

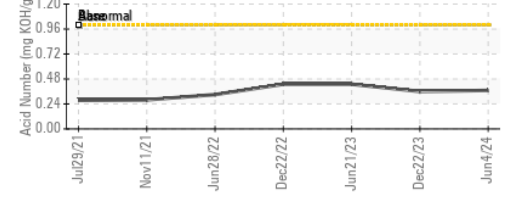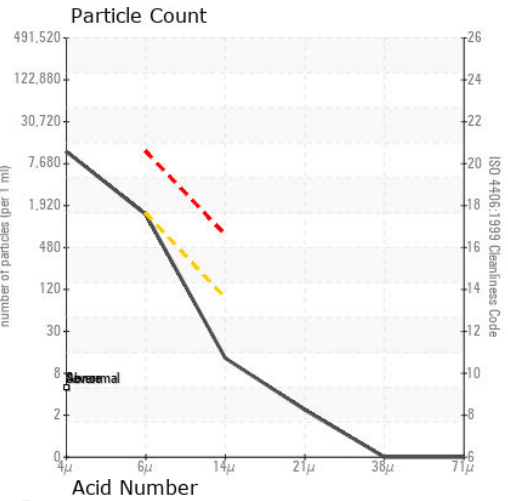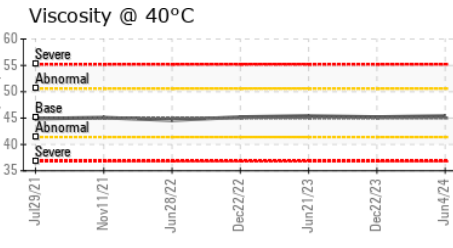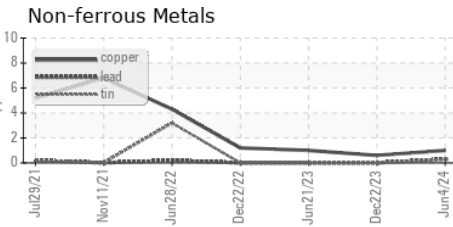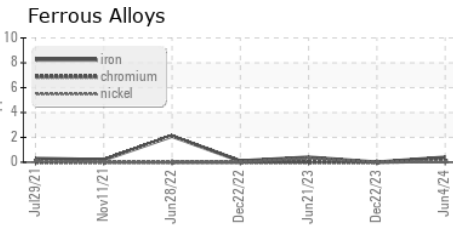

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA018104 **Received** : 13 Jun 2024
Lab Number : 06209256 **Tested** : 18 Jun 2024
Unique Number : 11076717 **Diagnosed** : 18 Jun 2024 - Angela Borella
Test Package : IND 2 (Additional Tests: KF, PrtCount)

POMPS TIRE SERVICE
 4160 REARDON RD
 DE FOREST, WI
 US 53532
 Contact: JEFFREY STIEREN
 JEFFREY.STIEREN@POMPSTIRE.COM

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)