


OIL ANALYSIS REPORT

Sample Rating Trend

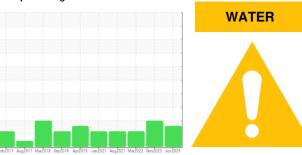

Machine Id

KAESER BSD 50 4501429 (S/N 1224)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

The filter change at the time of sampling has been noted. We recommend an early resample in 500 hours to monitor this condition. We advise that you stop the unit and follow the water drain-off procedure for this component.

All component wear rates are normal.

Contamination

There is a light concentration of water present in the oil. The amount and size of particulates present in the system are acceptable.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA017998	KCPA007684	KCP41077
Sample Date		Client Info		05 Jun 2024	29 Nov 2023	07 Mar 2022
Machine Age	hrs	Client Info		25766	24565	19830
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		Not Changd	N/A	Not Changd
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	0	0
Chromium	ppm	ASTM D5185m	>10	<1	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	<1	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	2	0	<1
Lead	ppm	ASTM D5185m	>10	<1	0	0
Copper	ppm	ASTM D5185m	>50	2	5	<1
Tin	ppm	ASTM D5185m	>10	<1	0	0
Antimony	ppm	ASTM D5185m				
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	5	0	19
Molybdenum	ppm	ASTM D5185m		<1	0	0
Manganese	ppm	ASTM D5185m		0	<1	0
Magnesium	ppm	ASTM D5185m	90	42	21	80
Calcium	ppm	ASTM D5185m	2	0	<1	<1
Phosphorus	ppm	ASTM D5185m		2	<1	12
Zinc	ppm	ASTM D5185m		7	0	<1
Sulfur	ppm	ASTM D5185m		19757	17730	16859
CONTAMINANTS	1	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	0	0
Sodium	ppm	ASTM D5185m		2	9	15
Potassium	ppm	ASTM D5185m	>20	2	0	0
Water	%	ASTM D6304	>0.05	<u> </u>	0.015	0.021
ppm Water	ppm	ASTM D6304	>500	<u> </u>	158	215.9
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		270	29163	5747
Particles >6µm		ASTM D7647	>1300	74	<u>12699</u>	<u>\$\text{2539}\$</u>
Particles >14μm		ASTM D7647	>80	5	<u>1734</u>	▲ 376
Particles >21μm		ASTM D7647	>20	1	490	△ 73
Particles >38μm		ASTM D7647	>4	0	<u>^</u> 20	4
Particles >71μm		ASTM D7647	>3	0	1	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	15/13/10	<u>22/21/18</u>	<u>19/16</u>
FLUID DEGRADA	TION	method	limit/base	current	history1	history2



OIL ANALYSIS REPORT

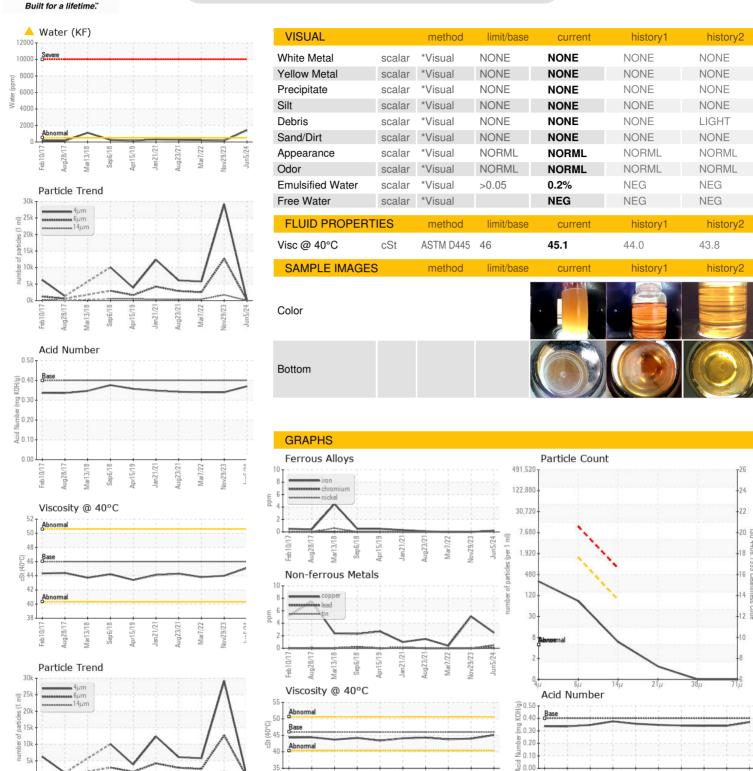





Certificate 12367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513 Sample No.

: KCPA017998 Lab Number : 06209258 Unique Number : 11076719

Received **Tested** Diagnosed

: 18 Jun 2024 - Angela Borella Test Package : IND 2 (Additional Tests: KF, PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation. **CABINETS DELUXE BY DALE INC**

171 MARKET ST GEORGETOWN, TX US 78626

Contact: REBECCA HUTTON rebecca@cabinetsdeluxe.com

T: (512)259-2531 F: (512)727-4599

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

: 13 Jun 2024

: 18 Jun 2024