


# **OIL ANALYSIS REPORT**

Sample Rating Trend



**NORMAL** 



Machine Id

# **ME-031143A EXPANDER**

Component Gearbox

USPI FG GEAR 320 (--- GAL)

Ν		

### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


		ov2019 Aug	2020 Jan 2021 Feb 2	021 Jul2021 Aug2022 A	ug2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USPM37658	USPM30241	USPM29177
Sample Date		Client Info		10 Jun 2024	21 Feb 2024	08 Aug 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	ATTENTION	ATTENTION
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>200	4	18	6
Chromium	ppm	ASTM D5185m	>15	<1	0	0
Nickel	ppm	ASTM D5185m	>15	0	<1	0
Titanium	ppm	ASTM D5185m		<1	0	0
Silver	ppm	ASTM D5185m		0	0	<1
Aluminum	ppm	ASTM D5185m	>25	2	4	<1
Lead	ppm	ASTM D5185m	>100	<1	1	<1
Copper	ppm	ASTM D5185m	>200	0	0	0
Tin	ppm	ASTM D5185m	>25	<1	1	0
Vanadium	ppm	ASTM D5185m		0	<1	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m		<1	1	0
Calcium	ppm	ASTM D5185m		0	0	0
Phosphorus	ppm	ASTM D5185m		455	508	485
Zinc	ppm	ASTM D5185m		0	3	0
Sulfur	ppm	ASTM D5185m		486	643	602
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	4	2	2
Sodium	ppm	ASTM D5185m		0	0	0
Potassium	ppm	ASTM D5185m	>20	<1	<1	<1
Water	%	ASTM D6304	>0.2	0.002	0.005	0.003
ppm Water	ppm	ASTM D6304	>2000	20	57	33.2
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>20000	17584	15246	2401
Particles >6µm		ASTM D7647	>5000	3551	2152	370
Particles >14µm		ASTM D7647	>640	105	39	16
Particles >21µm		ASTM D7647	>160	24	5	3
Particles >38µm		ASTM D7647	>40	3	0	0
Particles >71µm		ASTM D7647	>10	1	0	0
Oil Cleanliness		ISO 4406 (c)	>21/19/16	21/19/14	21/18/12	18/16/11
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.27	0.24	0.21





## **OIL ANALYSIS REPORT**



140k - 4	lum lum				
120k1	4μm				
100k					
100k - 80k - 60k - 40k - Abnormal	- 1	1			
60k -		1	Λ		
40k	-	1	/ \		
20k - Abnormal	- Lauren		1		_
Ok Lesses		1	-	2	er er
Nov7/19 Aug12/20	Jan21/21	Feb21/21	Jul22/21	Aug16/22	Aug8/23








VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
<b>Emulsified Water</b>	scalar	*Visual	>0.2	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445		298	206	195
SAMPLE IMAGES		method	limit/base	current	history1	history2

Color **Bottom** 



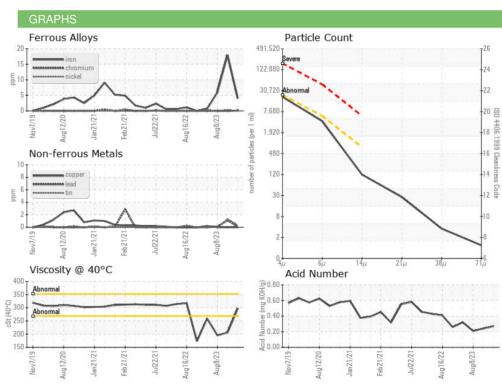





Certificate 12367

Laboratory Sample No. Lab Number : 06209267

: USPM37658 Unique Number : 11076728 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 13 Jun 2024

**Tested** : 16 Jun 2024 Diagnosed : 16 Jun 2024 - Doug Bogart

**CARGILL OIL SEEDS- GAINESVILLE** 

862 WEST RIDGE ROAD GAINESVILLE, GA US 30501

Contact: robyn wilbanks robyn\_wilbanks@cargill.com T: (770)531-4736

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: (770)538-6251