




OIL ANALYSIS REPORT

Sample Rating Trend

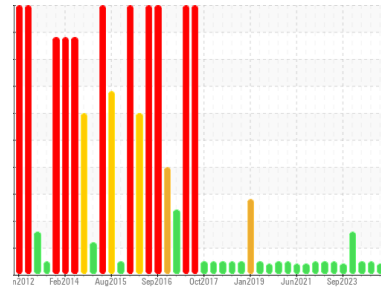

VISCOSITY



Area
FIBER
 Machine Id
FIBER OCC PULPER
 Component
Gearbox
 Fluid
ROYAL PURPLE SYNERGY 90/220 (--- GAL)

DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

▲ Fluid Condition

The oil viscosity is higher than normal. The AN level is acceptable for this fluid.

SAMPLE INFORMATION	method	limit/base	current	history1	history2
Sample Number	Client Info		RP0037927	RP0030311	RP0030330
Sample Date	Client Info		13 Jun 2024	13 Mar 2024	22 Jan 2024
Machine Age	mths	Client Info	0	0	0
Oil Age	mths	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			MARGINAL	NORMAL	NORMAL

WEAR METALS	method	limit/base	current	history1	history2
PQ	ASTM D8184		24	20	19
Iron	ppm	ASTM D5185m >200	85	57	60
Chromium	ppm	ASTM D5185m >15	<1	<1	<1
Nickel	ppm	ASTM D5185m >15	<1	0	1
Titanium	ppm	ASTM D5185m	0	<1	<1
Silver	ppm	ASTM D5185m	0	<1	0
Aluminum	ppm	ASTM D5185m >25	1	<1	2
Lead	ppm	ASTM D5185m >100	<1	1	1
Copper	ppm	ASTM D5185m >200	2	<1	1
Tin	ppm	ASTM D5185m >25	<1	<1	1
Vanadium	ppm	ASTM D5185m	0	<1	<1
Cadmium	ppm	ASTM D5185m	0	<1	<1






ADDITIVES	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	7	11	12
Barium	ppm	ASTM D5185m	0	0	<1
Molybdenum	ppm	ASTM D5185m	<1	<1	1
Manganese	ppm	ASTM D5185m	1	1	2
Magnesium	ppm	ASTM D5185m	0	0	0
Calcium	ppm	ASTM D5185m	0	0	3
Phosphorus	ppm	ASTM D5185m 370	264	264	261
Zinc	ppm	ASTM D5185m	4	5	5

CONTAMINANTS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >50	3	2	2
Sodium	ppm	ASTM D5185m	1	2	0
Potassium	ppm	ASTM D5185m >20	4	1	1
Water	%	ASTM D6304 >0.2	0.012	0.008	0.022
ppm Water	ppm	ASTM D6304 >2000	124	81	224

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>20000	5518	3702	4339
Particles >6µm	ASTM D7647	>5000	327	372	568
Particles >14µm	ASTM D7647	>640	11	19	48
Particles >21µm	ASTM D7647	>160	1	4	12
Particles >38µm	ASTM D7647	>40	0	0	0
Particles >71µm	ASTM D7647	>10	0	0	0
Oil Cleanliness	ISO 4406 (c)	>21/19/16	20/16/11	19/16/11	19/16/13

FLUID DEGRADATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.33	0.97	0.83	0.75


OIL ANALYSIS REPORT

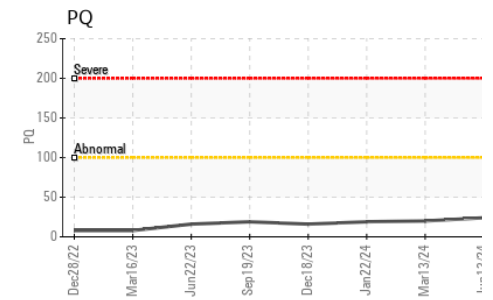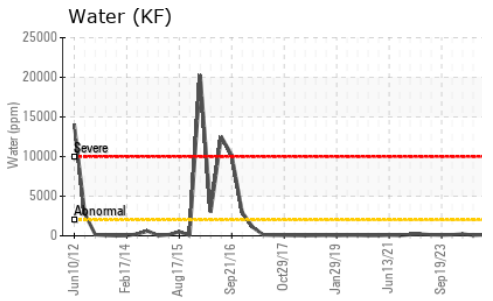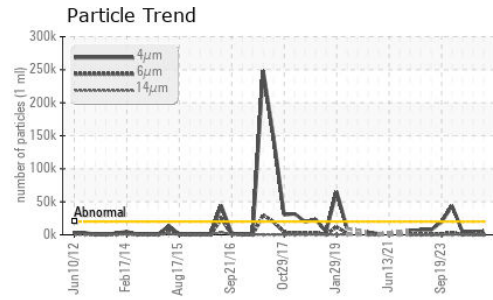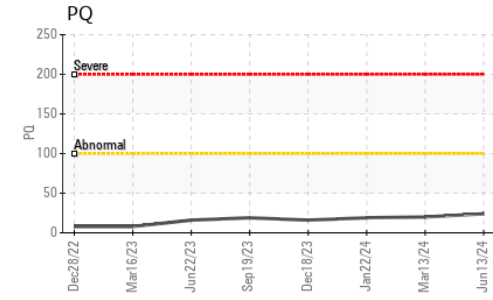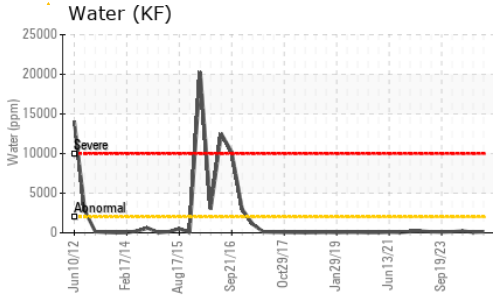






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	216.1 ▲ 277.0	209	211

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

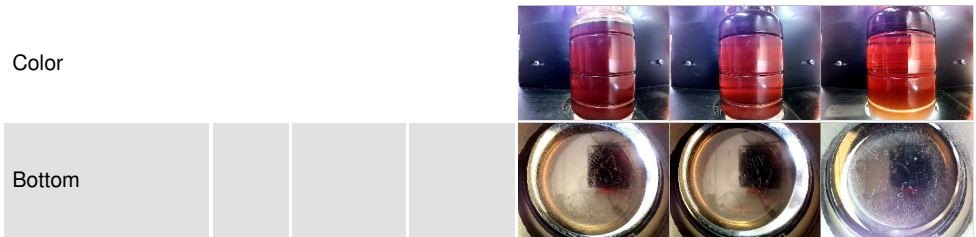

GRAPHS

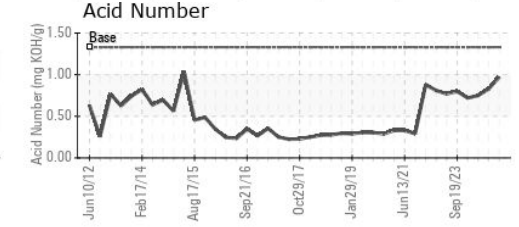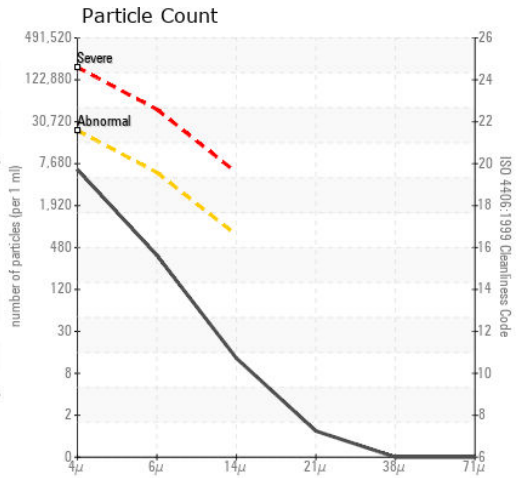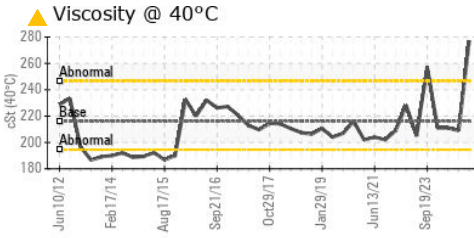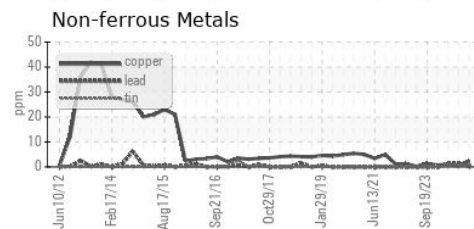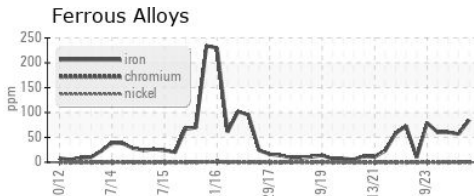

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : RP0037927
Lab Number : 06210140
Unique Number : 11083004
Test Package : IND 2 (Additional Tests: PQ, PrtCount)

Kimberly-Clark - Mobile - Fiber - BC UNITS
 200 BAYBRIDGE RD
 MOBILE, AL
 US 36610

Contact: MARK BOSARGE
 Mark.W.Bosarge@kcc.com
 T: (251)330-2221
 F: (251)452-6335

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)