


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



Machine Id

30 PRE-PRESS

Component Hydraulic System

MEGAFLOW AW-68 (--- GAL)

	G١		

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				May2024	24	
SAMPLE INFORM	AATION	method	limit/base	ourropt	hiotonyi	hioton/2
	MATION		IIIIIIVDase	current	history1	history2
Sample Number		Client Info		Y2K0000595		
Sample Date		Client Info		06 May 2024		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0 Not Observed		
Oil Changed		Client Info		Not Changd NORMAL		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>20	4		
Chromium	ppm	ASTM D5185m	>20	0		
Nickel	ppm	ASTM D5185m	>20	0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>20	<1		
Lead	ppm	ASTM D5185m	>20	<1		
Copper	ppm	ASTM D5185m	>20	5		
Tin	ppm	ASTM D5185m	>20	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<1		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		<1		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m		0		
Calcium	ppm	ASTM D5185m		27		
Phosphorus	ppm	ASTM D5185m		270		
Zinc	ppm	ASTM D5185m		332		
Sulfur	ppm	ASTM D5185m		583		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	2		
Sodium	ppm	ASTM D5185m		1		
Potassium	ppm	ASTM D5185m	>20	3		
Water	%	ASTM D6304	>0.05	0.006		
ppm Water	ppm	ASTM D6304	>500	63		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>5000	2144		
Particles >6µm		ASTM D7647	>1300	63		
Particles >14μm		ASTM D7647	>160	7		
Particles >21µm		ASTM D7647	>40	2		
Particles >38µm		ASTM D7647	>10	0		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>19/17/14	18/13/10		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.46		



OIL ANALYSIS REPORT

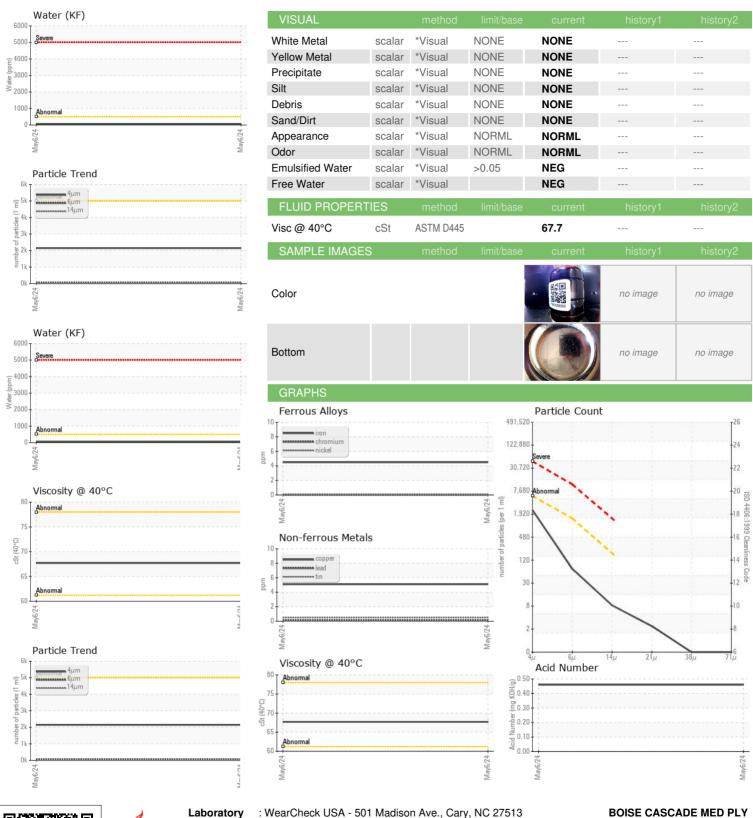





Certificate 12367

Laboratory Sample No.

Lab Number : 06210148

: Y2K0000595 Unique Number : 11083012

Received : 14 Jun 2024 **Tested** Diagnosed

: 17 Jun 2024 : 17 Jun 2024 - Wes Davis

Test Package : MOB 2 (Additional Tests: KF) To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

BOISE CASCADE MED PLY

3285 N PACIFIC HWY MEDFORD, OR US 97501 Contact: JOSE MATA

josemata@bc.com T: (541)776-6666

Contact/Location: JOSE MATA - BOIMED