




# OIL ANALYSIS REPORT

Sample Rating Trend

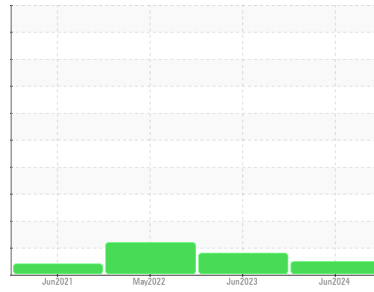

**NORMAL**



Machine Id  
**7464091 (S/N 1135)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KC130259</b>	KC101927	KC97451
Sample Date	Client Info			<b>07 Jun 2024</b>	02 Jun 2023	13 May 2022
Machine Age	hrs	Client Info		<b>8504</b>	6303	4153
Oil Age	hrs	Client Info		<b>2201</b>	2150	1139
Oil Changed	Client Info			<b>Changed</b>	Changed	Changed
Sample Status				<b>NORMAL</b>	ATTENTION	ATTENTION

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>&lt;1</b>	0	<1
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	<1
Aluminum	ppm	ASTM D5185m	>10	<b>1</b>	0	<1
Lead	ppm	ASTM D5185m	>10	<b>0</b>	<1	1
Copper	ppm	ASTM D5185m	>50	<b>3</b>	1	1
Tin	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	0
Antimony	ppm	ASTM D5185m		<b>---</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>&lt;1</b>	0	<1
Barium	ppm	ASTM D5185m	90	<b>22</b>	42	51
Molybdenum	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Magnesium	ppm	ASTM D5185m	90	<b>46</b>	74	72
Calcium	ppm	ASTM D5185m	2	<b>0</b>	<1	3
Phosphorus	ppm	ASTM D5185m		<b>0</b>	2	12
Zinc	ppm	ASTM D5185m		<b>0</b>	<1	2

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>2</b>	<1	1
Sodium	ppm	ASTM D5185m		<b>10</b>	9	11
Potassium	ppm	ASTM D5185m	>20	<b>5</b>	4	5
Water	%	ASTM D6304	>0.05	<b>0.014</b>	0.016	0.012
ppm Water	ppm	ASTM D6304	>500	<b>145</b>	165.4	121.8

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>750</b>	4884	3980
Particles >6µm		ASTM D7647	>1300	<b>296</b>	2139	1233
Particles >14µm		ASTM D7647	>80	<b>16</b>	40	137
Particles >21µm		ASTM D7647	>20	<b>2</b>	8	41
Particles >38µm		ASTM D7647	>4	<b>0</b>	1	2
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>17/15/11</b>	19/18/12	19/17/14

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	<b>0.32</b>	0.33	0.32


# OIL ANALYSIS REPORT

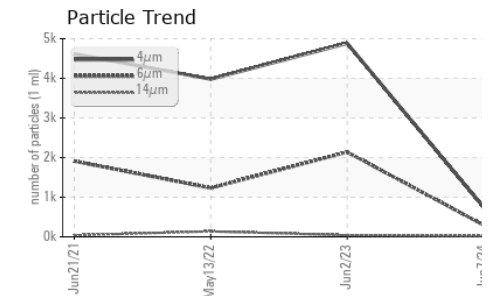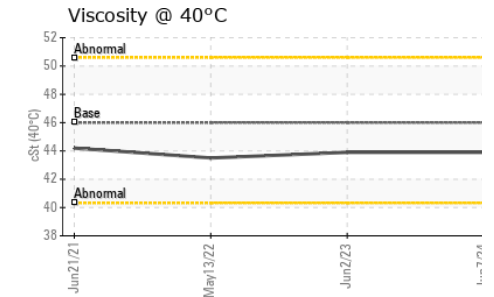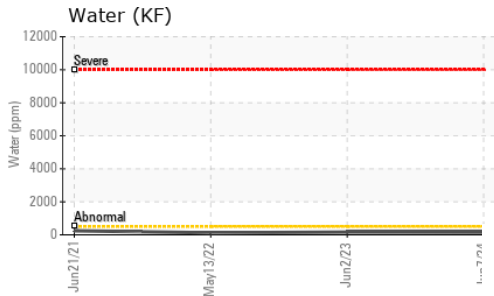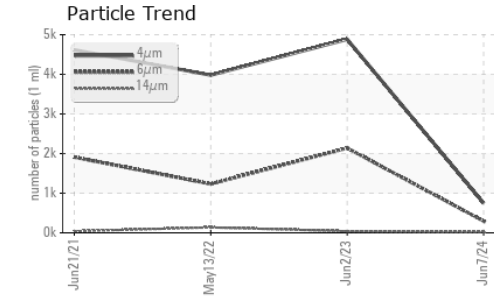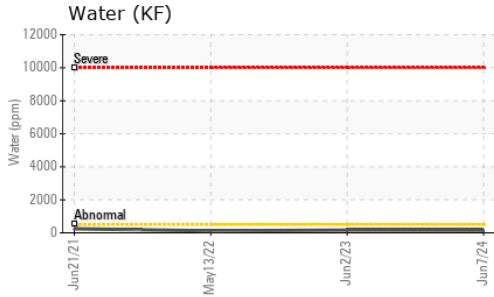






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	43.9	43.9	43.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

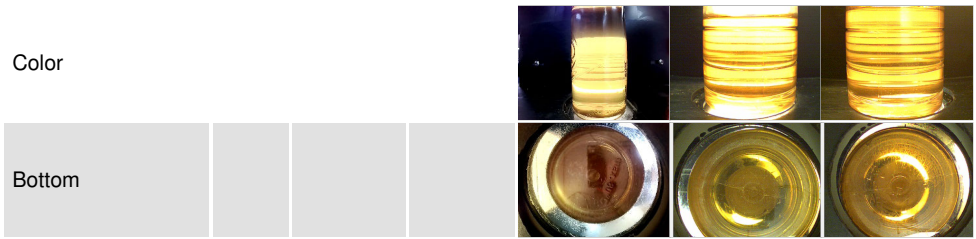

## GRAPHS

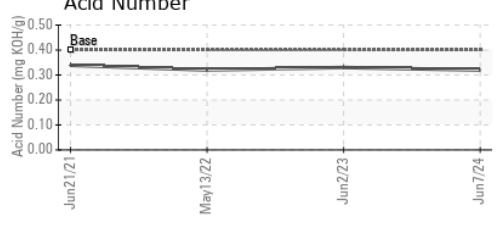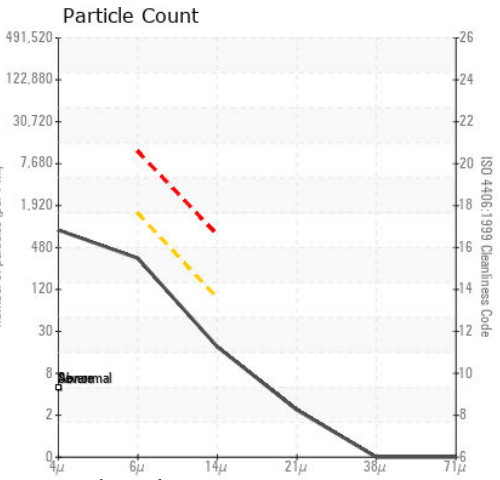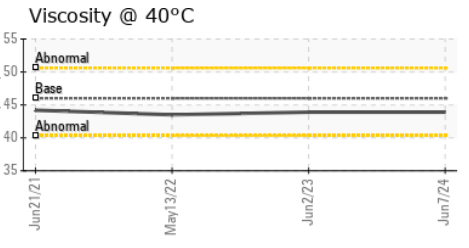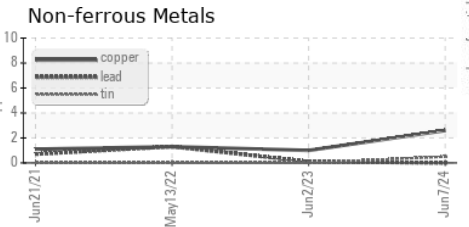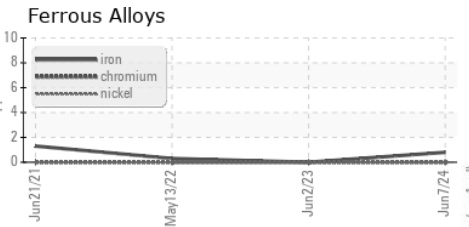

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC130259  
**Lab Number** : 06210159  
**Unique Number** : 11083023  
**Test Package** : IND 2  
**Received** : 14 Jun 2024  
**Tested** : 18 Jun 2024  
**Diagnosed** : 18 Jun 2024 - Don Baldrige

**S & K ELECTRONICS**  
 56301 ELECTRONICS  
 RONAN, MT  
 US 59864  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)