


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



Machine Id **SCREW 1**

Refrigeration Compressor

USPI 1009-68 SC (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


		Sep2020 A	pr2021 Oct2021 May	2022 Dec2022 Jul2023	Feb 2024	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USP0013320	USP0007741	USP0003506
Sample Date		Client Info		13 Jun 2024	21 Feb 2024	23 Nov 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	<1	0	<1
Chromium	ppm	ASTM D5185m	>2	0	<1	<1
Nickel	ppm	ASTM D5185m		0	0	<1
Titanium	ppm	ASTM D5185m		0	0	<1
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>3	<1	0	0
Lead	ppm	ASTM D5185m	>2	0	0	0
Copper	ppm	ASTM D5185m	>8	2	0	<1
Tin	ppm	ASTM D5185m	>4	<1	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	<1
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<1	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		<1	0	<1
Manganese	ppm	ASTM D5185m		<1	0	0
Magnesium	ppm	ASTM D5185m		0	0	<1
Calcium	ppm	ASTM D5185m		0	0	<1
Phosphorus	ppm	ASTM D5185m		0	0	0
Zinc	ppm	ASTM D5185m		0	0	0
Sulfur	ppm	ASTM D5185m	50	0	0	0
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<1	0	<1
Sodium	ppm	ASTM D5185m		<1	0	0
Potassium	ppm	ASTM D5185m	>20	3	0	<1
Water	%	ASTM D6304	>0.01	0.003	0.001	0.003
ppm Water	ppm	ASTM D6304	>100	39	12	31
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	8830	2896	4650
Particles >6µm		ASTM D7647	>2500	2113	688	1140
Particles >14µm		ASTM D7647	>320	38	23	45
Particles >21µm		ASTM D7647	>80	8	3	12
Particles >38µm		ASTM D7647	>20	1	0	0
Particles >71µm		ASTM D7647	>4	0	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	20/18/12	19/17/12	19/17/13
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.005	0.014	0.014	0.013





OIL ANALYSIS REPORT




Ok -	4μm 6μm					
5k - 1	 14µп					
Ok - Abac	rmal					
UK + D		_	/	1		
1						
0k - 5k - Abac 5k - 5k -	-	\wedge	/	1		/
5k 0k 0z/£1das	Apr10/21	Oct19/21	May17/22	Dec18/22	Jul10/23	Feb21/24 {







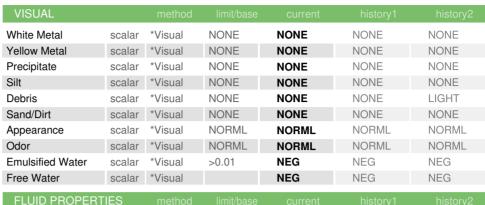

Visc @ 40°C	cSt	ASTM D445	67	67.0	67.7	68.5

SAMPLE IMAGES	method	
Color		or to service w





GR	APHS											
Ferr	ous All	oys					Parti 491,520 _T	cle Cou	int			T ²⁶
	iron chron						122,880 Severe					-24
4							30,720 - Abnorma					-22
0 L	21	21	22	- 22	23	24	- 7 680 P					-20 IS
Sep13/20	Apr10/21	Oct19/21	May17/22	Dec18/22	Jul10/23	Feb21/24	1,920-	1:				18 :18
	Non-ferrous Metals										180 4406:1999 Cleanliness Code	
8	coppe	er]					120 -		1			-14 miness
- G1	annana tin	J					₹ 30+		/			-12 Code
2							8+			1		-10
Sep13/20	Apr10/21.	Oct19/21	May17/22	Dec18/22	Jul10/23	Feb21/24	2-					8
				Dec	Jul	Feb.	044	6μ	14μ	21μ	38μ	71 _µ
80	Viscosity @ 40°C Acid Number											
75 - Abno (2070 - Base 75 - Abno	rmal	\wedge					0.01 Rase (mg VOH/g)		-			
60 - Abno	rmal						Base					
Sep13/20	Apr10/21	Oct19/21-	May17/22 -	Dec18/22 -	Jul10/23 -	Feb21/24	Ac Ac Sep 13/20	Apr10/21-	0ct19/21-	May17/22 + Dec18/22 +	Jul10/23 +	Feb21/24 -





Certificate 12367

Laboratory Sample No.

: USP0013320 Lab Number : 06210184 Unique Number : 11083048 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 14 Jun 2024

Tested : 19 Jun 2024 Diagnosed

: 19 Jun 2024 - Doug Bogart

SMITHFIELD - CARROLL - SMICAR

401 N GRANT RD CARROLL, IA US 51401 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: