

OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

Machine Id

RECIP 5 (S/N 63499)

Reciprocating Compressor

USPI 1009-68 SC (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


																					ł					
																						K				
						1																				
2016	Ĵ	ul2017	Â	pr201	8 1	Mar2	019	Feb	2020	Ďe	c2020	j 0	ct20)	21	Sep 2	022	Ĵul	2023	Ĵi	ın20						


SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USP0013318	USP0007740	USP0003507
Sample Date		Client Info		13 Jun 2024	21 Feb 2024	23 Nov 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	0	0
Chromium	ppm	ASTM D5185m	>10	0	<1	<1
Nickel	ppm	ASTM D5185m		0	0	<1
Titanium	ppm	ASTM D5185m		0	0	<1
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>25	<1	0	0
Lead	ppm	ASTM D5185m	>25	0	0	0
Copper	ppm	ASTM D5185m	>50	2	0	<1
Tin	ppm	ASTM D5185m	>15	<1	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	<1
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<1	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		<1	0	<1
Manganese	ppm	ASTM D5185m		<1	0	0
Magnesium	ppm	ASTM D5185m		0	0	0
Calcium	ppm	ASTM D5185m		0	0	<1
Phosphorus	ppm	ASTM D5185m		0	0	0
Zinc	ppm	ASTM D5185m		0	0	0
Sulfur	ppm	ASTM D5185m	50	0	0	0
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	0	<1
Sodium	ppm	ASTM D5185m		<1	0	0
Potassium	ppm	ASTM D5185m	>20	3	0	<1
Water	%	ASTM D6304	>0.1	0.006	0.003	0.006
ppm Water	ppm	ASTM D6304	>1000	69	35	62
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	3228	5461	1988
Particles >6µm		ASTM D7647	>2500	539	1028	391
Particles >14µm		ASTM D7647	>320	9	22	16
Particles >21µm		ASTM D7647	>80	3	3	3
Particles >38µm		ASTM D7647	>20	0	0	0
Particles >71µm		ASTM D7647	>4	0	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	19/16/10	20/17/12	18/16/11
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.005	0.014	0.028	0.012




OIL ANALYSIS REPORT











Viscosity @ 40°C





VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERT	IES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	67	75.8	72.6	72.6
SAMPLE IMAGES	\$	method	limit/base	current	history1	history2
Color						NH3 - HS R WHAT AT REFERENCE ALL AND ALL AND
Bottom						

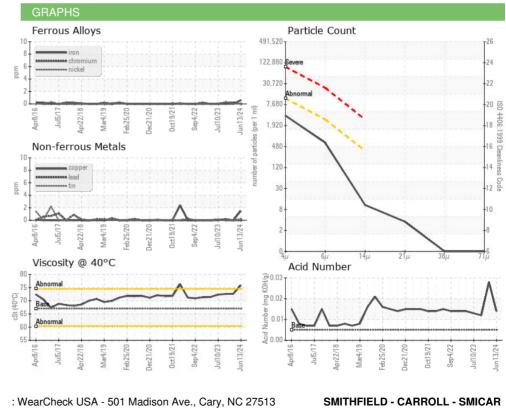


: 14 Jun 2024

: 19 Jun 2024

: 19 Jun 2024 - Doug Bogart





To discuss this sample report, contact Customer Service at 1-800-237-1369.

: USP0013318

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Received

Diagnosed

Tested

T: F:

Report Id: SMICARIA [WUSCAR] 06210186 (Generated: 06/22/2024 23:19:27) Rev: 1

Contact/Location: ? ? - SMICARIA

401 N GRANT RD

CARROLL, IA

US 51401

Contact: