


# **OIL ANALYSIS REPORT**

Sample Rating Trend



**NORMAL** 



Machine Id

# FES C-2 (S/N 10094-001-1-01-2)

Refrigeration Compressor

USPI 1009-68 SC (--- GAL)

### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Jan2020 1	lov2020 May2021	Feb2022 Jul2023 Feb2024	Jun2024	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USP0013337	USP0011538	USP0007180
Sample Date		Client Info		06 Jun 2024	14 May 2024	07 Feb 2024
Machine Age	hrs	Client Info		22029	21598	20942
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	ABNORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	<1	0	0
Chromium	ppm	ASTM D5185m	>2	0	0	0
Nickel	ppm	ASTM D5185m		0	0	0
Titanium	ppm	ASTM D5185m		0	0	<1
Silver	ppm	ASTM D5185m	>2	0	<1	0
Aluminum	ppm	ASTM D5185m	>3	<1	0	0
Lead	ppm	ASTM D5185m	>2	0	0	0
Copper	ppm	ASTM D5185m		2	0	0
Tin	ppm	ASTM D5185m	>4	<1	0	<1
Vanadium	ppm	ASTM D5185m		0	0	<1
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES	1-1-	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<1	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum		ASTM D5185m		<1	0	0
•	ppm	ASTM D5185m		<1	0	0
Manganese Magnesium	ppm	ASTM D5185m		0	0	0
Calcium	ppm	ASTM D5185m		0	0	0
	ppm			-		
Phosphorus	ppm	ASTM D5185m		0	<1	0
Zinc	ppm	ASTM D5185m	F0	0	0	0
Sulfur	ppm	ASTM D5185m	50	0	0	0
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	3	2	2
Sodium	ppm	ASTM D5185m		2	2	1
Potassium	ppm	ASTM D5185m	>20	3	0	0
Water	%	ASTM D6304	>0.01	0.005	0.005	0.004
ppm Water	ppm	ASTM D6304	>100	54	57	43
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	2271	<u>\$\text{29378}\$</u>	7382
Particles >6µm		ASTM D7647	>2500	543	4379	2103
Particles >14μm		ASTM D7647	>320	12	9	100
Particles >21µm		ASTM D7647	>80	2	0	20
Particles >38µm		ASTM D7647	>20	0	0	0
Particles >71µm		ASTM D7647	>4	0	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	18/16/11	<u>22/19/10</u>	20/18/14
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.005	0.014	0.012	0.015



## OIL ANALYSIS REPORT

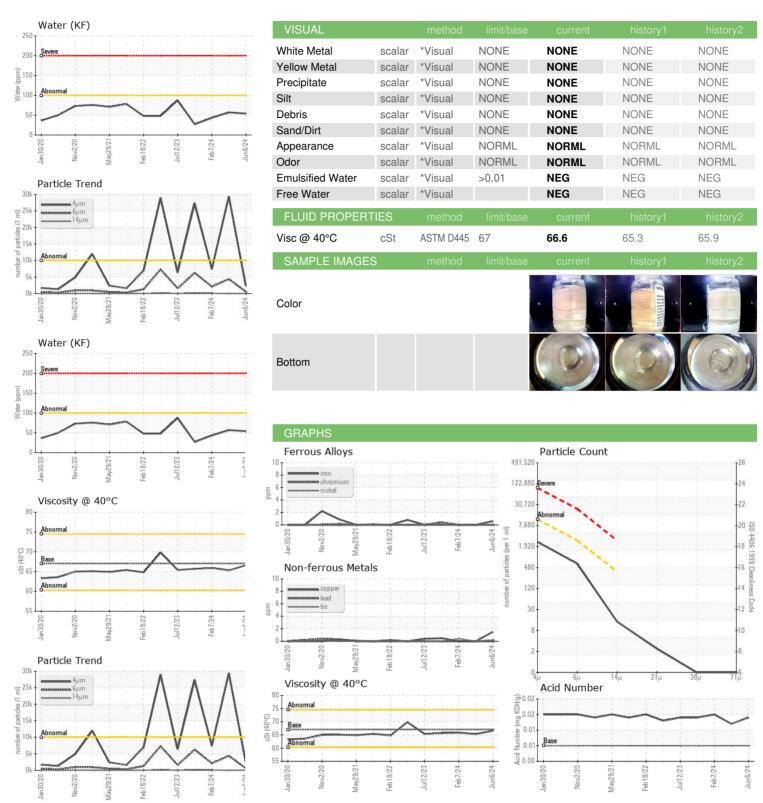





Laboratory Sample No. Lab Number

: 06210187 Unique Number : 11083051

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : USP0013337 Received **Tested** 

: 14 Jun 2024

: 19 Jun 2024

: 19 Jun 2024 - Doug Bogart

Diagnosed Test Package : IND 2

Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

AMERICAN FOODS GROUP

1000 CATTLE DR. YANKTON, SD

US 57078 Contact: Service Manager

Contact/Location: Service Manager - AMEYAN

T:

F: