




# OIL ANALYSIS REPORT

Area  
**OMNILUBE FG 46 XL**  
 Machine Id  
**GARDNER DENVER S508284 - HEARTHSIDE**  
 Component  
**Compressor**

Sample Rating Trend

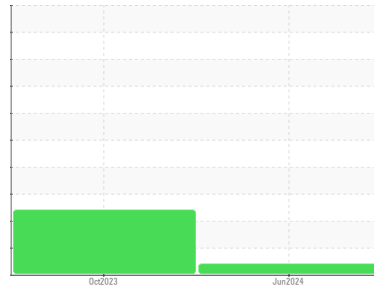

## VISCOSITY



### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil.

#### Fluid Condition

The oil viscosity is higher than normal. Confirm oil type. The AN level is acceptable for this fluid.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>UCH06210223</b>	UCH06049016	---
Sample Date	Client Info			<b>01 Jun 2024</b>	09 Oct 2023	---
Machine Age	hrs	Client Info		<b>0</b>	40485	---
Oil Age	hrs	Client Info		<b>6520</b>	0	---
Oil Changed	Client Info			<b>N/A</b>	N/A	---
Sample Status				<b>ABNORMAL</b>	ABNORMAL	---

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.1	<b>NEG</b>	NEG	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>&lt;1</b>	7	---
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	---
Nickel	ppm	ASTM D5185m		<b>0</b>	0	---
Titanium	ppm	ASTM D5185m		<b>0</b>	0	---
Silver	ppm	ASTM D5185m		<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m	>25	<b>&lt;1</b>	0	---
Lead	ppm	ASTM D5185m	>25	<b>0</b>	0	---
Copper	ppm	ASTM D5185m	>50	<b>2</b>	2	---
Tin	ppm	ASTM D5185m	>15	<b>&lt;1</b>	<1	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>&lt;1</b>	0	---
Barium	ppm	ASTM D5185m		<b>0</b>	0	---
Molybdenum	ppm	ASTM D5185m		<b>&lt;1</b>	0	---
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	---
Magnesium	ppm	ASTM D5185m		<b>0</b>	<1	---
Calcium	ppm	ASTM D5185m		<b>0</b>	1	---
Phosphorus	ppm	ASTM D5185m	75	<b>0</b>	<1	---
Zinc	ppm	ASTM D5185m		<b>0</b>	0	---
Sulfur	ppm	ASTM D5185m	1500	<b>0</b>	0	---


CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	0	---
Sodium	ppm	ASTM D5185m		<b>&lt;1</b>	1	---
Potassium	ppm	ASTM D5185m	>20	<b>3</b>	0	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.24	<b>0.64</b>	0.36	---




# OIL ANALYSIS REPORT

▲ Viscosity @ 40°C

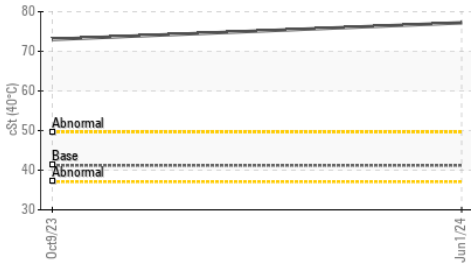


Acid Number

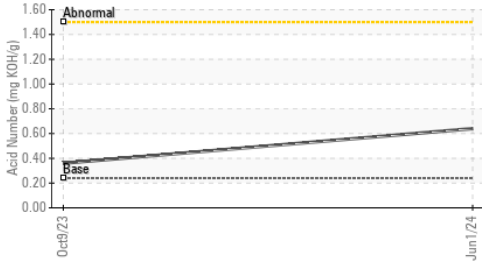





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.1	NEG	0.2%
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	41.2 ▲ 77.2	▲ 73.02	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

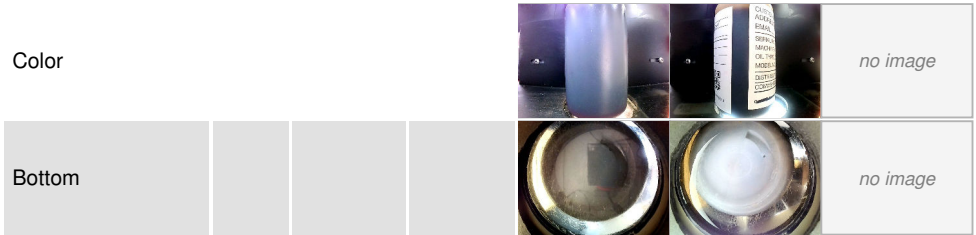

## GRAPHS

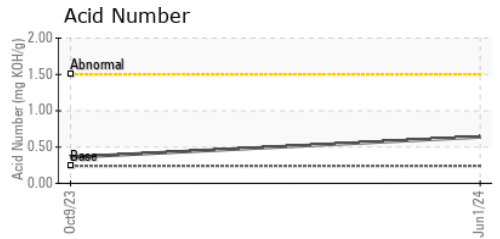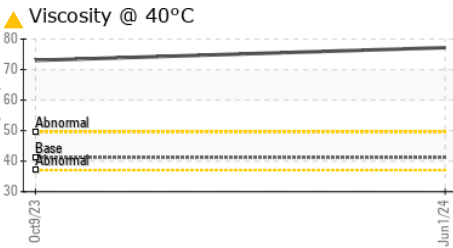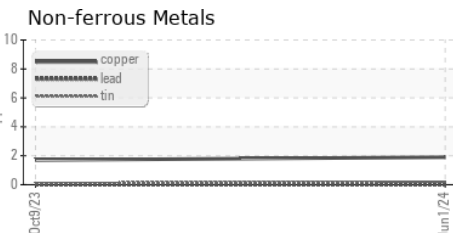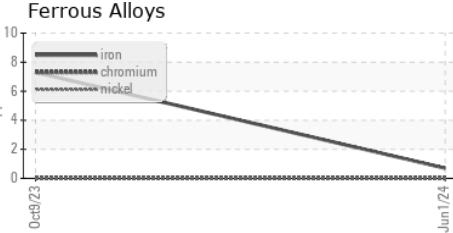

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCH06210223      **Received** : 14 Jun 2024  
**Lab Number** : 06210223      **Tested** : 18 Jun 2024  
**Unique Number** : 11083087      **Diagnosed** : 18 Jun 2024 - Angela Borella  
**Test Package** : IND 2

**AIR HANDLING EQUIPMENT INC**  
 1389 RIVERSIDE DR  
 SIDNEY, OH  
 US 45365  
 Contact: ANGIE ROSENBECK  
 angie@ahequip.net  
 T: (937)658-6266  
 F: (937)492-3147

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)