


# **OIL ANALYSIS REPORT**

NOT GIVEN **CHICAGO PNEUMATIC ITJ293685** 

Component Compressor

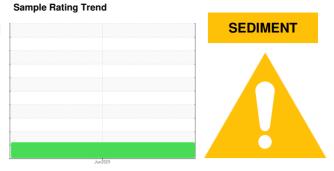

## **DIAGNOSIS**

### Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

All component wear rates are normal.

## Contamination

There is a moderate amount of visible silt present in the sample. Moderate concentration of visible dirt/debris present in the oil.


### **Fluid Condition**


The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.


SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UCH06210241		
Sample Date		Client Info		03 Jun 2024		
Machine Age	hrs	Client Info		9105		
Oil Age	hrs	Client Info		1600		
Oil Changed		Client Info		Not Changd		
Sample Status				ABNORMAL		
CONTAMINATION	V	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	1		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m		<1		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>25	<1		
Lead	ppm	ASTM D5185m	>25	0		
Copper	ppm	ASTM D5185m	>50	2		
Tin	ppm	ASTM D5185m	>15	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<1		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		<1		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m		0		
Calcium	ppm	ASTM D5185m		0		
Phosphorus	ppm	ASTM D5185m		225		
Zinc	ppm	ASTM D5185m		117		
Sulfur	ppm	ASTM D5185m		516		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	4		
Sodium	ppm	ASTM D5185m		3		
Potassium	ppm	ASTM D5185m	>20	4		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.28		



# **OIL ANALYSIS REPORT**

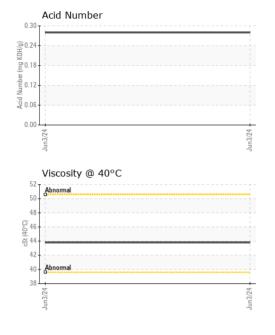

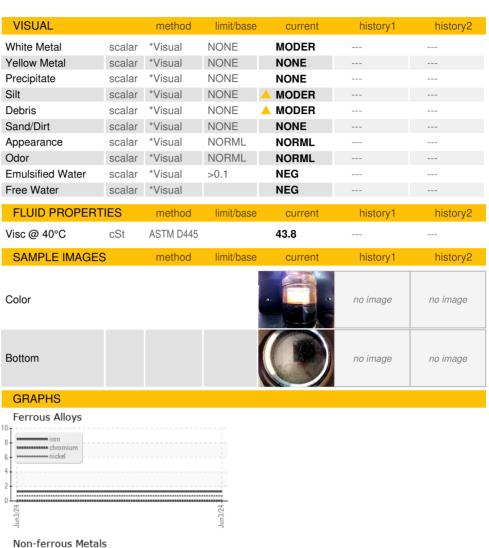





Certificate 12367

Laboratory Sample No.

Lab Number : 06210241 Unique Number : 11083105

Test Package : IND 2

35

: UCH06210241

Viscosity @ 40°C

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 14 Jun 2024

**Tested** : 18 Jun 2024 Diagnosed : 18 Jun 2024 - Angela Borella

ADVANCED COMPRESSED AIR SOLUTIONS (ACAS)

9421 FM 2920 RD BLDG 23 TOMBALL, TX

US 77375

Contact: JIM SUAREZ jim@advancedcompressedair.com

To discuss this sample report, contact Customer Service at 1-800-237-1369. \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) F:

Acid Number

(g) 0.30 (g) 0.24 £ 0.18 은 0.12 0.06

0.00

T: