

Area


**PALASYN 45**

Machine Id

**SULLIVAN PALATEK 21ME002772 - RENA TECH**

Component

**Compressor**

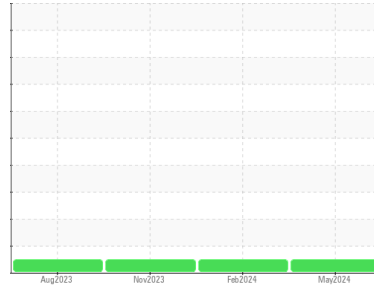

**DIAGNOSIS**

**Recommendation**

Resample at the next service interval to monitor.

**Wear**

All component wear rates are normal.

**Contamination**

There is no indication of any contamination in the oil.

**Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

**SAMPLE INFORMATION** method limit/base current history1 history2

Sample Number	Client Info	<b>UCS06210255</b>	UCS06210266	UCS06059361	
Sample Date	Client Info	<b>08 May 2024</b>	21 Feb 2024	21 Nov 2023	
Machine Age	hrs	Client Info	<b>3602</b>	2953	2215
Oil Age	hrs	Client Info	<b>2162</b>	1513	775
Oil Changed	Client Info	<b>Changed</b>	Not Changd	Not Changd	
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

**CONTAMINATION** method limit/base current history1 history2

Water	WC Method	>0.1	<b>NEG</b>	NEG	NEG
-------	-----------	------	------------	-----	-----

**WEAR METALS** method limit/base current history1 history2

Iron	ppm	ASTM D5185m	>50	<b>&lt;1</b>	0	0
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m		<b>0</b>	0	0
Titanium	ppm	ASTM D5185m		<b>0</b>	0	0
Silver	ppm	ASTM D5185m		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>25	<b>&lt;1</b>	0	0
Lead	ppm	ASTM D5185m	>25	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>2</b>	0	0
Tin	ppm	ASTM D5185m	>15	<b>&lt;1</b>	0	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

**ADDITIVES** method limit/base current history1 history2

Boron	ppm	ASTM D5185m	0.0	<b>&lt;1</b>	993	0
Barium	ppm	ASTM D5185m	0.0	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	0	<b>&lt;1</b>	0	0
Manganese	ppm	ASTM D5185m	0	<b>&lt;1</b>	0	0
Magnesium	ppm	ASTM D5185m	0.0	<b>0</b>	0	0
Calcium	ppm	ASTM D5185m	0.0	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m	966	<b>586</b>	623	638
Zinc	ppm	ASTM D5185m	0	<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m	1309	<b>988</b>	1078	1028


**CONTAMINANTS** method limit/base current history1 history2

Silicon	ppm	ASTM D5185m	>25	<b>3</b>	2	2
Sodium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Potassium	ppm	ASTM D5185m	>20	<b>3</b>	0	0

**FLUID DEGRADATION** method limit/base current history1 history2

Acid Number (AN)	mg KOH/g	ASTM D8045	0.172	<b>0.11</b>	0.07	0.07
------------------	----------	------------	-------	-------------	------	------


# OIL ANALYSIS REPORT

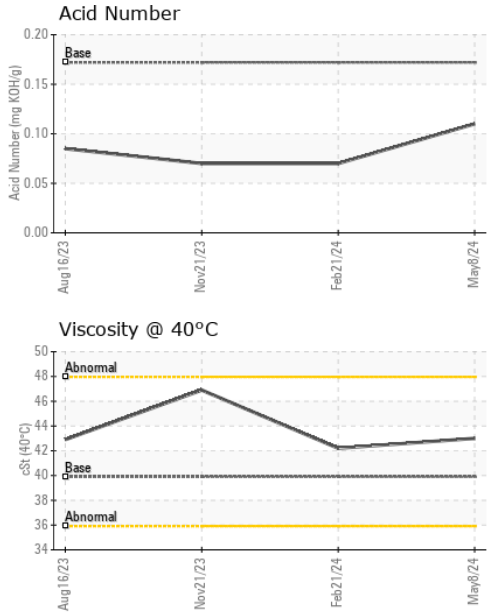



VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>LIGHT</b>	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	39.9	<b>43.0</b>	42.2	46.9

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

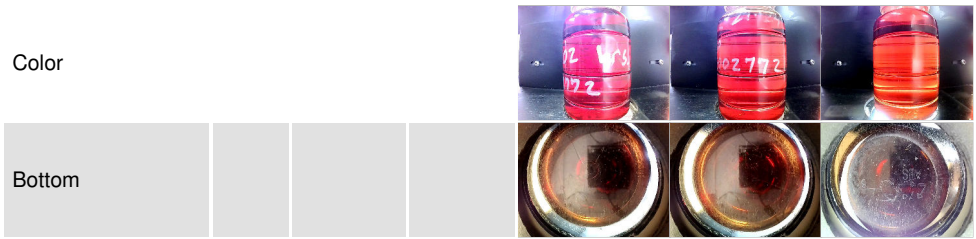

## GRAPHS

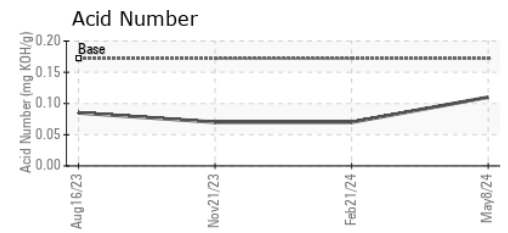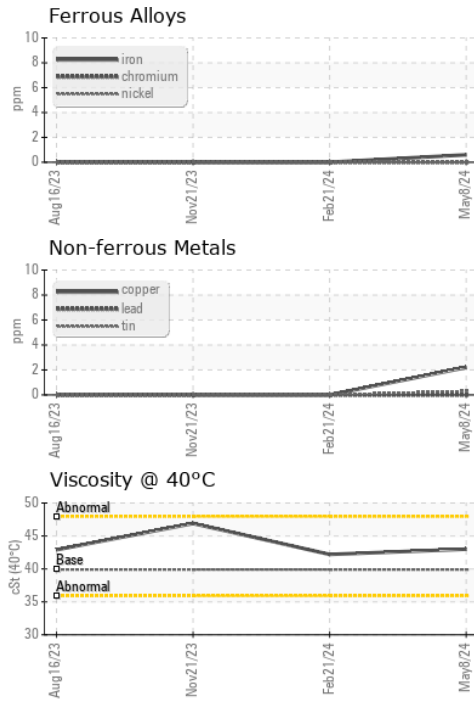

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCS06210255      **Received** : 14 Jun 2024  
**Lab Number** : **06210255**      **Tested** : 17 Jun 2024  
**Unique Number** : 11083119      **Diagnosed** : 17 Jun 2024 - Wes Davis  
**Test Package** : IND 2

**NORTHWEST COMPRESSOR**  
 29897 HWY 34 SW  
 ALBANY, OR  
 US 97321  
 Contact: CRAIG WORLEY  
 service@nwcompressor.com  
 T: (541)752-5366  
 F: (541)752-4716

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)