




# OIL ANALYSIS REPORT

## Sample Rating Trend

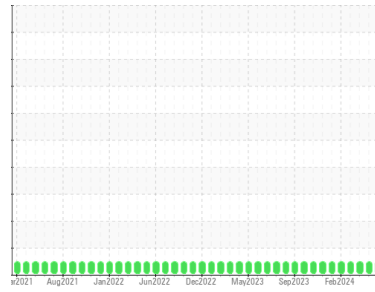

**NORMAL**



Area

**Tampa**

Machine Id

**[Tampa] Oil - Port Genset**

Component

**Port Genset**

Fluid

**MOBIL 15W40 (7 GAL)**

### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil.

#### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

### SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0874668</b>	WC0874673	WC0805299
Sample Date	Client Info		<b>04 Jun 2024</b>	09 May 2024	11 Apr 2024
Machine Age	hrs	Client Info	<b>22488</b>	14780	21660
Oil Age	hrs	Client Info	<b>250</b>	7	354
Oil Changed	Client Info		<b>Not Chngd</b>	Not Chngd	Not Chngd
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

### CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<b>&lt;1.0</b>	<1.0	<1.0
Glycol	WC Method		<b>NEG</b>	NEG	NEG

### WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>4</b>	3	3
Chromium	ppm	ASTM D5185m >4	<b>&lt;1</b>	<1	<1
Nickel	ppm	ASTM D5185m >2	<b>&lt;1</b>	<1	0
Titanium	ppm	ASTM D5185m	<b>&lt;1</b>	<1	<1
Silver	ppm	ASTM D5185m >5	<b>0</b>	<1	<1
Aluminum	ppm	ASTM D5185m >12	<b>2</b>	3	2
Lead	ppm	ASTM D5185m >17	<b>&lt;1</b>	<1	2
Copper	ppm	ASTM D5185m >70	<b>3</b>	1	2
Tin	ppm	ASTM D5185m >15	<b>&lt;1</b>	<1	1
Vanadium	ppm	ASTM D5185m	<b>0</b>	<1	<1
Cadmium	ppm	ASTM D5185m	<b>&lt;1</b>	<1	<1

### ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>49</b>	80	80
Barium	ppm	ASTM D5185m	<b>0</b>	<1	0
Molybdenum	ppm	ASTM D5185m	<b>57</b>	53	69
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	<1	0
Magnesium	ppm	ASTM D5185m	<b>580</b>	518	595
Calcium	ppm	ASTM D5185m	<b>1755</b>	1584	1785
Phosphorus	ppm	ASTM D5185m	<b>786</b>	726	878
Zinc	ppm	ASTM D5185m	<b>961</b>	860	955
Sulfur	ppm	ASTM D5185m	<b>2767</b>	2572	3068

### CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>4</b>	7	5
Sodium	ppm	ASTM D5185m >118	<b>2</b>	3	0
Potassium	ppm	ASTM D5185m >20	<b>1</b>	2	3
Water	%	ASTM D6304 >0.1	<b>NEG</b>	NEG	NEG

### INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	<b>0.1</b>	0.1	0.1
Nitration	Abs/cm	*ASTM D7624 >20	<b>7.6</b>	5.5	7.9
Sulfation	Abs/.1mm	*ASTM D7415 >30	<b>21.7</b>	20.7	21.0


### FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414 >25	<b>20.5</b>	17.8	19.8
Base Number (BN)	mg KOH/g	ASTM D2896	<b>8.79</b>	10.12	10.07



# OIL ANALYSIS REPORT


FT-IR (Direct Trend)

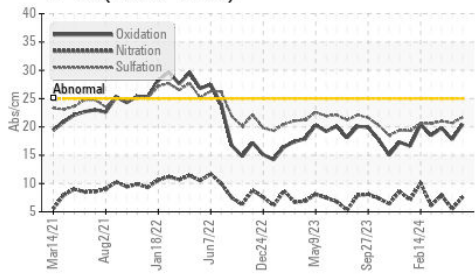


Water (KF)



Base Number

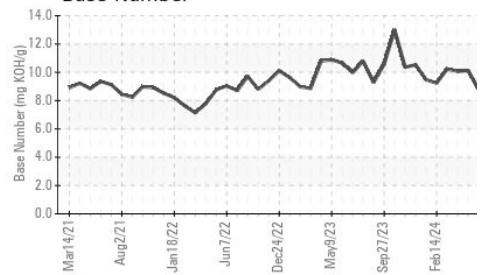

Water (KF)

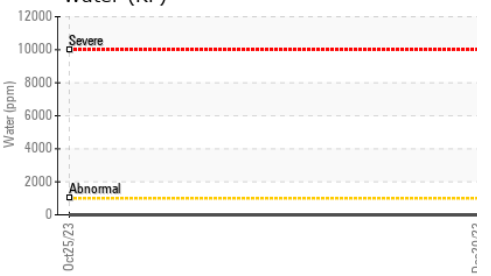


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	12.7	13.5	12.8

GRAPHS


Ferrous Alloys

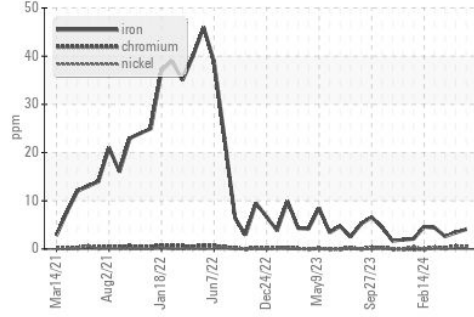


Non-ferrous Metals

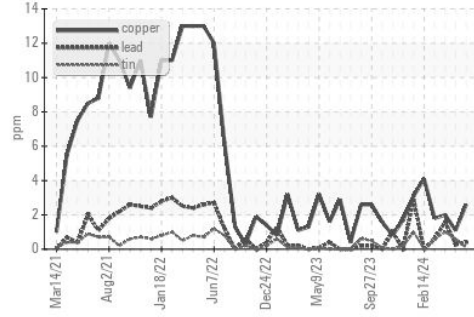

Viscosity @ 100°C

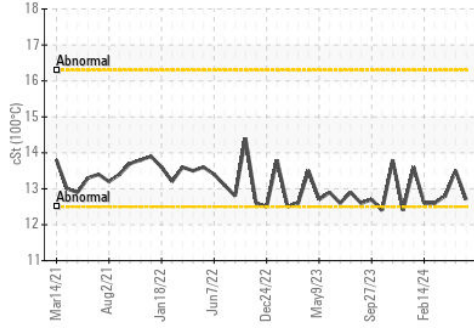

Base Number

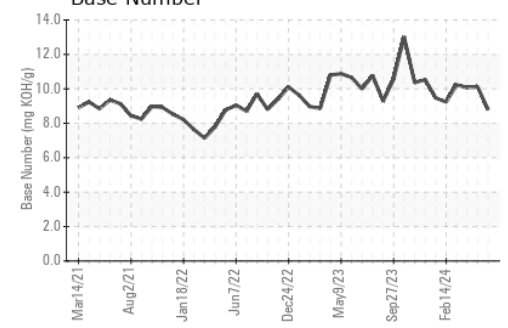

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0874668 **Received** : 14 Jun 2024  
**Lab Number** : 06210371 **Tested** : 18 Jun 2024  
**Unique Number** : 11083235 **Diagnosed** : 18 Jun 2024 - Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF )

**MARATHON PETROLEUM CO.**  
 101 12TH ST  
 CATLETTSBURG, KY  
 US 41169  
 Contact: CORY GUMBERT  
 cagumbert@marathonpetroleum.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)