




# FUEL REPORT

Sample Rating Trend

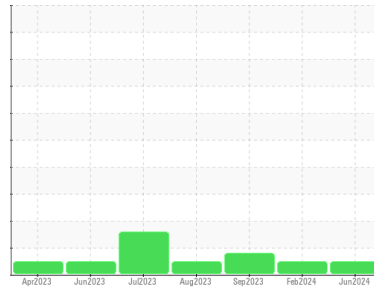

**NORMAL**



Machine Id  
**MELBOURNE S1**

Component  
**Diesel Fuel**

Fluid  
**No.2 DIESEL FUEL (ULTRALOW SULPHUR) (--- GAL)**

## DIAGNOSIS

### Recommendation

This is a baseline read-out on the submitted sample.

### Fuel Condition


Sulfur value derived by ASTM D5453 method for ULSD validation. Sulfur level is acceptable for ULSD specification.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WCDF4627</b>	WCDF4513	WCDF4469
Sample Date	Client Info			<b>11 Jun 2024</b>	28 Feb 2024	19 Sep 2023
Machine Age	mls	Client Info		<b>0</b>	0	0
Sample Status				<b>NORMAL</b>	NORMAL	ATTENTION

SULFUR CONTENT		method	limit/base	current	history1	history2
Sulfur (UVF)	ppm	ASTM D5453		<b>15</b>	11	40

CONTAMINANTS		method	limit/base	current	history1	history2
% Gasoline	%	*In-House	<0.50	---	---	0.0
% Biodiesel	%	*In-House	<20.0	---	---	0.0

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

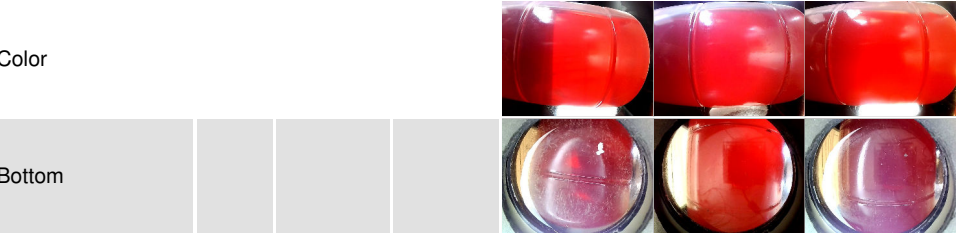



# FUEL REPORT

## GRAPHS



Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WCDF4627  
**Lab Number** : 06210645  
**Unique Number** : 11083509  
**Test Package** : TEST ( Additional Tests: Color-ASTM, GC-PercFuel, ICP, KF, KV40, PCO, PPM, WEAR)

**Received** : 14 Jun 2024  
**Tested** : 20 Jun 2024  
**Diagnosed** : 20 Jun 2024 - Doug Bogart

**TANK WIZARDS**  
 1511 MASTERS RD NW  
 PALM BAY, FL  
 US 32907

To discuss this sample report, contact Customer Service at 1-800-237-1369.

Contact: WENDALL STRODERD  
 wendall@tankwizards.com

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

T: (321)427-5149

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: (321)574-4131