

OIL ANALYSIS REPORT

Area BLACKJACK CREEK [200007683] 39WEA88442 - J-04 (S/N W-122502)

Wind Turbine Gearbox

Fluic FUCHS RENOLIN UNISYN CLP 320 (--- LTR)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

Wear

All component wear rates are normal.

Contamination

Moderate concentration of visible dirt/debris present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

)			Jan2023	Apr2U24		
SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		NX015719	NX011501	
Sample Date		Client Info		15 Apr 2024	23 Jan 2023	
Machine Age	hrs	Client Info		0	2276	
Oil Age	hrs	Client Info		0	0	
Oil Changed		Client Info		N/A	N/A	
Sample Status				ABNORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184	>40	16	12	
Iron	ppm	ASTM D5185m	>55	40	19	
Chromium	ppm	ASTM D5185m	>2	<1	0	
Nickel	ppm	ASTM D5185m	>2	<1	0	
Titanium	ppm	ASTM D5185m	>10	<1	0	
Silver	ppm	ASTM D5185m		0	0	
Aluminum	ppm	ASTM D5185m	>15	2	0	
Lead	ppm	ASTM D5185m	>3	2	0	
Copper	ppm	ASTM D5185m	>7	_ <1	0	
Tin	ppm	ASTM D5185m	>3	0	0	
Vanadium		ASTM D5185m	20	0	0	
Cadmium	ppm	ASTM D5185m		0	0	
	ppm		11 11 11			
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		6	4	
Barium	ppm	ASTM D5185m		<1	0	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		1	<1	
Magnesium	ppm	ASTM D5185m		<1	0	
Calcium	ppm	ASTM D5185m		15	16	
Phosphorus	ppm	ASTM D5185m		256	204	
Zinc	ppm	ASTM D5185m		15	0	
Sulfur	ppm	ASTM D5185m		5422	5155	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>35	11	7	
Sodium	ppm	ASTM D5185m		4	1	
Potassium	ppm	ASTM D5185m	>20	2	0	
Water	%	ASTM D6304	>0.02	0.002	0.008	
ppm Water	ppm	ASTM D6304	>200	23	86.7	
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647			166621	
Particles >6µm		ASTM D7647	>320		4 4639	
Particles >14µm		ASTM D7647	>40		156	
Particles >21µm		ASTM D7647	>10		11	
Particles >38μm		ASTM D7647	>3		2	
Particles >71µm		ASTM D7647			1	
Oil Cleanliness		ISO 4406 (c)	>/15/12		▲ 25/23/14	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.6	0.39 Contact/Leastic	0.37 DEVINTUNE	

Report Id: NORDEX [WUSCAR] 06210766 (Generated: 06/22/2024 22:02:15) Rev: 1

0.39Contact/Location: DEVIN LINEHAN - NORDEX


Page 1 of 2

Sample Rating Trend





OIL ANALYSIS REPORT

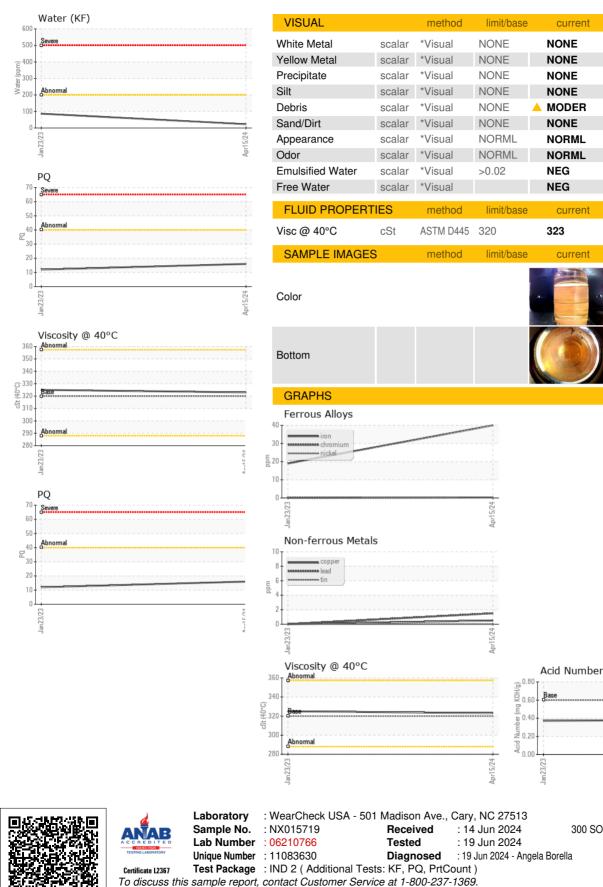

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

300 SOUTH WACKER DRIVE, SUITE 1500 CHICAGO, IL US 60606 Contact: DEVIN LINEHAN DLinehan@nordex-online.com T: (312)386-4124 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) F: (312)386-7102

NORDEX USA - Chicago

Report Id: NORDEX [WUSCAR] 06210766 (Generated: 06/22/2024 22:02:15) Rev: 1

Contact/Location: DEVIN LINEHAN - NORDEX

history1

NONE

NONE

NONE

NONE

LIGHT

NONE

NORML

NORML

history

history1

NEG

NEG

325

history2

history

history2

no image

no image