




OIL ANALYSIS REPORT

Sample Rating Trend

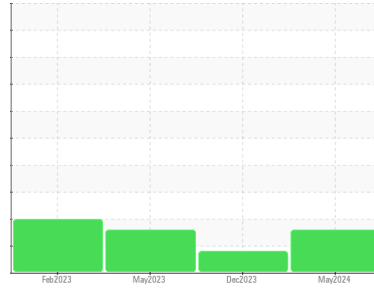

ISO



Area
BLACKJACK CREEK [200007683]
 Machine Id
24WEA88444 - E-04 (S/N W-122681)
 Component
Wind Turbine Gearbox
 Fluid
FUCHS RENOLIN UNISYN CLP 320 (--- LTR)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	NX015627	NX015712	NX011558
Sample Date	Client Info	30 May 2024	06 Dec 2023	08 May 2023
Machine Age	hrs	Client Info	0	101607
Oil Age	hrs	Client Info	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS

method	limit/base	current	history1	history2		
PQ	ASTM D8184	>40	16	18	16	
Iron	ppm	ASTM D5185m	>55	48	41	31
Chromium	ppm	ASTM D5185m	>2	<1	0	0
Nickel	ppm	ASTM D5185m	>2	<1	0	0
Titanium	ppm	ASTM D5185m	>10	<1	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>15	2	0	0
Lead	ppm	ASTM D5185m	>3	3	0	<1
Copper	ppm	ASTM D5185m	>7	<1	<1	<1
Tin	ppm	ASTM D5185m	>3	0	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0

ADDITIVES

method	limit/base	current	history1	history2		
Boron	ppm	ASTM D5185m		3	2	2
Barium	ppm	ASTM D5185m		<1	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		1	<1	<1
Magnesium	ppm	ASTM D5185m		<1	0	<1
Calcium	ppm	ASTM D5185m		15	9	20
Phosphorus	ppm	ASTM D5185m		212	180	213
Zinc	ppm	ASTM D5185m		17	0	9
Sulfur	ppm	ASTM D5185m		4621	4909	5211

CONTAMINANTS

method	limit/base	current	history1	history2		
Silicon	ppm	ASTM D5185m	>35	16	9	12
Sodium	ppm	ASTM D5185m		3	2	1
Potassium	ppm	ASTM D5185m	>20	2	<1	1
Water	%	ASTM D6304	>0.02	0.001	0.005	0.005
ppm Water	ppm	ASTM D6304	>200	6	57	57.2

FLUID CLEANLINESS






method	limit/base	current	history1	history2	
Particles >4µm	ASTM D7647		15373	122308	52087
Particles >6µm	ASTM D7647	>320	5853	31095	14734
Particles >14µm	ASTM D7647	>40	180	16	1806
Particles >21µm	ASTM D7647	>10	18	2	456
Particles >38µm	ASTM D7647	>3	0	0	3
Particles >71µm	ASTM D7647	>3	0	0	0
Oil Cleanliness	ISO 4406 (c)	>--/15/12	21/20/15	24/22/11	23/21/18

FLUID DEGRADATION

method	limit/base	current	history1	history2		
Acid Number (AN)	mg KOH/g	ASTM D8045	0.6	0.36	0.76	0.27




OIL ANALYSIS REPORT

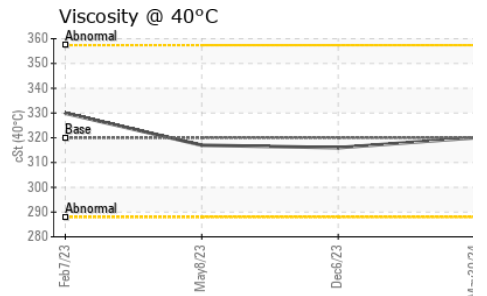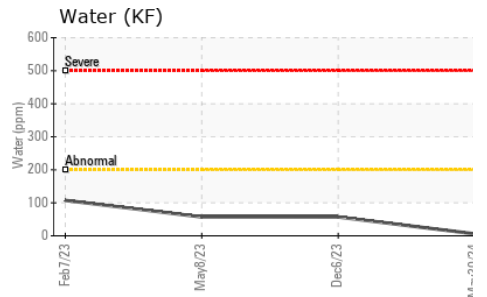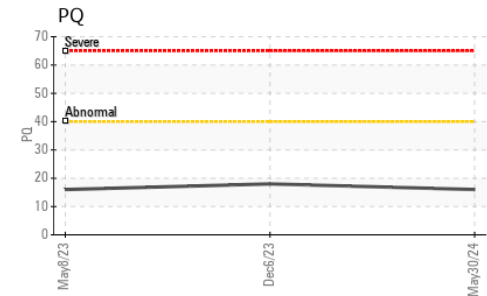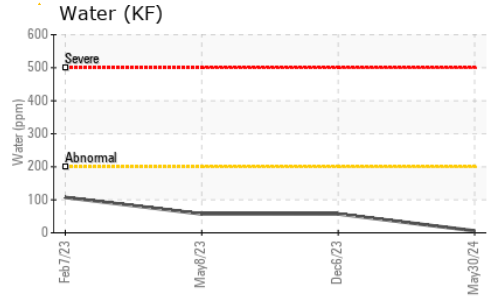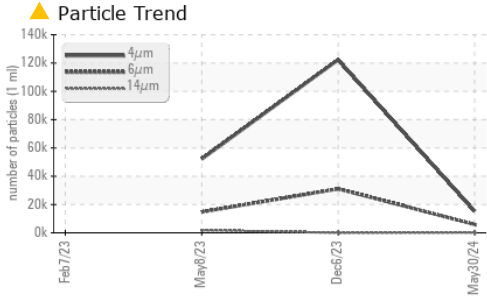






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	LIGHT	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.02	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	320	320	316

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

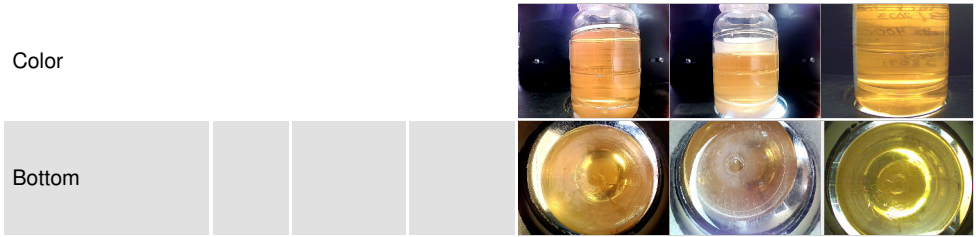

GRAPHS

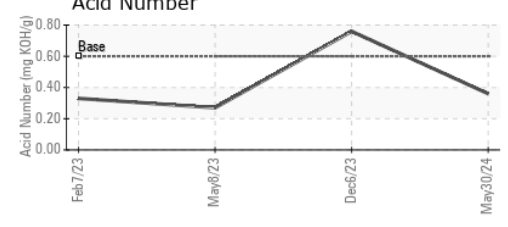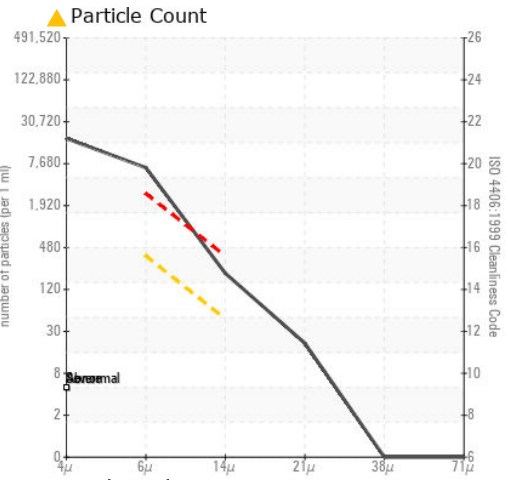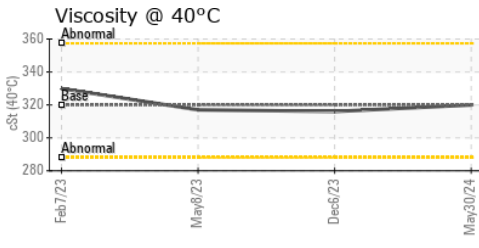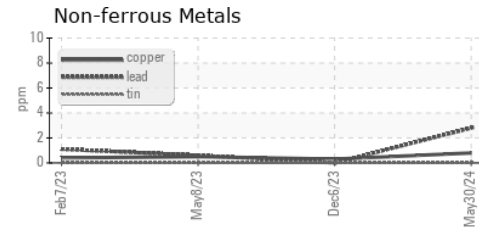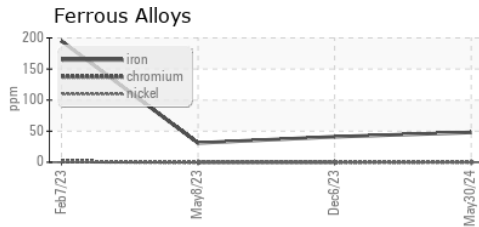

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : NX015627 **Received** : 14 Jun 2024
Lab Number : **06210767** **Tested** : 18 Jun 2024
Unique Number : 11083631 **Diagnosed** : 18 Jun 2024 - Angela Borella
Test Package : IND 2 (Additional Tests: KF, PQ, PrtCount)

NORDEX USA - Chicago
 300 SOUTH WACKER DRIVE, SUITE 1500
 CHICAGO, IL
 US 60606
 Contact: DEVIN LINEHAN
 DLinehan@nordex-online.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)