

OIL ANALYSIS REPORT

SAMPLE INCODMATION



Machine Id

9435490 (S/N 1041)

Component Compressor Fluid KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

The filter change at the time of sampling has been noted. We recommend an early resample in 500 hours to monitor this condition.

Wear

All component wear rates are normal.

Contamination

There is a light concentration of water present in the oil. Excessive free water present. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC130687		
Sample Date		Client Info		12 Jun 2024		
Machine Age	hrs	Client Info		3407		
Oil Age	hrs	Client Info		3407		
Oil Changed		Client Info		Not Changd		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	3		
Chromium	ppm	ASTM D5185m	>10	<1		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	<1		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	22		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm		>50	<1		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	<1		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	90	<1		
Calcium	ppm	ASTM D5185m	2	0		
Phosphorus	ppm	ASTM D5185m		57		
Zinc	ppm	ASTM D5185m		3		
CONTAMINANTS	6	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		<1		
Potassium	ppm	ASTM D5185m	>20	7		
Water	%	ASTM D6304	>0.05	A 0.074		
ppm Water	ppm	ASTM D6304	>500	A 740		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		600		
Particles >6µm		ASTM D7647	>1300	327		
Particles >14µm		ASTM D7647	>80	56		
Particles >21µm		ASTM D7647	>20	19		
Particles >38µm		ASTM D7647	>4	3		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	16/16/13		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.32		




Water (KF)

Nater

OIL ANALYSIS REPORT

1200		VISUAL	
1000	o Severe	White Metal	scalar
- 800		Yellow Metal	scalar
udd) 600		Precipitate	scalar
ate		Silt	scalar
400		Debris	scalar
200	0 - Abnormal	Sand/Dirt	scalar
	044		scalar
	Jun12/24	Appearance	
		Odor	scalar
	Particle Trend	Emulsified Water	scalar
1	4/m	Free Water	scalar
Ē	κ	FLUID PROPERT	IES
		Visc @ 40°C	cSt
number of particles (1 ml)	k -		COL
o uper o	k -	SAMPLE IMAGES	6
12 O	k -		
0			
	Jun 12/24	Color	
	ц, , , , , , , , , , , , , , , , , , ,		
	Acid Number		
0.5		Bottom	
<u></u> ©0.4	0 - Base	DOLLOITI	
4 KOF			
Acid Number (mg KOH/g) 7.0 KOH/g) 7.0 KOH/g) 7.0 KOH/g)		GRAPHS	
Uny 0.2	0	Ferrous Alloys	
Pciq Acid	0	10	
0.0		8 - iron chromium	
	Jun 12/24	e 6 nickel	
	Jun -		
	Viscosity @ 40°C	2	
5		74 Lo	
5		Jun 1 2/2 4	
4		Non-ferrous Metals	5
cSt (40°C)	6 - Base	¹⁰ T	
		8 - copper	
4	Abnormal		
4	UT :	ā 4	
3	<u>t</u>	2	
	/2/2 mul/ 2/2 mul/ 2/	5 ⁴	
		Jun 12/24	
1	Particle Trend	→ Viscosity @ 40°C	
_1	k =6μm	55 T	
Е С1	k+ 14μm	50 Abnormal	
number of particles (1 ml)	k	De Base	
of pe	k -	C2 45 - V V V Abnormal	
umbei	k -	40 - Abnormal	
U	K -	35	
0		Jun 12/24	
	Jun 12/24	nul	
	¬		

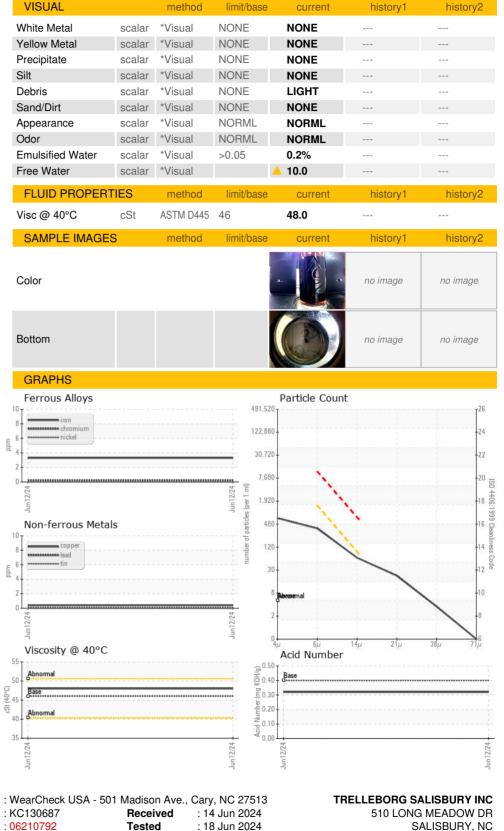



SALISBURY, NC : 18 Jun 2024 - Angela Borella US 28147 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

: KC130687

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Diagnosed

Report Id: TRESALNC [WUSCAR] 06210792 (Generated: 06/22/2024 03:37:58) Rev: 1

Certificate 12367

Laboratory

Sample No.

Lab Number : 06210792

Unique Number : 11083656

Test Package : IND 2

Contact/Location: Service Manager - TRESALNC

T:

F: