

OIL ANALYSIS REPORT

Sample Rating Trend



Area **[73450027] 7006617 (S/N 2093)** Component Compressor

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

KAESER SIGMA (OEM) M-460 (--- GAL)

Wear

Fluid

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.


Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA018414		
Sample Date		Client Info		11 Jun 2024		
Machine Age	hrs	Client Info		1395		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		Changed		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1		
Chromium	ppm	ASTM D5185m	>10	<1		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	<1		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	2		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	2		
Tin	ppm		>10	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	4		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	100	57		
Calcium	ppm	ASTM D5185m	0	0		
Phosphorus	ppm	ASTM D5185m	0	14		
Zinc	ppm	ASTM D5185m	0	12		
Sulfur	ppm	ASTM D5185m	23500	21744		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	2		
Sodium	ppm	ASTM D5185m		6		
Potassium	ppm	ASTM D5185m	>20	1		
Water	%	ASTM D6304	>0.05	0.020		
ppm Water	ppm	ASTM D6304	>500	206		
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		25669		
Particles >6µm		ASTM D7647	>1300	<u> </u>		
Particles >14µm		ASTM D7647	>80	<u> </u>		
Particles >21µm		ASTM D7647	>20	18		
Particles >38µm		ASTM D7647	>4	1		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	A 22/21/15		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.37		

Contact/Location: GABRIEL COLINDRES - PARMORKCP Page 1 of 2

KAESER COMPRESSORS Built for a lifetime."





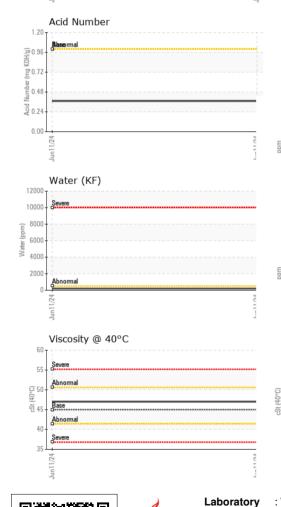

OIL ANALYSIS REPORT

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE		
Yellow Metal	scalar	*Visual	NONE	NONE		
Precipitate	scalar	*Visual	NONE	NONE		
Silt	scalar	*Visual	NONE	NONE		
Debris	scalar	*Visual	NONE	LIGHT		
Sand/Dirt	scalar	*Visual	NONE	NONE		
Appearance	scalar	*Visual	NORML	NORML		
Ddor	scalar	*Visual	NORML	NORML		
Emulsified Water	scalar	*Visual	>0.05	NEG		
Free Water	scalar	*Visual		NEG		
FLUID PROPERTI	ES	method	limit/base	current	history1	history2
/isc @ 40°C	cSt	ASTM D445	45	47.0		
SAMPLE IMAGES		method	limit/base	current	history1	history2
					,	,
Color					no image	no image
Bottom					no image	no image
					0	0
GRAPHS						
				Particle Coun	F	
Ferrous Alloys			491,52		L	T ²⁶
iron			122,88	0		24
nickel			122,00	-		-24
			30,72	0		-22
			7,68			-20
24						720
Jun 11/24			481 1721	•- \ \		-18
Non-ferrous Metals			ິ :12 48	0		16
			of par	Č N	\mathbf{X}	10
copper				0-	1	-14
tin			2 3	0-		-12
				⁸ Beresemal		-10
24			24	2 -		-8
Jun11/24			Jun 11/24			
¬ Viscosity @ 40°C			7	0 4μ 6μ	14µ 21µ	38µ 71µ
			-1.2	Acid Number		
Severe			(B/HO 9	Basermal		
Abnormal			¥ 0.3	2-		
Base			40.1 40.1 40.1 40.1 40.1 40.1 40.1 40.1	8		
Abnormal			N p 0.2	4		
			0.0	0		
11/24			Jun11/24	Jun 11/24		Jun 11/24
Jun 11,			Jun	Jun		unf
	Recei Teste Diagn	ved : 14 d : 18 iosed : 18	, NC 27513 Jun 2024 Jun 2024 Jun 2024 - Ang	ela Borella		SUTTER BLVD IGAN HILL, CA US 95037
1083660 ND 2 (Additional Test Intact Customer Servic	Diagn s: KF, P ce at 1-8	nosed : 18 rtCount)	Jun 2024 - Ang 9.			US 950 L COLINDR

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: PARMORKCP [WUSCAR] 06210796 (Generated: 06/19/2024 08:53:32) Rev: 1

Certificate L2367

Sample No.

Lab Number Unique Number Test Package :

Contact/Location: GABRIEL COLINDRES - PARMORKCP

Т:

F: