

OIL ANALYSIS REPORT

Sample Rating Trend ISO

Machine Id

KAESER ASD 25 3426335 (S/N 1471)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil. Moderate concentration of visible dirt/debris present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in

				Apr2024		
SAMPLE INFORM	ΙΔΤΙΩΝ	method	limit/base	current	history1	history2
	IATION		IIIIII/Dase			
Sample Number		Client Info		KC06210802		
Sample Date	la usa	Client Info		16 Apr 2024		
Machine Age	hrs	Client Info		19426		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A ABNORMAL		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	9		
Chromium	ppm	ASTM D5185m	>10	<1		
Nickel	ppm	ASTM D5185m	>3	<1		
Titanium	ppm	ASTM D5185m	>3	<1		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	2		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	14		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	<1		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	90	5		
Calcium	ppm	ASTM D5185m	2	0		
Phosphorus	ppm	ASTM D5185m		5		
Zinc	ppm	ASTM D5185m		80		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m	720	0		
Potassium	ppm	ASTM D5185m	>20	1		
Water	%	ASTM D6304		0.005		
ppm Water	ppm	ASTM D6304		51		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		196038		
Particles >6μm		ASTM D7647	>1300	▲ 84252		
Particles >14µm		ASTM D7647	>80	<u>△</u> 2885		
Particles >21µm		ASTM D7647		△ 320		
Particles >38µm		ASTM D7647	>4	7		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	△ 25/24/19		
FLUID DEGRADA	TION	method	limit/base		history1	history2
					HISTORY	HISTORYZ
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.31		



OIL ANALYSIS REPORT

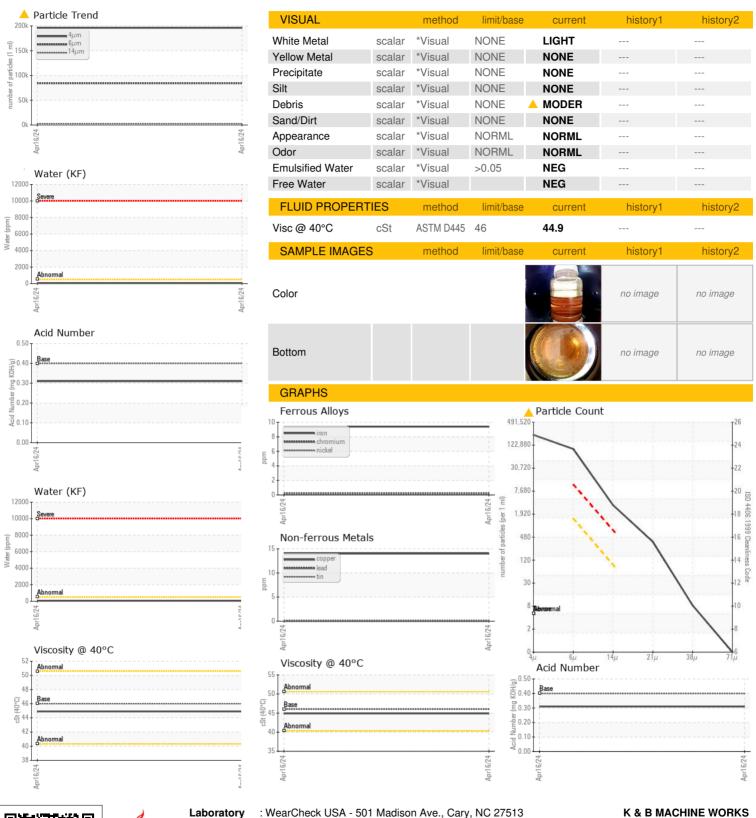





Certificate 12367

Laboratory Sample No.

Lab Number : 06210802 Unique Number : 11083666

: KC06210802

Test Package : IND 2

Received : 14 Jun 2024 **Tested** : 18 Jun 2024

: 18 Jun 2024 - Angela Borella Diagnosed

2186 GRAND CAILLOU RD HOUMA, LA US 70363

Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.

 st - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: