

## **OIL ANALYSIS REPORT**

Sample Rating Trend

### NORMAL

#### Machine Id

# FRICK SC-2 (S/N 1225TFMPTHGC03)

Component Refrigeration Compressor

USPI 1009-68 SC (--- GAL)

#### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


SAMPLE INFORM	ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USP0013313	USP0004727	USP0004148
Sample Date		Client Info		07 Jun 2024	22 Dec 2023	07 Dec 2023
Machine Age	hrs	Client Info		11448	7774	7436
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	2	1	<1
Chromium	ppm	ASTM D5185m	>2	<1	0	0
Nickel	ppm	ASTM D5185m		0	0	0
Titanium	ppm	ASTM D5185m		<1	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>3	0	0	0
Lead	ppm	ASTM D5185m	>2	0	0	0
Copper	ppm	ASTM D5185m	>8	<1	0	<1
Tin	ppm	ASTM D5185m	>4	0	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		<1	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	<1	<1
Magnesium	ppm	ASTM D5185m		<1	0	0
Calcium	ppm	ASTM D5185m		0	0	<1
Phosphorus	ppm	ASTM D5185m		0	0	<1
Zinc	ppm	ASTM D5185m		<1	0	0
Sulfur	ppm	ASTM D5185m	50	0	0	8
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	1	<1	<1
Sodium	ppm	ASTM D5185m		0	2	2
Potassium	ppm	ASTM D5185m	>20	<1	2	0
Water	%	ASTM D6304		0.003	0.003	0.003
ppm Water	ppm	ASTM D6304	>100	33	36	36
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		2433	1148	330589
Particles >6µm		ASTM D7647	>2500	515	359	190460
Particles >14µm		ASTM D7647	>320	9	20	<b>A</b> 3299
Particles >21µm		ASTM D7647	>80	1	4	<b>1</b> 40
Particles >38µm		ASTM D7647	>20	0	0	1
Particles >71µm		ASTM D7647	>4	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/18/15	18/16/10	17/16/11	▲ 26/25/19
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.005	0.014	0.013	0.014


Contact/Location: SERVICE MANAGER ? - NORLEMWAR Page 1 of 2




## **OIL ANALYSIS REPORT**





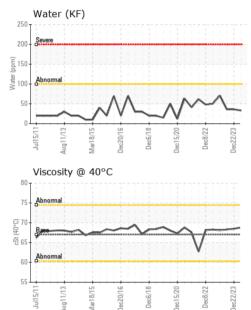






VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPER	TIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	67	68.8	68.5	68.3
SAMPLE IMAGES method		method	limit/base	current	history1	history2
Color				A.	•	•
Bottom					(63)	



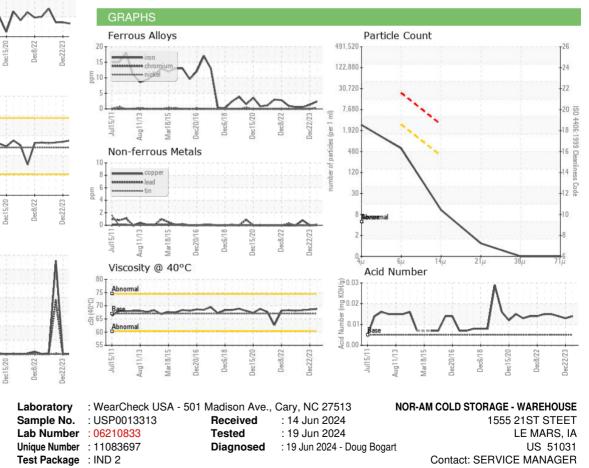

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (712)548-4433 F: (712)548-4663

Report Id: NORLEMWAR [WUSCAR] 06210833 (Generated: 06/22/2024 23:40:00) Rev: 1

Certificate 12367

Contact/Location: SERVICE MANAGER ? - NORLEMWAR

Page 2 of 2