



COOLANT REPORT

Sample Rating Trend



NORMAL

Area

BLACKJACK CREEK

Machine Id

01WEA88421 - A-01 (S/N W-121854)

Component

Coolant

Fluid

{not provided} (--- LTR)

DIAGNOSIS

Recommendation

The fluid is suitable for further service.

Corrosion

All metal levels are normal indicating no corrosion in the cooling system.

Contaminants

There is no indication of any contamination in the coolant.

Coolant Condition

Glycol and nitrite levels are acceptable. The pH level of this fluid is within the acceptable limits.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		NX015629	---	---
Sample Date	Client Info		22 May 2024	---	---
Machine Age	hrs	Client Info	19661202	---	---
Oil Age	hrs	Client Info	0	---	---
Oil Changed		Client Info	N/A	---	---
Sample Status			NORMAL	---	---

PHYSICAL TEST RESULTS

	method	limit/base	current	history1	history2
Glycol Type	FT-IR		---	---	---
Specific Gravity	*ASTM D1298		1.060	---	---
pH	Scale 0-14	ASTM D1287	7.91	---	---
Nitrites	ppm	AP-053:2009	300	---	---
Reserve Alkalinity	Scale 0-20	*ASTM D1121	---	---	---
Percentage Glycol	%	ASTM D3321	44.5	---	---
Freezing Point	°F	ASTM D3321	-21	---	---
Total Dissolved Solids			258.5	---	---
Carboxylate			n/a	---	---

CORROSION INHIBITORS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D6130	1	---	---
Phosphorus	ppm	ASTM D6130	0	---	---
Boron	ppm	ASTM D6130	0	---	---
Molybdenum	ppm	ASTM D6130	175	---	---

CORROSION

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D6130	>15	0	---
Aluminum	ppm	ASTM D6130	>10	2	---
Copper	ppm	ASTM D6130	>10	<1	---
Lead	ppm	ASTM D6130	>10	0	---
Tin	ppm	ASTM D6130	>10	0	---
Zinc	ppm	ASTM D6130		7	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Chlorine	ppm	ASTM D6130		5	---

CARRIER SALTS


	method	limit/base	current	history1	history2
Sodium	ppm	ASTM D6130		3449	---
Potassium	ppm	ASTM D6130		397	---



SCALE POTENTIAL

	method	limit/base	current	history1	history2
Calcium	ppm	ASTM D6130		1	---
Magnesium	ppm	ASTM D6130		1	---






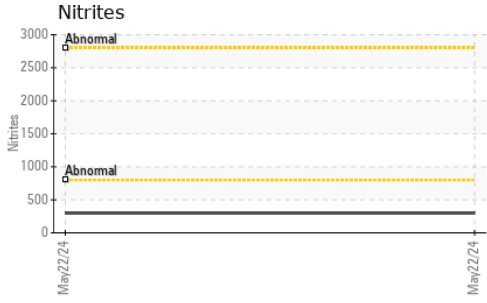


COOLANT REPORT



VISUAL	method	limit/base	current	history1	history2
Coolant Color	*Visual		Yllow	---	---
Coolant Appearance	*Visual	Clear	normal	---	---
Color				no image	no image
Bottom				no image	no image

GRAPHS

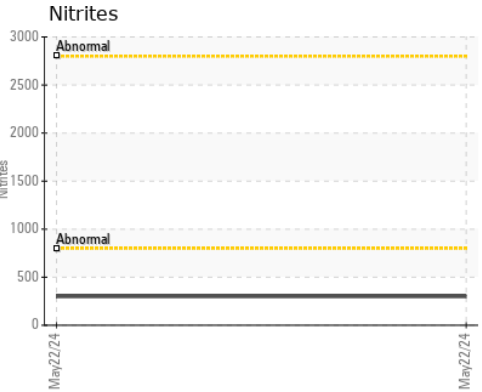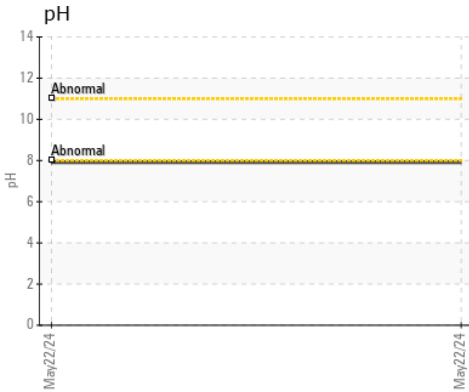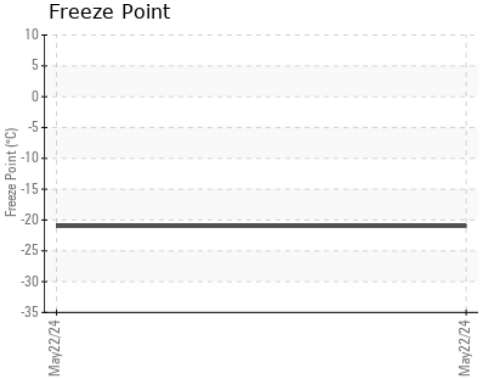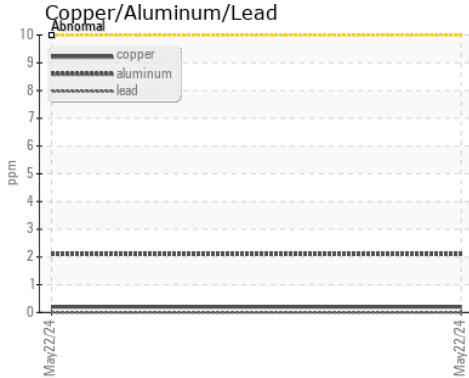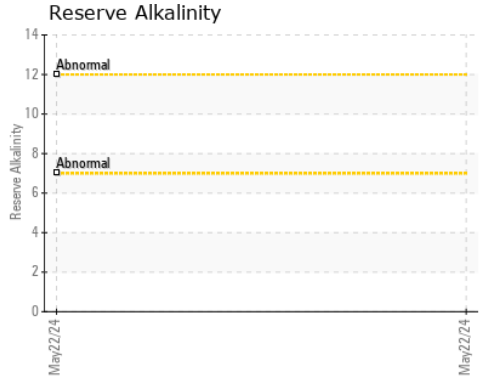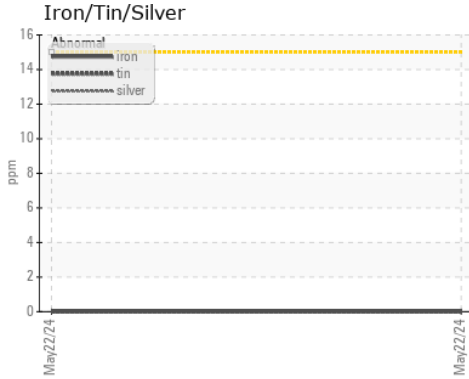

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : NX015629
Lab Number : **06211190**
Unique Number : 11084054
Test Package : COOL- (Additional Tests: GlycolType, ICP)

Received : 14 Jun 2024
Tested : 20 Jun 2024
Diagnosed : 20 Jun 2024 - Jonathan Hester

NORDEX USA - Chicago
 300 SOUTH WACKER DRIVE, SUITE 1500
 CHICAGO, IL
 US 60606

Contact: DEVIN LINEHAN
 DLinehan@nordex-online.com

T: (312)386-4124
 F: (312)386-7102

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)