



OIL ANALYSIS REPORT

Area

Co-Gen - Utilities

Machine Id

45-1130 - MAIN GEAR/PINION - PRIMARY CLARIFIER


Component

Bull Gear

Fluid

SHELL OMALA S4 GXV 320 (--- GAL)

Sample Rating Trend

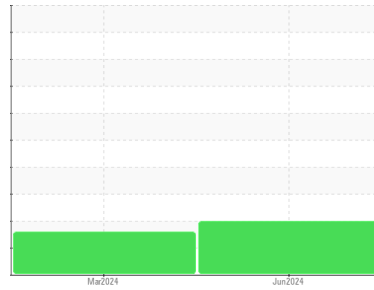

WEAR



DIAGNOSIS

Recommendation

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor.

Wear

An increase in the iron level is noted.

Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	PE0004554	PE0001549	---
Sample Date	Client Info	11 Jun 2024	25 Mar 2024	---
Machine Age	hrs	0	0	---
Oil Age	hrs	0	0	---
Oil Changed	Client Info	N/A	N/A	---
Sample Status		ABNORMAL	ABNORMAL	---

CONTAMINATION

method	limit/base	current	history1	history2
Water	WC Method	NEG	NEG	---

WEAR METALS

method	limit/base	current	history1	history2
PQ	ASTM D8184	22	14	---
Iron	ppm	119	49	---
Chromium	ppm	2	<1	---
Nickel	ppm	<1	0	---
Titanium	ppm	<1	<1	---
Silver	ppm	0	<1	---
Aluminum	ppm	2	2	---
Lead	ppm	<1	1	---
Copper	ppm	<1	<1	---
Tin	ppm	<1	<1	---
Vanadium	ppm	<1	<1	---
Cadmium	ppm	<1	0	---

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm	10	6	---
Barium	ppm	<1	<1	---
Molybdenum	ppm	<1	0	---
Manganese	ppm	1	<1	---
Magnesium	ppm	<1	<1	---
Calcium	ppm	0	9	---
Phosphorus	ppm	460	462	---
Zinc	ppm	3	3	---
Sulfur	ppm	3552	3054	---






CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm	17	19	---
Sodium	ppm	2	<1	---
Potassium	ppm	<1	1	---

FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	29122	68516	---
Particles >6µm	ASTM D7647	4984	10511	---
Particles >14µm	ASTM D7647	128	408	---
Particles >21µm	ASTM D7647	15	77	---
Particles >38µm	ASTM D7647	0	2	---
Particles >71µm	ASTM D7647	0	0	---
Oil Cleanliness	ISO 4406 (c)	22/19/14	23/21/16	---

OIL ANALYSIS REPORT

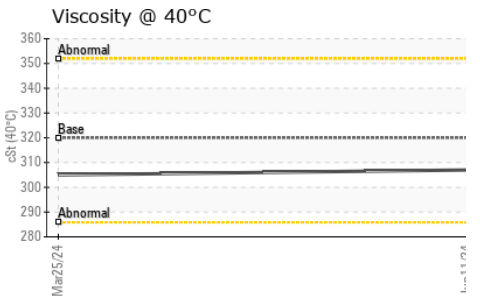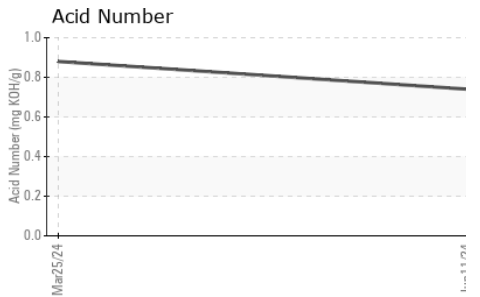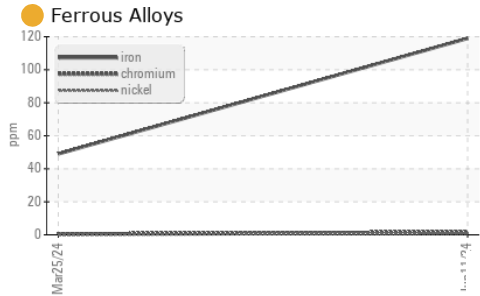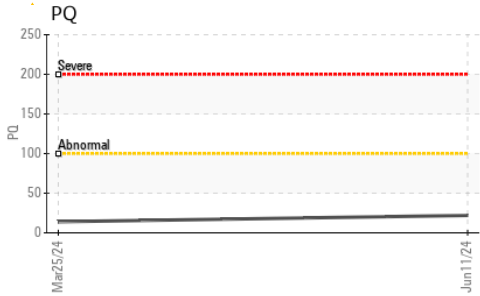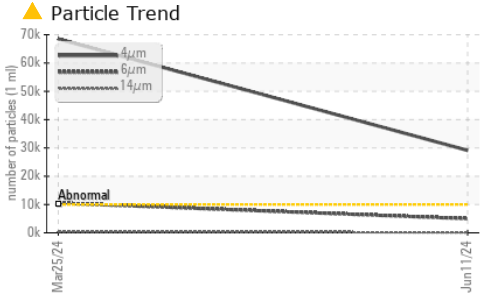





FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.74	0.88	---

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	▲ MODER	---
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.1	NEG	0.2%	---
Free Water	scalar	*Visual		NEG	NEG	---

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	320	307	305	---

SAMPLE IMAGES		method	limit/base	current	history1	history2
Color						no image
Bottom						no image

GRAPHS

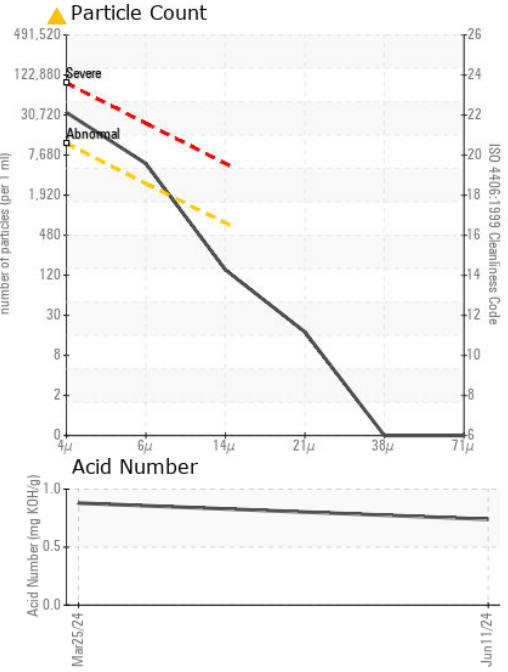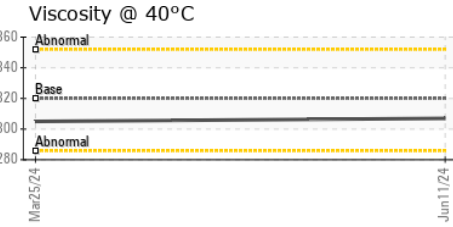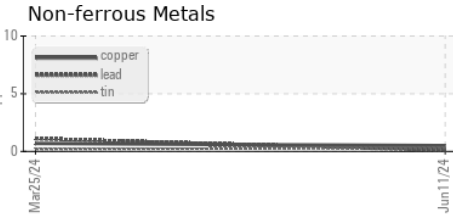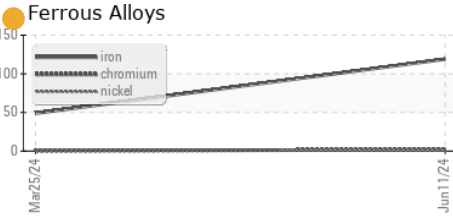

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : PE0004554 **Received** : 17 Jun 2024
Lab Number : **06211479** **Tested** : 18 Jun 2024
Unique Number : 11084343 **Diagnosed** : 18 Jun 2024 - Angela Borella
Test Package : PLANT (Additional Tests: ICP, KV40, PQ, PrtCount, SCREEN)

MCKINLEY PAPER COMPANY
 1902 MARINE DR
 PORT ANGELES, WA
 US 98363
 Contact: JOSHUA HALL
 joshua.hall@biopappel.com
 T: (360)457-4474
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)