



OIL ANALYSIS REPORT

Sample Rating Trend



WEAR

Machine Id
C3 EAST
 Component
Hydraulic System
 Fluid
 {not provided} (--- GAL)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

Wear

The copper level is abnormal. All other component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION	method	limit/base	current	history1	history2
Sample Number	Client Info		PH0001134	---	---
Sample Date	Client Info		16 Jun 2024	---	---
Machine Age	hrs	Client Info	0	---	---
Oil Age	hrs	Client Info	0	---	---
Oil Changed	Client Info		N/A	---	---
Sample Status			ABNORMAL	---	---

CONTAMINATION	method	limit/base	current	history1	history2
Water	WC Method	>0.05	NEG	---	---


WEAR METALS	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>20	2	---
Chromium	ppm	ASTM D5185m	>20	<1	---
Nickel	ppm	ASTM D5185m	>20	<1	---
Titanium	ppm	ASTM D5185m		<1	---
Silver	ppm	ASTM D5185m		0	---
Aluminum	ppm	ASTM D5185m	>20	2	---
Lead	ppm	ASTM D5185m	>20	<1	---
Copper	ppm	ASTM D5185m	>20	27	---
Tin	ppm	ASTM D5185m	>20	<1	---
Vanadium	ppm	ASTM D5185m		0	---
Cadmium	ppm	ASTM D5185m		<1	---

ADDITIVES	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		4	---
Barium	ppm	ASTM D5185m		0	---
Molybdenum	ppm	ASTM D5185m		4	---
Manganese	ppm	ASTM D5185m		<1	---
Magnesium	ppm	ASTM D5185m		18	---
Calcium	ppm	ASTM D5185m		166	---
Phosphorus	ppm	ASTM D5185m		358	---
Zinc	ppm	ASTM D5185m		472	---
Sulfur	ppm	ASTM D5185m		1009	---

CONTAMINANTS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	8	---
Sodium	ppm	ASTM D5185m		1	---
Potassium	ppm	ASTM D5185m	>20	<1	---






FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	28436	---	---
Particles >6µm	ASTM D7647	>2500	6845	---	---
Particles >14µm	ASTM D7647	>320	385	---	---
Particles >21µm	ASTM D7647	>80	72	---	---
Particles >38µm	ASTM D7647	>20	2	---	---
Particles >71µm	ASTM D7647	>4	0	---	---
Oil Cleanliness	ISO 4406 (c)	>20/18/15	22/20/16	---	---

FLUID DEGRADATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.44	---	---

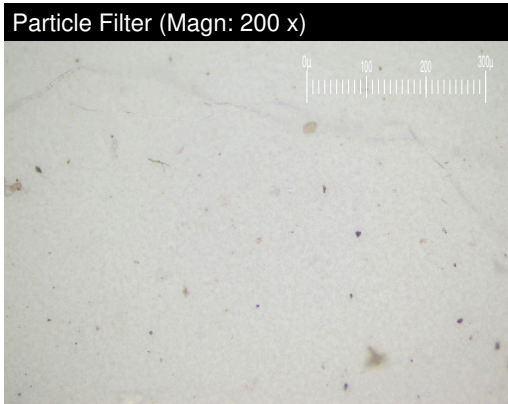



OIL ANALYSIS REPORT

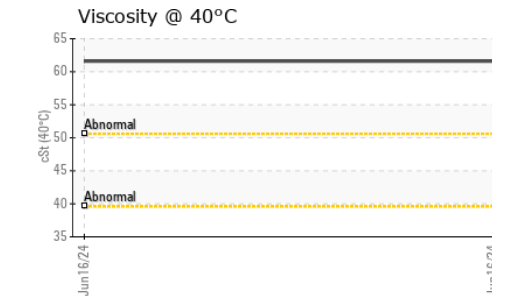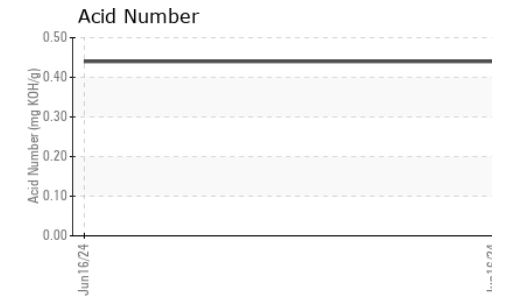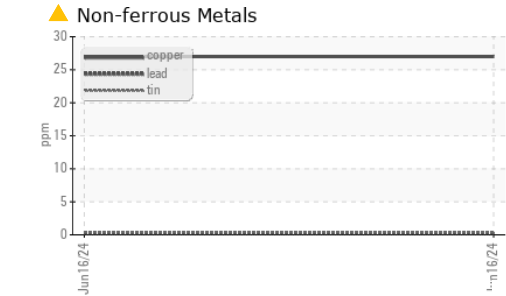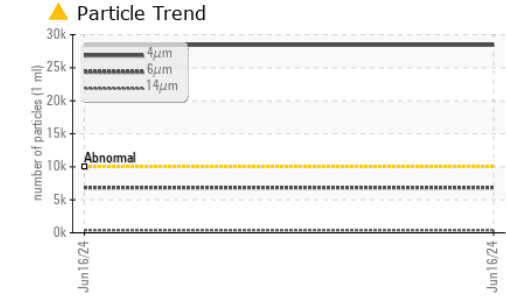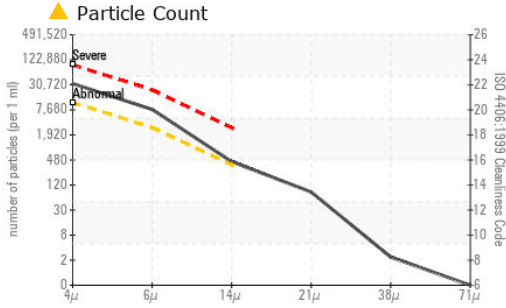






VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Precipitate	scalar	*Visual	NONE	NONE	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---	---
Free Water	scalar	*Visual		NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	61.6	---	---

SAMPLE IMAGES

	method	limit/base	current	history1	history2
Color					
Bottom					
PrtFilter					

GRAPHS

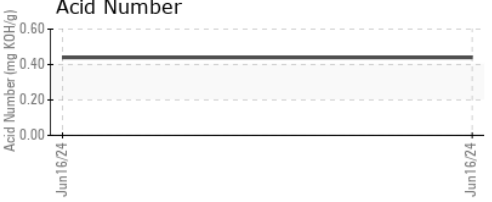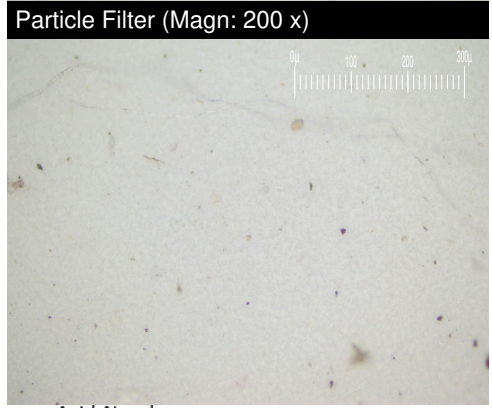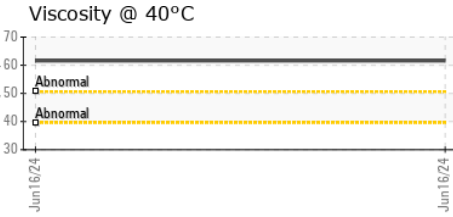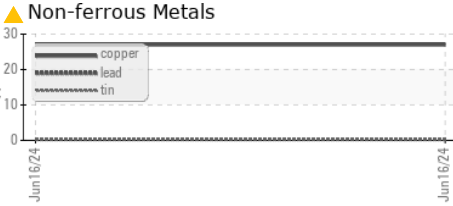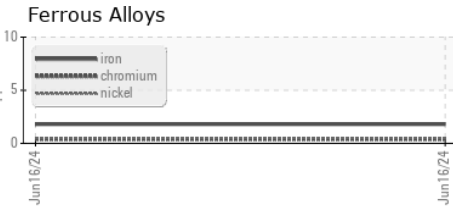

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : PH0001134 **Received** : 17 Jun 2024
Lab Number : 06211599 **Tested** : 19 Jun 2024
Unique Number : 11084463 **Diagnosed** : 19 Jun 2024 - Angela Borella
Test Package : PLANT (Additional Tests: PrtFilter)

PARKER HANNIFIN CORPORATION-OIL LAB
 501 MADISON AVENUE
 CARY, NC
 US 27513
 Contact: JAY GRONBACH
 jay.gronbach@parker.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)