




# OIL ANALYSIS REPORT

Sample Rating Trend

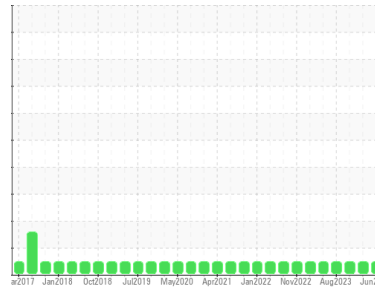

**NORMAL**



Machine Id  
**BUSCH CARNEB 41 VAC (S/N 4051531)**  
 Component  
**Pump**  
 Fluid  
**USPI VAC 100 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>USPM37747</b>	USPM30394	USPM31553
Sample Date	Client Info	<b>16 Jun 2024</b>	13 Mar 2024	03 Dec 2023
Machine Age	hrs	Client Info	<b>0</b>	0
Oil Age	hrs	Client Info	<b>0</b>	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>NORMAL</b>	NORMAL	NORMAL

## WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >90	<b>10</b>	8	9
Chromium	ppm	ASTM D5185m >5	<b>0</b>	<1	0
Nickel	ppm	ASTM D5185m >5	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m >3	<b>&lt;1</b>	<1	<1
Silver	ppm	ASTM D5185m >3	<b>0</b>	<1	0
Aluminum	ppm	ASTM D5185m >7	<b>&lt;1</b>	<1	1
Lead	ppm	ASTM D5185m >12	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >30	<b>&lt;1</b>	0	<1
Tin	ppm	ASTM D5185m >9	<b>0</b>	1	0
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	<1	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	<1	0

## ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m 0	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 0	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	<1	0
Magnesium	ppm	ASTM D5185m 0	<b>&lt;1</b>	0	0
Calcium	ppm	ASTM D5185m 0	<b>&lt;1</b>	0	<1
Phosphorus	ppm	ASTM D5185m 1800	<b>1861</b>	1701	1816
Zinc	ppm	ASTM D5185m 0	<b>1</b>	0	0
Sulfur	ppm	ASTM D5185m 0	<b>0</b>	0	0

## CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >60	<b>2</b>	2	2
Sodium	ppm	ASTM D5185m	<b>0</b>	<1	0
Potassium	ppm	ASTM D5185m >20	<b>1</b>	2	1
Water	%	ASTM D6304 >.1	<b>0.046</b>	0.021	0.030
ppm Water	ppm	ASTM D6304 >1000	<b>467</b>	213	304

## FLUID CLEANLINESS






method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	<b>291</b>	699	115
Particles >6µm	ASTM D7647 >2500	<b>92</b>	117	50
Particles >14µm	ASTM D7647 >320	<b>5</b>	9	7
Particles >21µm	ASTM D7647 >80	<b>1</b>	2	4
Particles >38µm	ASTM D7647 >20	<b>0</b>	0	2
Particles >71µm	ASTM D7647 >4	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c) >--/18/15	<b>15/14/10</b>	17/14/10	14/13/10

## FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.05	<b>0.26</b>	0.17	0.15




# OIL ANALYSIS REPORT

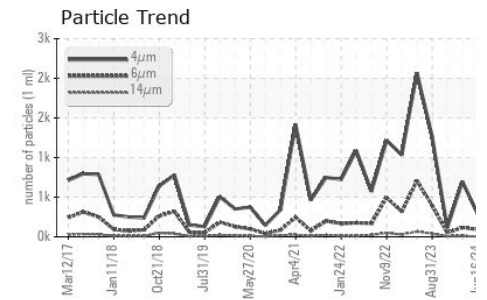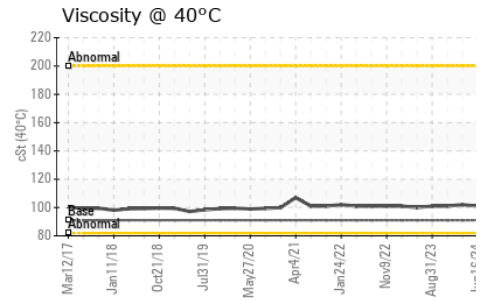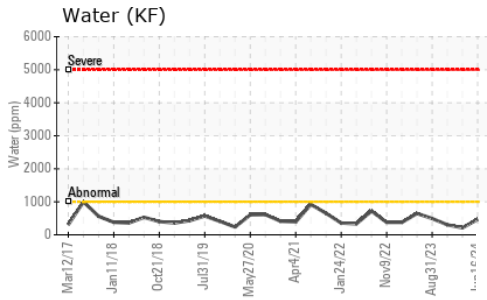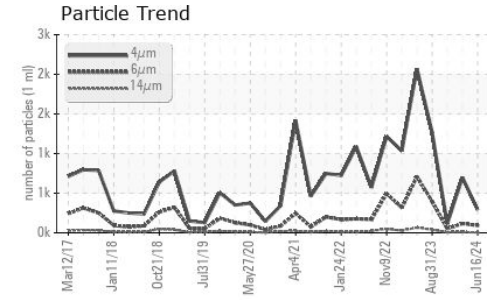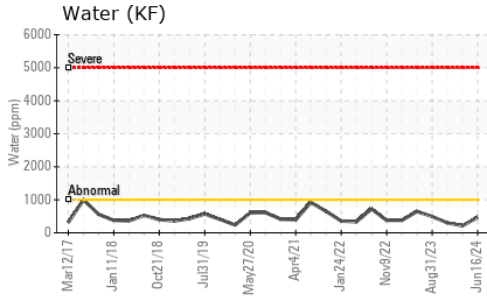






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 91	101	102	101

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

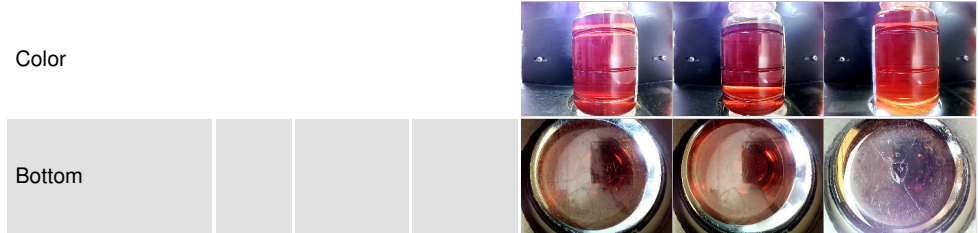

## GRAPHS

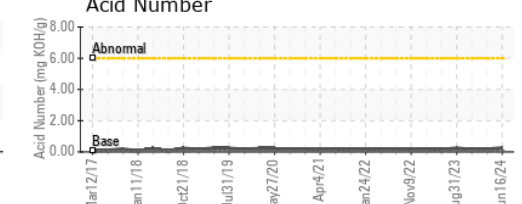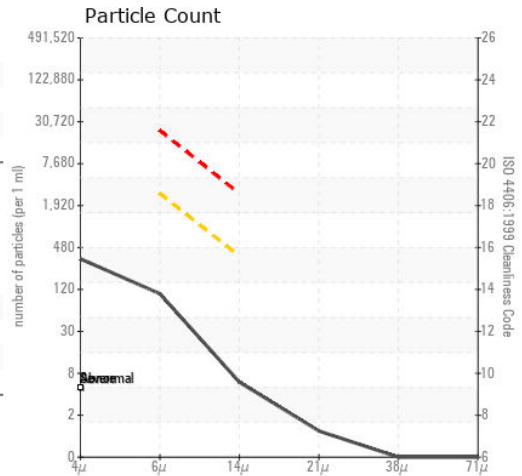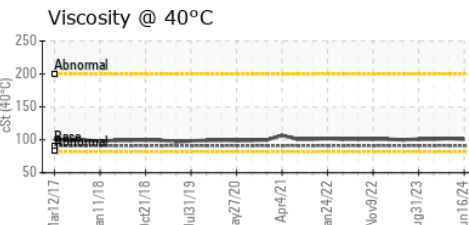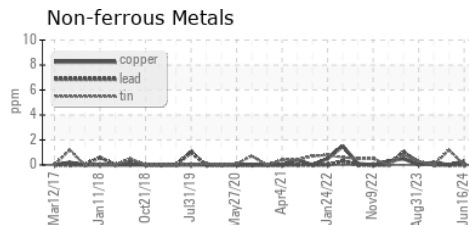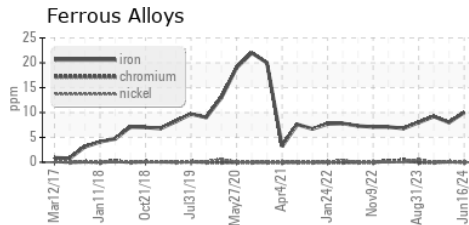

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
 Sample No. : USPM37747  
 Lab Number : 06211679  
 Unique Number : 11084543  
 Test Package : IND 2

Received : 17 Jun 2024  
 Tested : 18 Jun 2024  
 Diagnosed : 20 Jun 2024 - Doug Bogart

CARGILL FOODS

NEBRASKA CITY, NE  
 US

Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
 F: