


OIL ANALYSIS REPORT

Sample Rating Trend

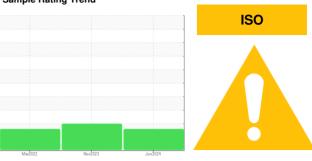

Machine Id

FRICK BLDG 3 CP-4

Component Refrigeration Compressor

Fluid IRP 717 (--- GAL)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

	Mar2022 Nov2023 Jun2024					
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USP0013265	USP249857	USP235343
Sample Date		Client Info		16 Jun 2024	28 Nov 2023	29 Mar 2022
Machine Age	hrs	Client Info		0	57488	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	1	2	5
Chromium	ppm	ASTM D5185m	>2	0	0	0
Nickel	ppm	ASTM D5185m		0	0	0
Titanium	ppm	ASTM D5185m		<1	0	0
Silver	ppm	ASTM D5185m	>2	0	0	<1
Aluminum	ppm	ASTM D5185m	>3	0	0	0
Lead	ppm	ASTM D5185m	>2	0	0	0
Copper	ppm	ASTM D5185m	>8	<1	0	<1
Tin	ppm	ASTM D5185m	>4	0	0	0
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		<1	<1	1
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	1
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	0	0
Magnesium	ppm	ASTM D5185m		0	0	0
Calcium	ppm	ASTM D5185m		0	0	0
Phosphorus	ppm	ASTM D5185m		1	<1	0
Zinc	ppm	ASTM D5185m		6	0	<1
Sulfur	ppm	ASTM D5185m		0	7	18
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m		<1	0	<1
Sodium	ppm	ASTM D5185m	>10	2	0	<1
Potassium	ppm	ASTM D5185m	>20	0	0	0
Water	%	ASTM D6304	>0.01	0.001	0.001	0.001
ppm Water	ppm	ASTM D6304	>100	15	10	11.1
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	△ 103905	▲ 139084	▲ 183447
Particles >6µm		ASTM D7647	>2500	▲ 34706	▲ 51593	▲ 49880
Particles >14µm		ASTM D7647	>320	<u> </u>	▲ 3063	▲ 1804
Particles >21μm		ASTM D7647	>80	56	▲ 627	▲ 275
Particles >38µm		ASTM D7647	>20	0	7	2
Particles >71μm		ASTM D7647	>4	0	1	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	△ 24/22/17	<u>4</u> 24/23/19	△ 25/23/18
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	mmubase	0.014	0.014	0.014
AGIG NUTTIDET (AIN)	iiig NO⊓/ÿ	70 I IVI D3/4		0.014	0.014	0.014



OIL ANALYSIS REPORT





Certificate 12367

Laboratory Sample No. Lab Number

: USP0013265 : 06211725 Unique Number : 11084589 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 17 Jun 2024

Tested : 18 Jun 2024 Diagnosed : 20 Jun 2024 - Doug Bogart

264 FARRELL RD SYRACUSE, NY

US 13209 Contact: ANDREW RAY

To discuss this sample report, contact Customer Service at 1-800-237-1369.

 st - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: ANDREW RAY - AMESYR

T:

F: