



# OIL ANALYSIS REPORT

Sample Rating Trend



**NORMAL**



Machine Id  
**TRANE CFCC ND CHILLER CIRC 2 (S/N U09C03749)**  
 Component  
**Refrigeration Compressor**  
 Fluid  
**TRANE 0048 (2 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC0801211</b>	---	---
Sample Date	Client Info			<b>13 May 2024</b>	---	---
Machine Age	hrs	Client Info		<b>41448</b>	---	---
Oil Age	hrs	Client Info		<b>0</b>	---	---
Oil Changed	Client Info			<b>Not Changed</b>	---	---
Sample Status				<b>NORMAL</b>	---	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	<b>4</b>	---	---
Chromium	ppm	ASTM D5185m	>2	<b>0</b>	---	---
Nickel	ppm	ASTM D5185m		<b>0</b>	---	---
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Silver	ppm	ASTM D5185m	>2	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m	>3	<b>0</b>	---	---
Lead	ppm	ASTM D5185m	>2	<b>0</b>	---	---
Copper	ppm	ASTM D5185m	>8	<b>&lt;1</b>	---	---
Tin	ppm	ASTM D5185m	>4	<b>&lt;1</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	---	---




ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	1	<b>&lt;1</b>	---	---
Barium	ppm	ASTM D5185m	0	<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	---	---
Manganese	ppm	ASTM D5185m	0	<b>&lt;1</b>	---	---
Magnesium	ppm	ASTM D5185m	0	<b>&lt;1</b>	---	---
Calcium	ppm	ASTM D5185m	0	<b>0</b>	---	---
Phosphorus	ppm	ASTM D5185m	5	<b>8</b>	---	---
Zinc	ppm	ASTM D5185m	0	<b>27</b>	---	---
Sulfur	ppm	ASTM D5185m	10	<b>0</b>	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<b>6</b>	---	---
Sodium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	---	---
Water	%	ASTM D6304	>0.01	<b>0.035</b>	---	---
ppm Water	ppm	ASTM D6304	>100	<b>358</b>	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.09	<b>0.204</b>	---	---





# OIL ANALYSIS REPORT

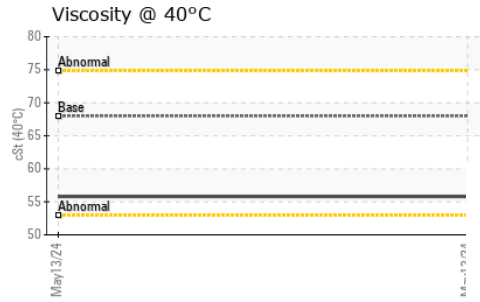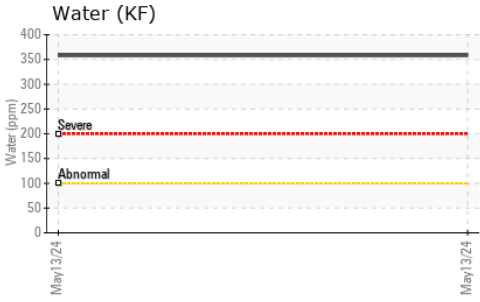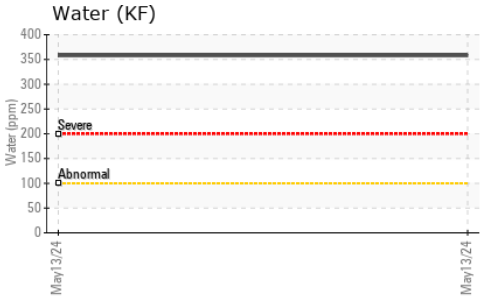





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	<b>NONE</b>	---	---
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	---	---
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	---	---
Silt	scalar	*Visual	NONE	<b>NONE</b>	---	---
Debris	scalar	*Visual	NONE	<b>NONE</b>	---	---
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	---	---
Appearance	scalar	*Visual	NORML	<b>NORML</b>	---	---
Odor	scalar	*Visual	NORML	<b>NORML</b>	---	---
Emulsified Water	scalar	*Visual	>0.01	<b>NEG</b>	---	---
Free Water	scalar	*Visual		<b>NEG</b>	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 68	<b>55.8</b>	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

## GRAPHS

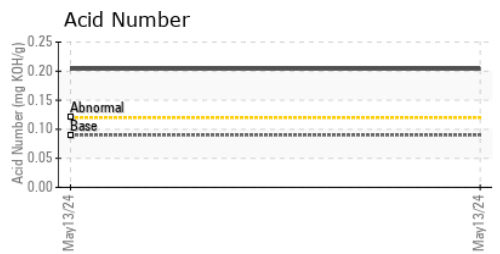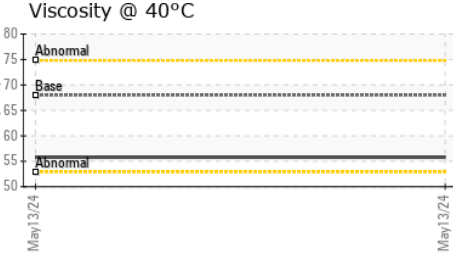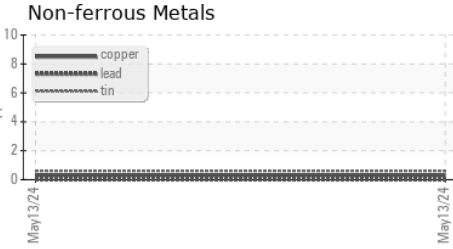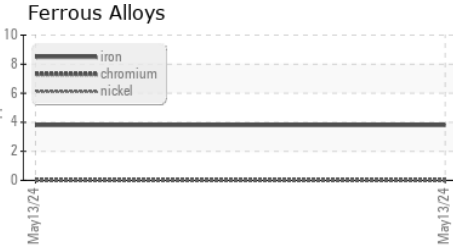

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0801211      **Received** : 17 Jun 2024  
**Lab Number** : **06211740**      **Tested** : 18 Jun 2024  
**Unique Number** : 11084604      **Diagnosed** : 19 Jun 2024 - Angela Borella  
**Test Package** : IND 2

**SCHNEIDER ELECTRIC**  
 PO DRAWER 185  
 MORRISVILLE, NC  
 US 27560  
 Contact: ERICH WEBBER  
 erich.webber@se.com  
 T: (919)274-4145  
 F: (919)467-7466

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)