



OIL ANALYSIS REPORT



Machine Id
YORK CFCC SCHNEIDER ELECTRIC CIRC 2 (S/N 11552N12866074)
 Component
Refrigeration Compressor
 Fluid
YORK TYPE L (--- GAL)

Sample Rating Trend



WATER



DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

Insufficient sample was received to conduct all the routine laboratory tests. There is a trace of moisture present in the oil.

Fluid Condition

The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC06211746	---	---
Sample Date	Client Info		21 Mar 2024	---	---
Machine Age	hrs	Client Info	14335	---	---
Oil Age	hrs	Client Info	14335	---	---
Oil Changed		Client Info	N/A	---	---
Sample Status			MARGINAL	---	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >8	0	---	---
Chromium	ppm	ASTM D5185m >2	0	---	---
Nickel	ppm	ASTM D5185m	0	---	---
Titanium	ppm	ASTM D5185m	<1	---	---
Silver	ppm	ASTM D5185m >2	0	---	---
Aluminum	ppm	ASTM D5185m >3	0	---	---
Lead	ppm	ASTM D5185m >2	0	---	---
Copper	ppm	ASTM D5185m >8	<1	---	---
Tin	ppm	ASTM D5185m >4	0	---	---
Vanadium	ppm	ASTM D5185m	<1	---	---
Cadmium	ppm	ASTM D5185m	0	---	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	0	---	---
Barium	ppm	ASTM D5185m 0	0	---	---
Molybdenum	ppm	ASTM D5185m 0	0	---	---
Manganese	ppm	ASTM D5185m 0	<1	---	---
Magnesium	ppm	ASTM D5185m 0	<1	---	---
Calcium	ppm	ASTM D5185m 0	0	---	---
Phosphorus	ppm	ASTM D5185m 0	2	---	---
Zinc	ppm	ASTM D5185m 0	<1	---	---
Sulfur	ppm	ASTM D5185m 10	17	---	---

CONTAMINANTS




	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	6	---	---
Sodium	ppm	ASTM D5185m	1	---	---
Potassium	ppm	ASTM D5185m >20	0	---	---
Water	%	ASTM D6304 >0.030	▲ 0.058	---	---
ppm Water	ppm	ASTM D6304 >300	▲ 581	---	---

VISUAL

	method	limit/base	current	history1	history2
White Metal	scalar	*Visual NONE	NONE	---	---
Yellow Metal	scalar	*Visual NONE	NONE	---	---
Precipitate	scalar	*Visual NONE	NONE	---	---
Silt	scalar	*Visual NONE	LIGHT	---	---
Debris	scalar	*Visual NONE	NONE	---	---
Sand/Dirt	scalar	*Visual NONE	NONE	---	---
Appearance	scalar	*Visual NORML	NORML	---	---
Odor	scalar	*Visual NORML	NORML	---	---
Emulsified Water	scalar	*Visual >0.030	NEG	---	---
Free Water	scalar	*Visual	NEG	---	---







OIL ANALYSIS REPORT

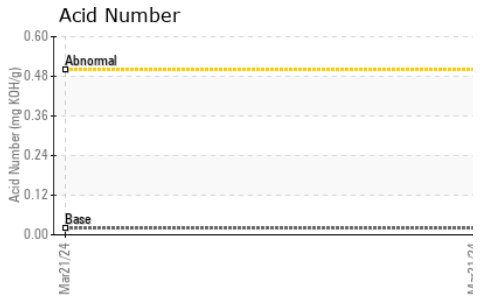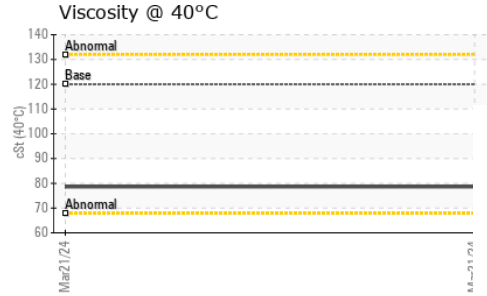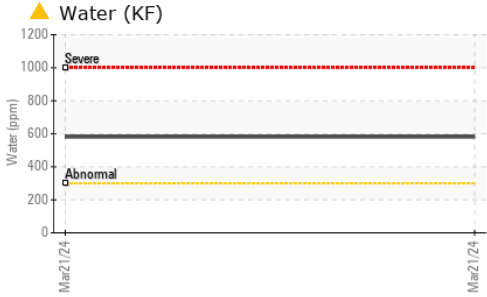

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 120	78.6	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

GRAPHS

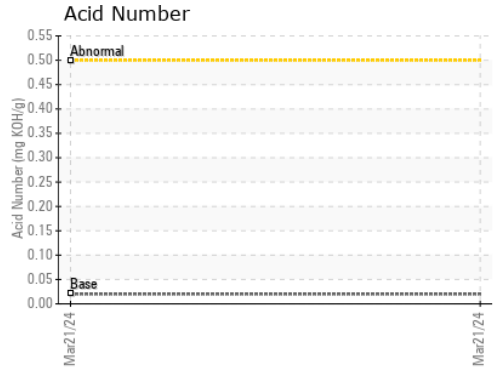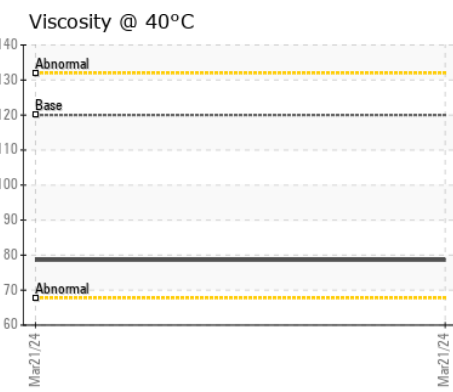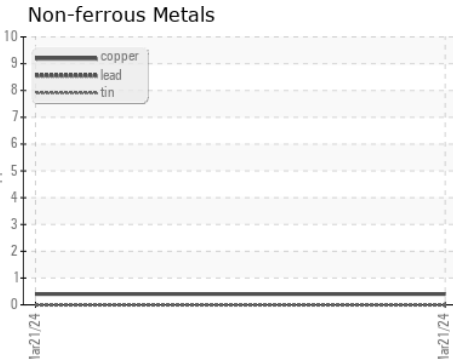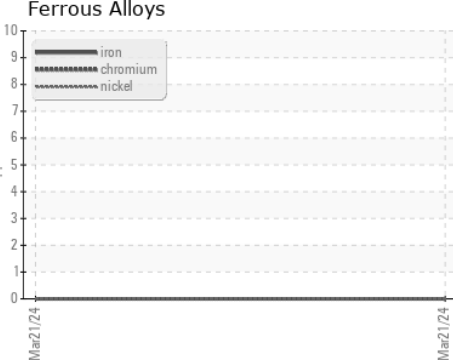

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC06211746 **Received** : 17 Jun 2024
Lab Number : **06211746** **Tested** : 20 Jun 2024
Unique Number : 11084610 **Diagnosed** : 20 Jun 2024 - Jonathan Hester
Test Package : IND 2

SCHNEIDER ELECTRIC
 PO DRAWER 185
 MORRISVILLE, NC
 US 27560
 Contact: ERICH WEBBER
 erich.webber@se.com
 T: (919)274-4145
 F: (919)467-7466

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)