




OIL ANALYSIS REPORT

Sample Rating Trend

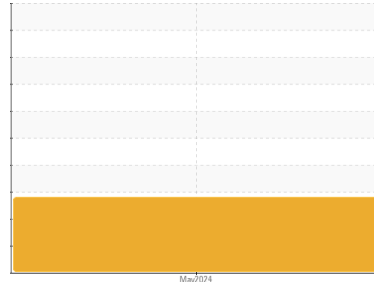

WATER



Machine Id
TRANE CFCC ND CHILLER CIRC 1 (S/N U09C03749)
 Component
Refrigeration Compressor
 Fluid
TRANE 0048 (2 GAL)

DIAGNOSIS

▲ Recommendation

The oil is near the end of its useful service life, recommend schedule an oil change. We recommend an early resample to monitor this condition.

Wear

All component wear rates are normal.

▲ Contamination

There is a trace of moisture present in the oil.

▲ Fluid Condition

The AN level is at the top-end of the recommended limit.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0801210	---	---
Sample Date	Client Info			13 May 2024	---	---
Machine Age	hrs	Client Info		35758	---	---
Oil Age	hrs	Client Info		0	---	---
Oil Changed	Client Info			Not Changed	---	---
Sample Status				ABNORMAL	---	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	<1	---	---
Chromium	ppm	ASTM D5185m	>2	0	---	---
Nickel	ppm	ASTM D5185m		0	---	---
Titanium	ppm	ASTM D5185m		<1	---	---
Silver	ppm	ASTM D5185m	>2	0	---	---
Aluminum	ppm	ASTM D5185m	>3	0	---	---
Lead	ppm	ASTM D5185m	>2	0	---	---
Copper	ppm	ASTM D5185m	>8	<1	---	---
Tin	ppm	ASTM D5185m	>4	<1	---	---
Vanadium	ppm	ASTM D5185m		<1	---	---
Cadmium	ppm	ASTM D5185m		0	---	---




ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	1	4	---	---
Barium	ppm	ASTM D5185m	0	0	---	---
Molybdenum	ppm	ASTM D5185m	0	0	---	---
Manganese	ppm	ASTM D5185m	0	<1	---	---
Magnesium	ppm	ASTM D5185m	0	<1	---	---
Calcium	ppm	ASTM D5185m	0	0	---	---
Phosphorus	ppm	ASTM D5185m	5	7	---	---
Zinc	ppm	ASTM D5185m	0	20	---	---
Sulfur	ppm	ASTM D5185m	10	0	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	6	---	---
Sodium	ppm	ASTM D5185m		<1	---	---
Potassium	ppm	ASTM D5185m	>20	0	---	---
Water	%	ASTM D6304	>0.01	▲ 0.029	---	---
ppm Water	ppm	ASTM D6304	>100	▲ 291	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.09	▲ 0.306	---	---



OIL ANALYSIS REPORT

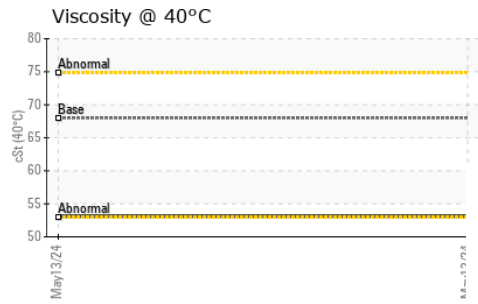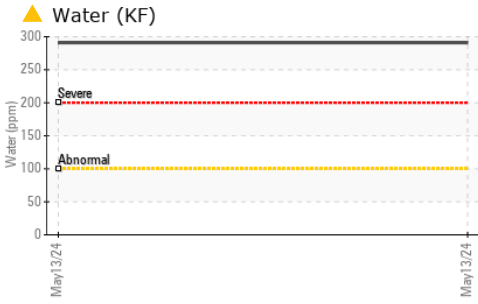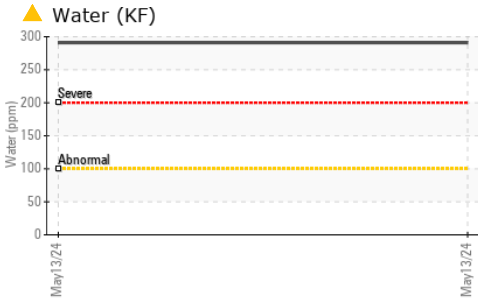





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	LIGHT	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.01	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 68	53.1	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

GRAPHS

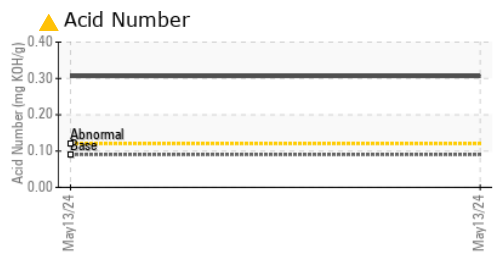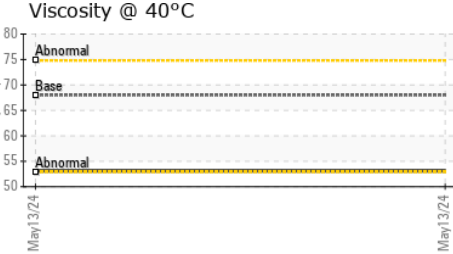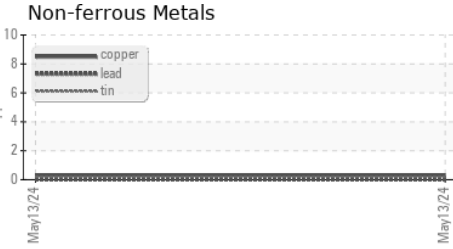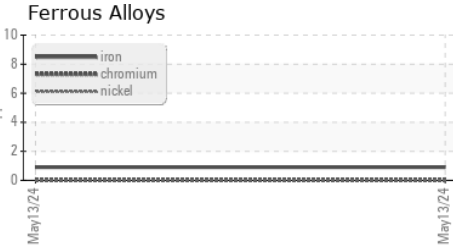

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0801210 **Received** : 17 Jun 2024
Lab Number : 06211747 **Tested** : 18 Jun 2024
Unique Number : 11084611 **Diagnosed** : 20 Jun 2024 - Jonathan Hester
Test Package : IND 2

SCHNEIDER ELECTRIC
 PO DRAWER 185
 MORRISVILLE, NC
 US 27560
 Contact: ERICH WEBBER
 erich.webber@se.com
 T: (919)274-4145
 F: (919)467-7466

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)