




# OIL ANALYSIS REPORT

Sample Rating Trend

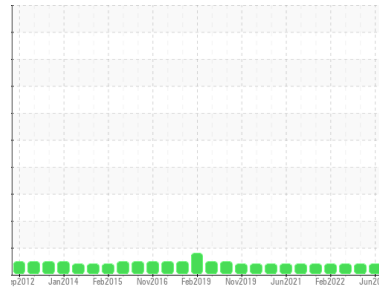

## VISCOSITY



Area  
**COMP-LUBE PLUS 10**  
 Machine Id  
**ALP 218615 - PUBLISHERS PRINTING**  
 Component  
**Compressor**

### DIAGNOSIS

#### Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil.

#### Fluid Condition

The oil viscosity is higher than normal. Confirm oil type. The AN level is acceptable for this fluid.

### SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>UCH06211803</b>	UCH05952864	UCH05567289
Sample Date	Client Info		<b>10 Jun 2024</b>	28 Aug 2023	27 May 2022
Machine Age	hrs	Client Info	<b>69922</b>	65331	58646
Oil Age	hrs	Client Info	<b>1000</b>	6000	8870
Oil Changed	Client Info		<b>Not Chngd</b>	Not Chngd	Changed
Sample Status			<b>ATTENTION</b>	ATTENTION	ATTENTION

### CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	<b>NEG</b>	NEG	NEG

### WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	<1	<1
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >25	<b>0</b>	<1	<1
Lead	ppm	ASTM D5185m >25	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >50	<b>&lt;1</b>	0	<1
Tin	ppm	ASTM D5185m >15	<b>0</b>	0	<1
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

### ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0.1	<b>0</b>	0	<1
Barium	ppm	ASTM D5185m 0.8	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m 0.9	<b>&lt;1</b>	0	0
Magnesium	ppm	ASTM D5185m 0	<b>0</b>	0	0
Calcium	ppm	ASTM D5185m 0	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m 409	<b>28</b>	199	239
Zinc	ppm	ASTM D5185m 0	<b>&lt;1</b>	0	0
Sulfur	ppm	ASTM D5185m 1290	<b>57</b>	539	335

### CONTAMINANTS



	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>2</b>	1	<1
Sodium	ppm	ASTM D5185m	<b>1</b>	<1	0
Potassium	ppm	ASTM D5185m >20	<b>0</b>	1	<1

### FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.537	<b>0.49</b>	1.02	0.63




# OIL ANALYSIS REPORT

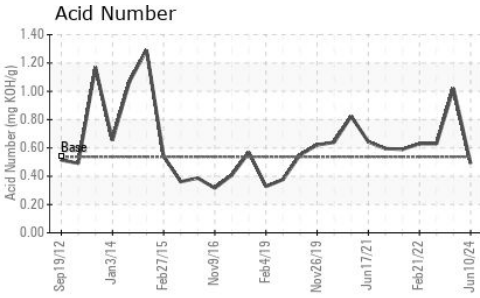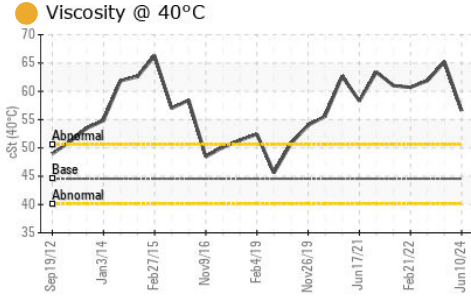





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	44.56	56.6	65.2

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

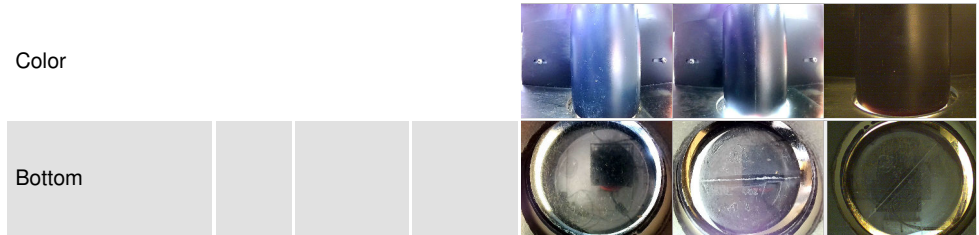

## GRAPHS

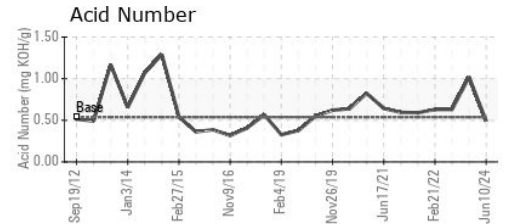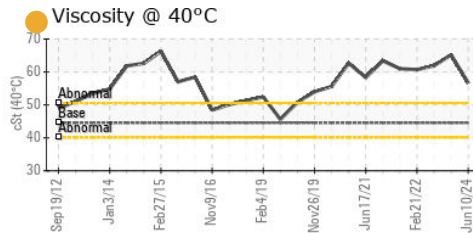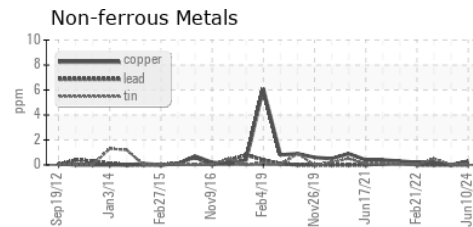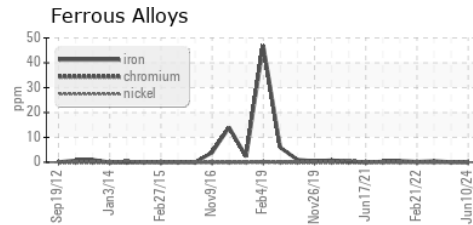

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCH06211803  
**Lab Number** : 06211803  
**Unique Number** : 11084667  
**Test Package** : IND 2

**Received** : 17 Jun 2024  
**Tested** : 18 Jun 2024  
**Diagnosed** : 19 Jun 2024 - Don Baldrige

**AIR SERVICE AND PARTS INC.**  
 2211 BUECHEL AVE  
 LOUISVILLE, KY  
 US 40218

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact: DWIGHT LOGSDON  
 dwight@airserviceandparts.com; canastasio@wearcheckusa.com

T: (502)239-1541

F: (502)239-7678