





# OIL ANALYSIS REPORT

Area  
**VISION 8000**  
 Machine Id  
**HODGE 2204020728**  
 Component  
**Compressor**

Sample Rating Trend

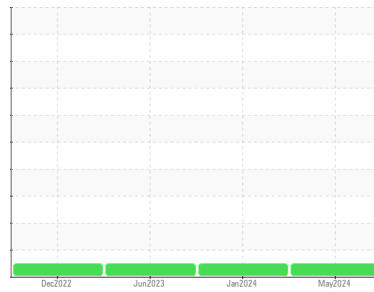

## DIAGNOSIS

**Recommendation**  
 Resample at the next service interval to monitor.

**Wear**  
 All component wear rates are normal.

**Contamination**  
 There is no indication of any contamination in the oil.

**Fluid Condition**  
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>UHC0001064</b>	UHC0001078	UHC0000717
Sample Date	Client Info		<b>21 May 2024</b>	31 Jan 2024	30 Jun 2023
Machine Age	hrs	Client Info	<b>6405</b>	5340	3324
Oil Age	hrs	Client Info	<b>2335</b>	1270	1273
Oil Changed	Client Info		<b>Changed</b>	Not Changd	Not Changd
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>3</b>	17	1
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >25	<b>&lt;1</b>	1	0
Lead	ppm	ASTM D5185m >25	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >50	<b>&lt;1</b>	<1	<1
Tin	ppm	ASTM D5185m >15	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0.3	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 0.3	<b>0</b>	0	<1
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m 0.9	<b>&lt;1</b>	0	0
Magnesium	ppm	ASTM D5185m 0.2	<b>0</b>	0	<1
Calcium	ppm	ASTM D5185m 0.1	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m 429	<b>481</b>	429	422
Zinc	ppm	ASTM D5185m 0.3	<b>43</b>	39	38
Sulfur	ppm	ASTM D5185m 1336	<b>1302</b>	1085	987

## CONTAMINANTS


	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>&lt;1</b>	1	2
Sodium	ppm	ASTM D5185m	<b>1</b>	3	0
Potassium	ppm	ASTM D5185m >20	<b>0</b>	1	1

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.622	<b>0.96</b>	0.44	0.65




# OIL ANALYSIS REPORT

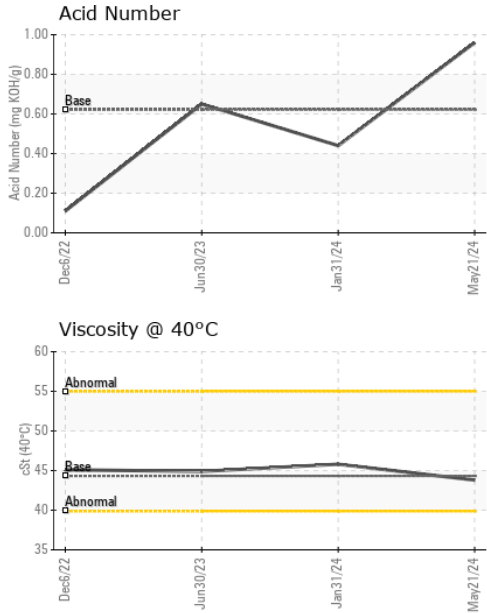





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	44.32	<b>43.8</b>	45.8	44.9

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

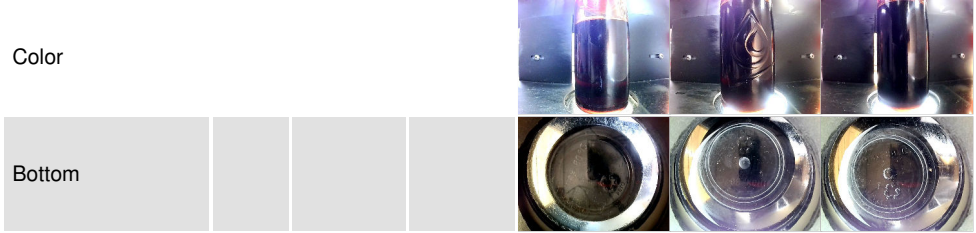

## GRAPHS

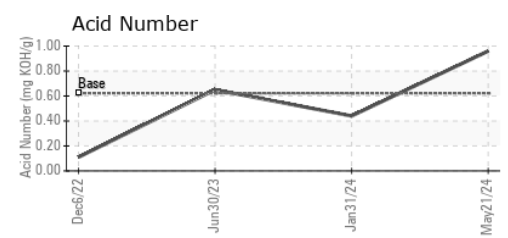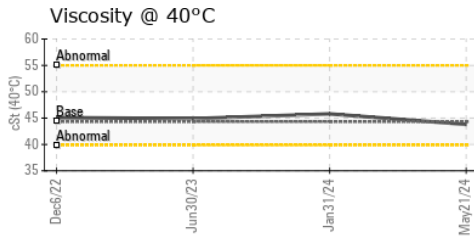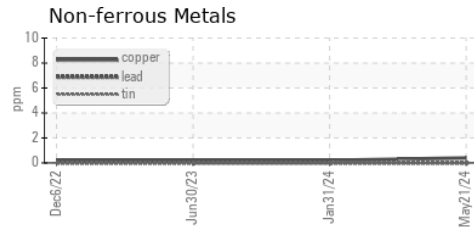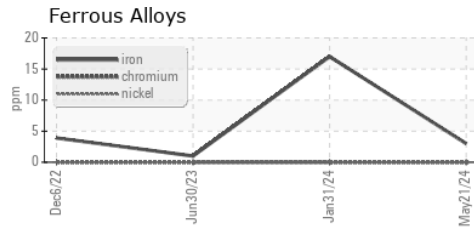

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UHC0001064      **Received** : 17 Jun 2024  
**Lab Number** : **06211830**      **Tested** : 18 Jun 2024  
**Unique Number** : 11084694      **Diagnosed** : 18 Jun 2024 - Wes Davis  
**Test Package** : IND 2

**ATLANTA AIR COMPRESSOR**  
 123 MERCHANTS PARK DR  
 HOSCHTON, GA  
 US 30548  
 Contact: Derik Bray  
 Derik@atlantaaircompressor.com  
 T: (470)252-9952  
 F: x:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)