




OIL ANALYSIS REPORT



Machine Id
Byron Center CAT 2 BYCM02BE
 Component
Biogas Engine
 Fluid
CHEVRON HDAX 9500 GAS ENGINE OIL 40 (--- GAL)

Sample Rating Trend

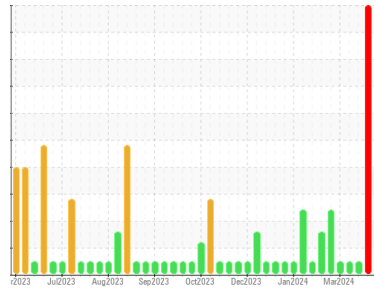

DIAGNOSIS

▲ Recommendation
 We advise that you inspect for the source(s) of wear. We recommend an early resample to monitor this condition.

▲ Wear
 The very high ferrous density (PQ) index indicates that severe wear is occurring. All component wear rates are normal.

Contamination
 There is no indication of any contamination in the oil.

Fluid Condition
 The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0640332	WC0640329	WC0640328
Sample Date	Client Info		14 Jun 2024	02 Apr 2024	25 Mar 2024
Machine Age	hrs	Client Info	74650	107968	107839
Oil Age	hrs	Client Info	48	573	420
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			SEVERE	SEVERE	NORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<1.0	<1.0	<1.0
Water	WC Method		NEG	NEG	NEG
Glycol	WC Method		NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184		▲ 24	---	---
Iron	ppm	ASTM D5185m >14	4	▲ 73	3
Chromium	ppm	ASTM D5185m >3	0	0	0
Nickel	ppm	ASTM D5185m	<1	0	0
Titanium	ppm	ASTM D5185m	0	<1	0
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >5	2	▲ 10	2
Lead	ppm	ASTM D5185m >8	0	2	2
Copper	ppm	ASTM D5185m >5	3	1	<1
Tin	ppm	ASTM D5185m >3	0	▲ 3	3
Vanadium	ppm	ASTM D5185m	0	<1	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	131	2	2
Barium	ppm	ASTM D5185m	0	0	0
Molybdenum	ppm	ASTM D5185m	6	1	<1
Manganese	ppm	ASTM D5185m	<1	2	0
Magnesium	ppm	ASTM D5185m	57	13	16
Calcium	ppm	ASTM D5185m	1472	1720	1777
Phosphorus	ppm	ASTM D5185m	487	231	286
Zinc	ppm	ASTM D5185m	573	314	343
Sulfur	ppm	ASTM D5185m	3994	3158	3554

CONTAMINANTS






	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >180	15	122	151
Sodium	ppm	ASTM D5185m >20	9	<1	<1
Potassium	ppm	ASTM D5185m >20	2	0	2

INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	0	0.1	0
Nitration	Abs/cm	*ASTM D7624	2.9	5.7	5.6
Sulfation	Abs/.1mm	*ASTM D7415	16.3	22.4	23.6



OIL ANALYSIS REPORT




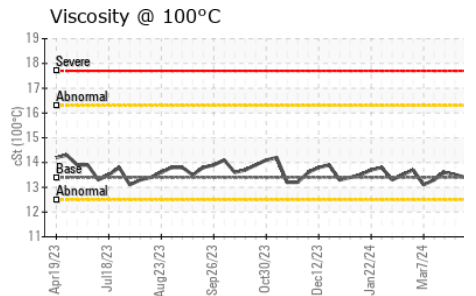
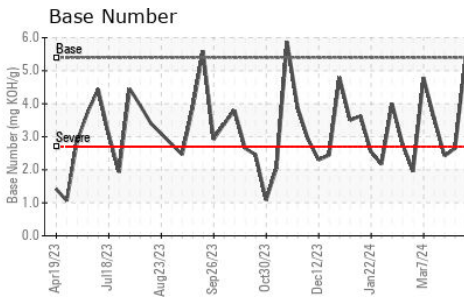
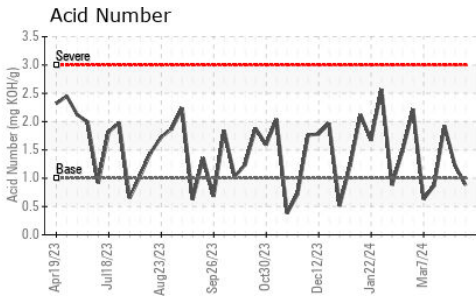
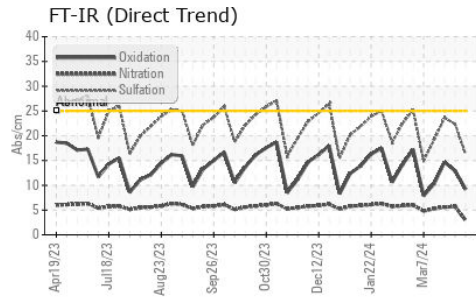
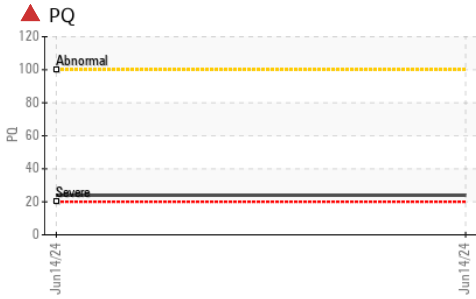


FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs./1mm	*ASTM D7414		9.2	12.9	14.7
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.88	1.22	1.92
Base Number (BN)	mg KOH/g	ASTM D2896	5.4	5.34	2.65	2.42

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual		NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.4	13.4	13.5	13.6

GRAPHS

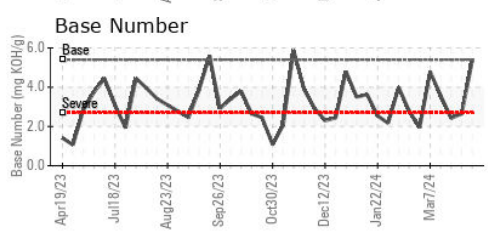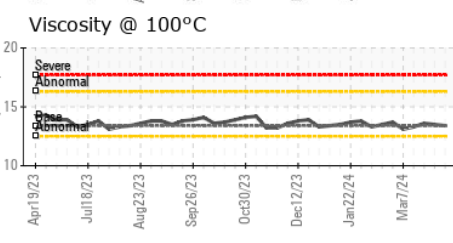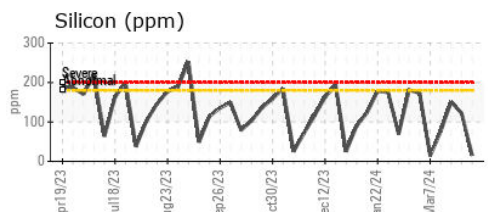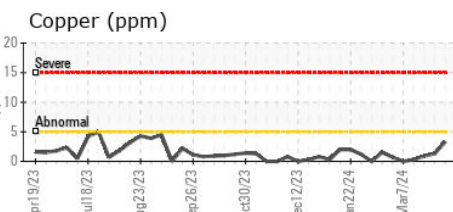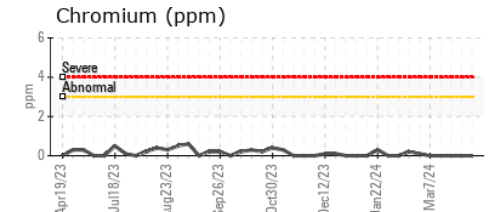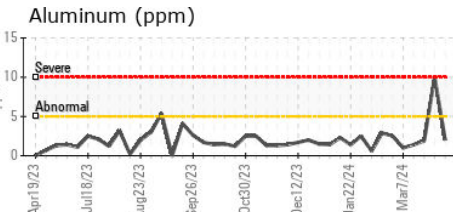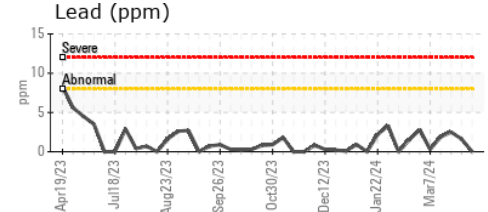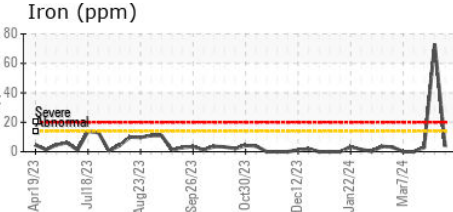

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0640332
Lab Number : 06211926
Unique Number : 11084790
Test Package : MOB 2 (Additional Tests: PQ)

Received : 17 Jun 2024
Tested : 20 Jun 2024
Diagnosed : 20 Jun 2024 - Jonathan Hester

EDL NA Recips-Byron Center
 Byron Center Powerstation, 10310 South Kent Road
 Byron Center, MI
 US 49315
 Contact: Jake Ripke
 Jake.Ripke@edlenergy.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)