


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



Area
Aji-Tein
Machine Id
CS-3501D
Component

Lube System

ROYAL PURPLE SYNFILM GT 46 (14 GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


| | | sp2018 Jun2 | 019 Mar2020 Dec2020 | Sep2021 Jul2022 Jun2023 | Mar2024 | |
|------------------|----------|--------------|---------------------|-----------------------------|-------------|-------------|
| SAMPLE INFORM | MATION | method | limit/base | current | history1 | history2 |
| Sample Number | | Client Info | | WC0941378 | WC0850060 | WC0870649 |
| Sample Date | | Client Info | | 13 Jun 2024 | 12 Mar 2024 | 10 Jan 2024 |
| Machine Age | mths | Client Info | | 0 | 0 | 0 |
| Oil Age | mths | Client Info | | 0 | 0 | 0 |
| Oil Changed | | Client Info | | N/A | N/A | N/A |
| Sample Status | | | | NORMAL | NORMAL | NORMAL |
| WEAR METALS | | method | limit/base | current | history1 | history2 |
| Iron | ppm | ASTM D5185m | >20 | 14 | 11 | 15 |
| Chromium | ppm | ASTM D5185m | >10 | 0 | <1 | <1 |
| Nickel | ppm | ASTM D5185m | >10 | 0 | <1 | 0 |
| Titanium | ppm | ASTM D5185m | | <1 | 0 | <1 |
| Silver | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Aluminum | ppm | ASTM D5185m | >10 | <1 | <1 | 2 |
| Lead | ppm | ASTM D5185m | >10 | 0 | 0 | 0 |
| Copper | ppm | ASTM D5185m | >75 | 22 | 20 | 23 |
| Tin | ppm | ASTM D5185m | >10 | 0 | 0 | <1 |
| Vanadium | ppm | ASTM D5185m | | <1 | 0 | 0 |
| Cadmium | ppm | ASTM D5185m | | 0 | 0 | 0 |
| ADDITIVES | | method | limit/base | current | history1 | history2 |
| Boron | ppm | ASTM D5185m | 0 | 0 | 0 | 0 |
| Barium | ppm | ASTM D5185m | 0 | <1 | 0 | 0 |
| Molybdenum | ppm | ASTM D5185m | 0 | 0 | 0 | <1 |
| Manganese | ppm | ASTM D5185m | | <1 | <1 | 0 |
| Magnesium | ppm | ASTM D5185m | 95 | 4 | 10 | 10 |
| Calcium | ppm | ASTM D5185m | 0 | 0 | 0 | <1 |
| Phosphorus | ppm | ASTM D5185m | 0 | 274 | 296 | 273 |
| Zinc | ppm | ASTM D5185m | 0 | 44 | 37 | 9 |
| Sulfur | ppm | ASTM D5185m | 15000 | 20674 | 23708 | 18770 |
| CONTAMINANTS | | method | limit/base | current | history1 | history2 |
| Silicon | ppm | ASTM D5185m | >20 | <1 | 0 | 0 |
| Sodium | ppm | ASTM D5185m | | 1 | 1 | 0 |
| Potassium | ppm | ASTM D5185m | >20 | 0 | 0 | <1 |
| Water | % | ASTM D6304 | | 0.009 | 0.001 | 0.003 |
| ppm Water | ppm | ASTM D6304 | | 93 | 8 | 31 |
| FLUID CLEANLIN | IESS | method | limit/base | current | history1 | history2 |
| Particles >4µm | | ASTM D7647 | >640 | 256 | 514 | 144 |
| Particles >6µm | | ASTM D7647 | >160 | 82 | 79 | 47 |
| Particles >14µm | | ASTM D7647 | >40 | 6 | 6 | 8 |
| Particles >21µm | | ASTM D7647 | >10 | 2 | 2 | 3 |
| Particles >38µm | | ASTM D7647 | >3 | 0 | 0 | 1 |
| Particles >71µm | | ASTM D7647 | >3 | 0 | 0 | 1 |
| Oil Cleanliness | | ISO 4406 (c) | >16/14/12 | 15/14/10 | 16/13/10 | 14/13/10 |
| FLUID DEGRADA | TION | method | limit/base | current | history1 | history2 |
| Acid Number (AN) | mg KOH/g | ASTM D8045 | | 1.03 | 1.073 | 0.97 |





OIL ANALYSIS REPORT












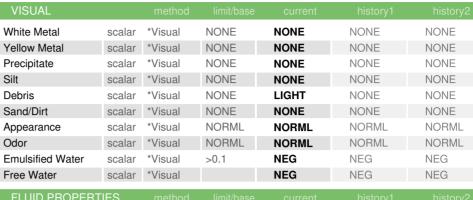


| 1 LOID I HOI LITTILO | | | | | | | |
|----------------------|-----|-----------|------|------|------|------|--|
| Visc @ 40°C | cSt | ASTM D445 | 46.0 | 47.3 | 47.3 | 47.3 | |

| MPLE IMAGES | method | |
|-------------|--------|--|
| | | |



Color

Bottom

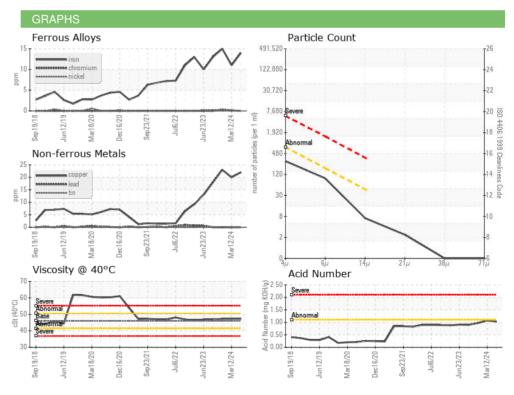





Certificate 12367

Laboratory

Sample No. Lab Number

: WC0941378 : 06212341 Unique Number : 11085205 Test Package : PLANT

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 17 Jun 2024 **Tested** : 19 Jun 2024

Diagnosed

: 19 Jun 2024 - Don Baldridge

To discuss this sample report, contact Customer Service at 1-800-237-1369.

 st - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

AJINOMOTO ANIMAL NUTRITION NORTH AMERICA, INC.

1116 HWY 137 EDDYVILLE, IA US 52553

Contact: Alan Brittain brittaina@ajiusa.com

T: (641)295-0086