




# OIL ANALYSIS REPORT

Sample Rating Trend

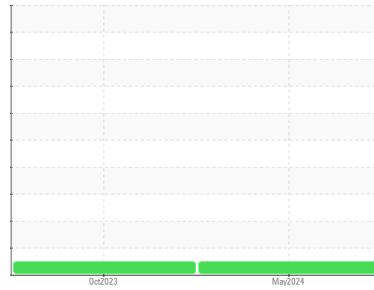

Machine Id  
**6312636 (S/N 1118)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

**Recommendation**  
 Resample at the next service interval to monitor.

**Wear**  
 All component wear rates are normal.

**Contamination**  
 There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

**Fluid Condition**  
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KCPA018164</b>	KCPA007498	---
Sample Date	Client Info		<b>28 May 2024</b>	10 Oct 2023	---
Machine Age	hrs	Client Info	<b>51385</b>	46086	---
Oil Age	hrs	Client Info	<b>3500</b>	0	---
Oil Changed	Client Info		<b>Changed</b>	N/A	---
Sample Status			<b>NORMAL</b>	NORMAL	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	0	---
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	---
Nickel	ppm	ASTM D5185m >3	<b>0</b>	<1	---
Titanium	ppm	ASTM D5185m >3	<b>&lt;1</b>	0	---
Silver	ppm	ASTM D5185m >2	<b>0</b>	<1	---
Aluminum	ppm	ASTM D5185m >10	<b>0</b>	0	---
Lead	ppm	ASTM D5185m >10	<b>0</b>	0	---
Copper	ppm	ASTM D5185m >50	<b>9</b>	8	---
Tin	ppm	ASTM D5185m >10	<b>0</b>	0	---
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	0	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	---
Barium	ppm	ASTM D5185m 90	<b>0</b>	0	---
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	---
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	0	---
Magnesium	ppm	ASTM D5185m 90	<b>&lt;1</b>	2	---
Calcium	ppm	ASTM D5185m 2	<b>0</b>	2	---
Phosphorus	ppm	ASTM D5185m	<b>1</b>	<1	---
Zinc	ppm	ASTM D5185m	<b>&lt;1</b>	0	---
Sulfur	ppm	ASTM D5185m	<b>18433</b>	17140	---

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>&lt;1</b>	0	---
Sodium	ppm	ASTM D5185m	<b>2</b>	0	---
Potassium	ppm	ASTM D5185m >20	<b>0</b>	0	---
Water	%	ASTM D6304 >0.05	<b>0.006</b>	0.006	---
ppm Water	ppm	ASTM D6304 >500	<b>68</b>	67.4	---






## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>1924</b>	2315	---
Particles >6µm	ASTM D7647 >1300		<b>467</b>	629	---
Particles >14µm	ASTM D7647 >80		<b>36</b>	79	---
Particles >21µm	ASTM D7647 >20		<b>8</b>	30	---
Particles >38µm	ASTM D7647 >4		<b>0</b>	2	---
Particles >71µm	ASTM D7647 >3		<b>0</b>	0	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	<b>18/16/12</b>	18/16/13	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	<b>0.46</b>	0.45	---


# OIL ANALYSIS REPORT

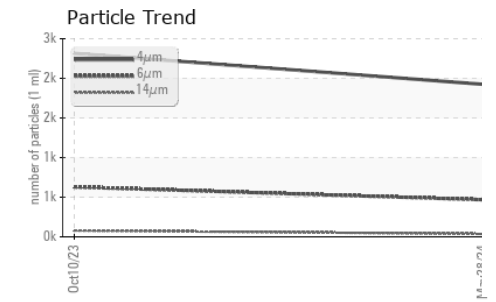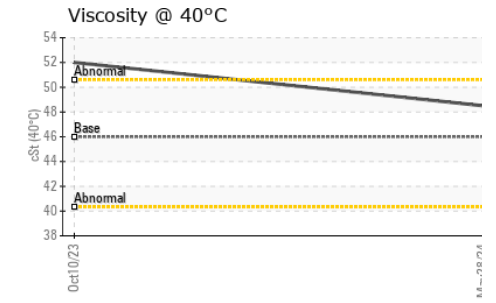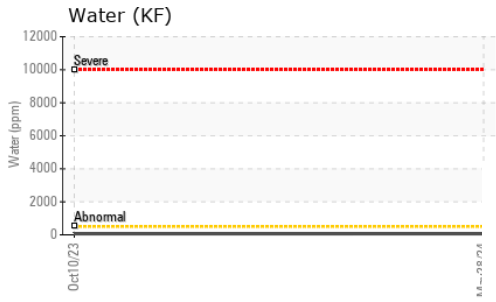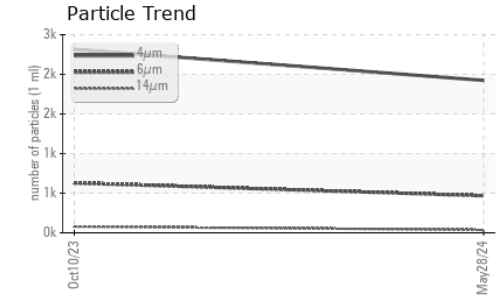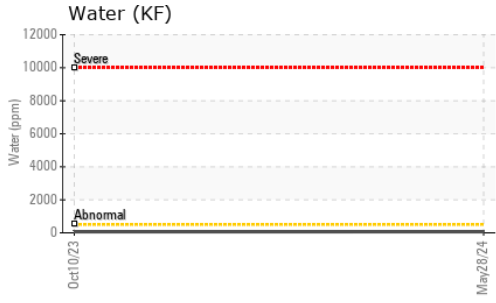






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	48.5	52.0

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

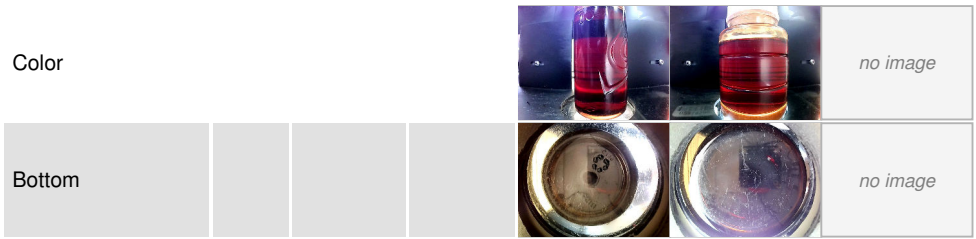

## GRAPHS

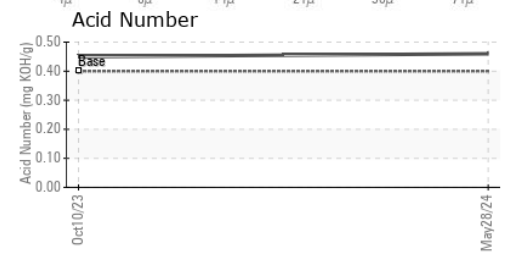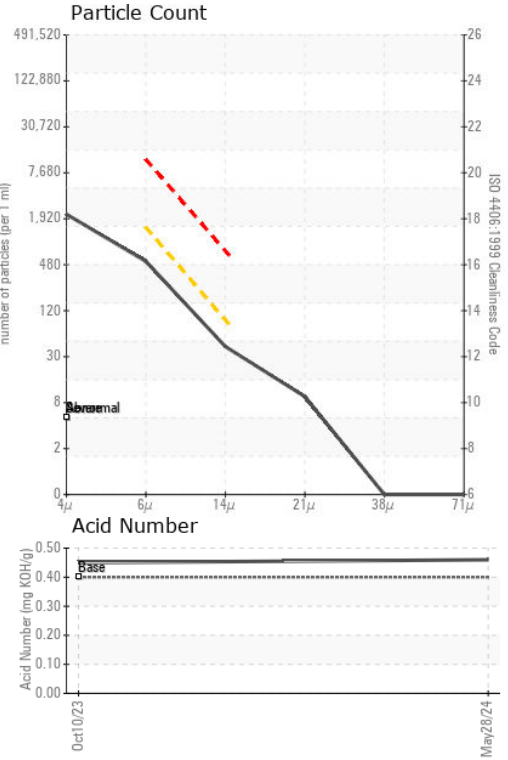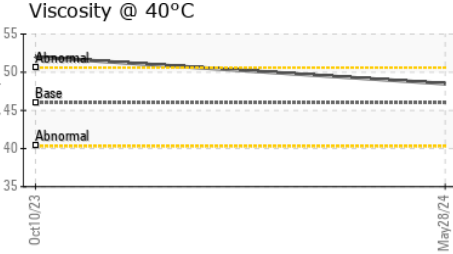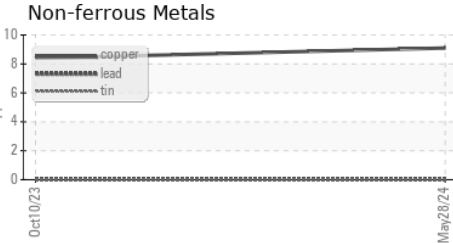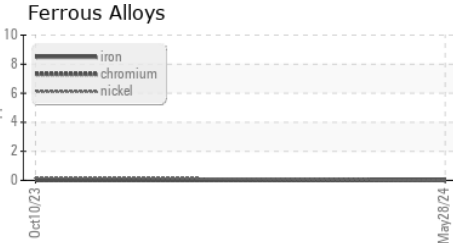

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA018164 **Received** : 17 Jun 2024  
**Lab Number** : 06212357 **Tested** : 19 Jun 2024  
**Unique Number** : 11085221 **Diagnosed** : 19 Jun 2024 - Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**BRIESS MALT AND INGREDIENTS CO**  
 37 S COLUMBIA ST  
 CHILTON, WI  
 US 53014  
 Contact: DILLON KOENIGS  
 dillon.koenigs@briess.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)